

**NFPA 262**  
**Standard**  
**Method**  
**of Tests for**  
**Flame Travel**  
**and Smoke of**  
**Wires and Cables**  
**for Use in**  
**Air-Handling**  
**Spaces**

**1999 Edition**



National Fire Protection Association, 1 Batterymarch Park, PO Box 9101, Quincy, MA 02269-9101  
An International Codes and Standards Organization

Copyright ©  
National Fire Protection Association, Inc.  
One Batterymarch Park  
Quincy, Massachusetts 02269

## IMPORTANT NOTICE ABOUT THIS DOCUMENT

NFPA codes and standards, of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in its codes and standards.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on this document. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making this document available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of this document. Nor does the NFPA list, certify, test or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

## NOTICES

All questions or other communications relating to this document and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA documents during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

Users of this document should be aware that this document may be amended from time to time through the issuance of Tentative Interim Amendments, and that an official NFPA document at any point in time consists of the current edition of the document together with any Tentative Interim Amendments then in effect. In order to determine whether this document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments, consult appropriate NFPA publications such as the *National Fire Codes*® Subscription Service, visit the NFPA website at [www.nfpa.org](http://www.nfpa.org), or contact the NFPA at the address listed above.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

The NFPA does not take any position with respect to the validity of any patent rights asserted in connection with any items which are mentioned in or are the subject of this document, and the NFPA disclaims liability of the infringement of any patent resulting from the use of or reliance on this document. Users of this document are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Users of this document should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

## **Licensing Policy**

This document is copyrighted by the National Fire Protection Association (NFPA). By making this document available for use and adoption by public authorities and others, the NFPA does not waive any rights in copyright to this document.

**1. Adoption by Reference** – Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term “adoption by reference” means the citing of title and publishing information only.

**2. Adoption by Transcription** – **A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA’s copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction’s lawmaking or rule-making process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA’s copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.

**3. Scope of License Grant** – The terms and conditions set forth above do not extend to the index of this document.

(For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

Copyright © 1999 NFPA, All Rights Reserved

## **NFPA 262**

# **Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces**

## **1999 Edition**

This edition of NFPA 262, *Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces*, was prepared by the Technical Committee on Fire Tests and acted on by the National Fire Protection Association, Inc., at its Fall Meeting held November 16–18, 1998, in Atlanta, GA. It was issued by the Standards Council on January 15, 1999, with an effective date of February 4, 1999, and supersedes all previous editions.

This edition of NFPA 262 was approved as an American National Standard on February 4, 1999.

## **Origin and Development of NFPA 262**

The test procedure covered by this standard was originally developed by Underwriters Laboratories Inc. and published as UL 910, *Standard for Safety Test for Flame-Propagation and Smoke-Density Values for Electrical and Optical-Fiber Cables Used in Spaces Transporting Environmental Air*. It is an adaptation of the Steiner tunnel test (NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Burning Materials*, ASTM E 84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, UL 723, *Tests for Surface Burning Characteristics of Building Materials*), which was designed to provide information for evaluating the potential for fire spread along cables and wires housed in a plenum or other environmental space. The original 1985 edition was reconfirmed in 1990. The 1994 edition contained minor editorial changes.

The 1999 edition has been revised to reflect the current practices that are being used with this type of test apparatus and procedure. Revisions have been made to the requirements associated with the fire test chamber transition, exhaust blower instrumentation, and data acquisition. The title and scope of this document have been editorially revised to reflect the true application of the test procedures, which was for the testing of flame travel and optical density of smoke for wires and cables used in an air-handling space.

## Technical Committee on Fire Tests

**Jesse J. Beitel**, *Chair*  
Hughes Assoc. Inc., MD [SE]

**April L. Berkol**, TT Sheraton Corp., NY [U]  
Rep. American Hotel & Motel Assn.  
**John A. Blair**, The DuPont Co., DE [M]  
Rep. Society of the Plastics Industry Inc.  
**William P. Chien**, State of New York Dept. of Fire Prevention & Control, NY [E]  
**William E. Fitch**, Omega Point Laboratories Inc., TX [RT]  
**Sam W. Francis**, American Forest & Paper Assn., PA [M]  
**Thomas W. Fritz**, Armstrong World Industries Inc., PA [M]  
**James R. Griffith**, Southwest Research Inst., TX [RT]  
**Marcelo M. Hirschler**, GBH Int'l, CA [SE]  
**Alfred J. Hogan**, Reedy Creek Improvement District, FL [E]  
Rep. Fire Marshals Assn. of North America  
**Karl D. Houser**, Gypsum Assn., DC [M]  
**William E. Koffel, Jr.**, Koffel Assoc., Inc., MD [SE]

**James R. Lawson**, U.S. Nat'l Inst. of Standards and Technology, MD [RT]  
**Gerald E. Lingenfelter**, American Insurance Services Group Inc., NY [I]  
**William S. Metes**, Underwriters Laboratories Inc., IL [RT]  
**George E. Meyer**, Warnock Hersey, Inc., CA [RT]  
**James A. Milke**, University of Maryland, MD [SE]  
**John Roberts**, Underwriters' Laboratories of Canada, Ontario, Canada [RT]  
**T. Hugh Talley**, Hugh Talley Co., TN [M]  
Rep. Upholstered Furniture Action Council  
**David K. Tanaka**, Factory Mutual Research Corp., MA [I]  
**Richard P. Thornberry**, The Code Consortium, Inc., CA [SE]  
**Kay M. Villa**, American Textile Mfrs. Inst., DC [M]  
**Robert J. Wills**, American Iron & Steel Inst., AL [M]  
**Peter J. Gore Willse**, HSB Industrial Risk Insurers, CT [I]

### Alternates

**Kenneth G. Adams**, Society of the Plastics Industry Inc., DC [M]  
(Alt. to J. A. Blair)  
**Delbert F. Boring, Jr.**, American Iron & Steel Inst., OH [M]  
(Alt. to R. J. Wills)  
**Tony Crimi**, Underwriters' Laboratories of Canada, Ontario, Canada [RT]  
(Alt. to J. Roberts)  
**Philip J. DiNunno**, Hughes Assoc., Inc., MD [SE]  
(Alt. to J. J. Beitel)  
**Richard G. Gann**, U.S. Nat'l Inst. of Standards and Technology, MD [RT]  
(Alt. to J. R. Lawson)  
**Marc L. Janssens**, Southwest Research Inst., TX [RT]  
(Alt. to J. R. Griffith)  
**John W. Michener**, Milliken Research Corp., SC [M]  
(Alt. to K. M. Villa)

**Gene V. Paolucci**, Yasuda Fire & Marine Insurance Co. of America, NY [I]  
(Alt. to G. E. Lingenfelter)  
**Nigel R. Stamp**, Intertek Testing Services NA Inc., WI [RT]  
(Alt. to G. E. Meyer)  
**Kuma Sumathipala**, American Forest & Paper Assn., DC [M]  
(Alt. to S. W. Francis)  
**William A. Thornberg**, HSB Industrial Risk Insurers, CT [I]  
(Alt. to P. J. G. Willse)  
**James J. Urban**, Underwriters Laboratories Inc., IL [RT]  
(Alt. to W. S. Metes)  
**Robert A. Wessel**, Gypsum Assn., DC [M]  
(Alt. to K. D. Houser)  
**Joe Ziolkowski**, American Furniture Mfrs. Assoc., NC [M]  
(Alt. to T. H. Talley)

### Nonvoting

**Robert H. Barker**, American Fiber Mfrs. Assn., DC [M]  
(Alt. to T. L. Jilg)  
**James F. Hoebel**, U.S. Consumer Product Safety Commission, MD [C]  
**Tod L. Jilg**, Hoechst Celanese Corp., NC [M]  
Rep. American Fiber Mfrs. Assn.

**Rohit Khanna**, U.S. Consumer Product Safety Commission, MD [C]  
(Alt. to J. F. Hoebel)  
**Herman H. Spaeth**, Novato, CA

**Walter P. Sterling**, NFPA Staff Liaison

*This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of this document.*

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

**Committee Scope:** This Committee shall have primary responsibility for documents on fire testing procedures, for reviewing existing fire test standards and recommending appropriate action to NFPA; for recommending the application of and advising on the interpretation of acceptable test standards for fire problems of concern to NFPA technical committees and members; and for acting in a liaison capacity between NFPA and the committees of other organizations writing fire test standards. This Committee does not cover fire tests that are used to evaluate extinguishing agents, devices, or systems.

## Contents

<b>Chapter 1 General</b> .....	262- 4	5-3 Number of Cable Lengths.....	262-11
1-1 Scope.....	262- 4	5-4 Cable Mounting.....	262-11
1-2 Significance.....	262- 4		
1-3 Purpose.....	262- 4	<b>Chapter 6 Test Procedure</b> .....	262-12
1-4 Summary of Test Method.....	262- 4	6-1 Procedure.....	262-12
1-5 Definitions.....	262- 4		
<b>Chapter 2 Test Apparatus</b> .....	262- 4	<b>Chapter 7 Post-Test Cleanup and Inspection</b> .....	262-12
2-1 Fire-Test Room.....	262- 4	7-1 Debris.....	262-12
2-2 Fire-Test Apparatus.....	262- 5	7-2 Windows.....	262-12
2-3 Ladder Cable Tray.....	262- 8	7-3 Supports.....	262-12
2-4 Fire-Test Chamber Airflow System.....	262- 9	7-4 Damaged Boards.....	262-12
2-5 Smoke Measurement System.....	262- 9	7-5 Preparation for Next Test.....	262-12
2-6 Fire-Test Chamber Temperature Measurement Instruments.....	262- 9	7-6 Cleanliness of Smoke Measurement System.....	262-12
2-7 Data-Acquisition Equipment.....	262- 9		
<b>Chapter 3 Test Specimens</b> .....	262- 9	<b>Chapter 8 Calculations</b> .....	262-12
3-1 Specimens.....	262- 9	8-1 Optical Density of Smoke.....	262-12
<b>Chapter 4 Calibration and Maintenance of Test Equipment</b> .....	262- 9	<b>Chapter 9 Report</b> .....	262-13
4-1 Frequency of Calibration.....	262- 9	9-1 Data.....	262-13
4-2 Airflow.....	262- 9		
4-3 Smoke Measurement System Calibration Test.....	262-10	<b>Chapter 10 Precision and Bias</b> .....	262-13
4-4 Fuel.....	262-10	10-1 Applicability.....	262-13
4-5 Chamber Temperature.....	262-10		
4-6 Standard Insulated Conductor Test.....	262-11	<b>Chapter 11 Referenced Publications</b> .....	262-13
4-7 Maintenance.....	262-11		
<b>Chapter 5 Test Specimen Preparation</b> .....	262-11	<b>Appendix A Explanatory Material</b> .....	262-13
5-1 Specimen Conditioning.....	262-11		
5-2 Determination of Specimen Diameter.....	262-11	<b>Appendix B Airflow, Smoke, and Heat Release Measurements</b> .....	262-14
		<b>Appendix C Referenced Publications</b> .....	262-17
		<b>Index</b> .....	262-17

## NFPA 262

## Standard Method of Test for

Flame Travel and Smoke of Wires and Cables  
for Use in Air-Handling Spaces

## 1999 Edition

NOTICE: An asterisk (\*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Appendix A.

Information on referenced publications can be found in Chapter 11 and Appendix C.

## Chapter 1 General

## 1-1 Scope.

**1-1.1\*** This standard describes the methodology to measure flame travel distance and optical density of smoke for insulated, jacketed, or both, electrical wires and cables that are to be installed in plenums and other spaces used to transport environmental air without being enclosed in raceways.

**1-1.2** This test method does not provide information on the fire performance of insulating materials contained in electrical or optical cables in fire conditions other than the ones specifically used in this standard, nor does it measure the contribution of the cables to a developing fire condition.

**1-1.3\*** Although this test uses equipment similar to that used in NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*, and ASTM E 84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, sufficient changes have been made to the chamber so that a test conducted in the apparatus used for NFPA 255 or ASTM E 84 cannot be considered identical or produce comparable results.

**1-1.4** The values stated in U.S. units are the standard. When a value for measurement is followed by a value in other units in parenthesis, the first stated value is the requirement.

**1-1.5** This standard does not purport to address all of the safety problems associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and to determine the applicability of regulatory limitations prior to use.

**1-2\* Significance.** This test is designed to provide comparative test data on insulated, jacketed, or both, electrical wires and cables that are to be installed in ducts, plenums, and other spaces used to transport environmental air without being enclosed in raceways. Such data are used to evaluate the potential for the spread of fire along electrical cables or wires or along optical fiber cables and to evaluate the potential for the development of high smoke levels in these spaces if the wires and cables are exposed to fire.

## 1-3 Purpose.

**1-3.1** The purpose of this test is to measure and record the fire and smoke characteristics of insulated, jacketed, or both, electrical wires and cables that are to be installed in ducts, plenums, and other spaces used to transport environmental air without being enclosed in raceways. The test measures the flame travel distance and optical density of smoke when a spec-

imen is exposed to the test fire. Optional measurements include heat and smoke release rates.

**1-3.2** Optical density of smoke and flame travel distance shall be recorded in this test. However, there is not necessarily a relationship between these measurements.

**1-3.3** This test method does not investigate circuit integrity characteristics or other such functionality performance during or after the fire test.

**1-3.4** This test method does not investigate the toxicity of the products of combustion or decomposition.

## 1-4 Summary of Test Method.

**1-4.1** This test method uses the apparatus described in Chapter 2 to determine flame travel distance and optical density of smoke from insulated, jacketed, or both, electrical wires and cables that are to be installed in ducts, plenums, and other spaces used to transport environmental air without being enclosed in raceways. The apparatus is similar to that described in UL 910, *Test Method for Fire and Smoke Characteristics of Electrical and Optical-Fiber Cables Used in Air Handling Spaces*. The test method shall expose a set of wire or cable specimens, 24 ft (7.32 m) long, installed on a horizontal ladder-type cable tray, to a controlled air and flaming fire exposure in a fire-test chamber. A special specimen holder is used to expose the test specimens. The holder, 11.25 in. (286 mm) wide and approximately 4.25 in. (108 mm) below the ceiling of the test chamber, is filled with one layer of test specimens. The specimens shall be exposed to a 300,000 Btu/hr (87.9 kW) fire, 4.25 ft (1.37 m) long, for a period of 20 minutes, with an initial draft of 240 ft/min (73 m/min) through the chamber. During the test, flame travel distance and optical density of smoke shall be measured, and peak and average optical density of smoke shall be calculated. Optional measurements shall be permitted to include heat and smoke release rates from the burning sample.

## 1-5 Definitions.

**Flame Travel Distance.** Distance that the flame travels beyond the extent of the gas burner flame.

**Optical Density of Smoke (OD).** Smoke obscuration described in terms of logarithmic ratio of initial light intensity to instantaneous light intensity.

**Shall.** Indicates a mandatory requirement.

**Should.** Indicates a recommendation or that which is advised but not required.

**Standard.** A document, the main text of which contains only mandatory provisions using the word "shall" to indicate requirements and which is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions shall be located in an appendix, footnote, or fine-print note and are not to be considered a part of the requirements of a standard.

## Chapter 2 Test Apparatus

**2-1 Fire-Test Room.** The fire-test room in which the test chamber is located shall have provision for a free inflow of air to maintain the room at controlled pressure of 0–0.05 in. (0–12 Pa) of water column greater than ambient barometric pressure and at a temperature of 73°F ± 5°F (23°C ± 3°C) and relative humidity of 50 ± 5 percent throughout each test run.

**2-2 Fire-Test Apparatus.** The fire-test apparatus shall consist of the following:

- (a) Air-inlet chamber
- (b) Fire-test chamber
- (c) Gas burners
- (d) Removable top cover
- (e) Exhaust transition
- (f) Exhaust system

**2-2.1 Air-Inlet Chamber.** The fire-test chamber air-inlet transition shall consist of an L-shaped galvanized steel unit secured to the air-inlet end of the fire-test chamber. The unit shall contain an 11.75 in.  $\pm$  0.25 in. (300 mm  $\pm$  6 mm)  $\times$  18.25 in.  $\pm$  0.25 in. (464 mm  $\pm$  6 mm) rectangular opening to allow air to enter the fire-test chamber through the chamber air-inlet shutter. A schematic of the air-inlet chamber is shown in Figure 2-2.1.

**2-2.1.1 Air-Inlet Shutter.** A vertically sliding shutter, extending the entire width of the test chamber, shall be provided at the air-inlet end of the fire-test chamber. The shutter shall be positioned to provide an air-inlet opening 3 in.  $\pm$  0.06 in. (76 mm  $\pm$  2 mm) high, measured from the floor level of the test chamber, as shown in Figure 2-2.1. [See also Figure 2-2.2.1(a).]

**2-2.2 Fire-Test Chamber.**

**2-2.2.1\*** The fire-test chamber shall consist of a horizontal duct of the shapes and sizes shown in Figures 2-2.2.1(a)

and (b). The sides and base of the duct shall be lined with insulating masonry, consisting of refractory fire brick, as illustrated in Figure 2-2.2.1(b). One side shall be provided with a row of two panes of  $\frac{1}{4}$  in. (6 mm) thick high-temperature glass, pressure-tight observation windows, with the inside pane mounted flush with the inner wall. [See Figure 2-2.2.1(b).] The exposed window area shall be 2.75 in.  $\pm$  0.25 in.  $\times$  11 in.  $\pm$  1.5 in. (70 mm  $\pm$  6.4 mm  $\times$  280 mm  $\pm$  38 mm). The windows shall be located so that the entire length of the specimens being tested is observable from outside the fire-test chamber.

**2-2.2.2\*** The top cover support ledges shall be fabricated of a structural material capable of withstanding abuse of continuous testing. The ledges shall be level with respect to length and width of the chamber and with respect to each other.

**2-2.2.3** To provide air turbulence for combustion, turbulence-inducing baffles shall be provided by positioning six 9 in. long  $\times$  4.5 in. wide  $\times$  2.5 in. thick (229 mm long  $\times$  114 mm wide  $\times$  64 mm thick) refractory fire bricks (long dimension vertical and 4.5 in. dimension parallel to the wall) along the side walls of the chamber at distances of 6.5 ft  $\pm$  0.5 ft (2.13 m  $\pm$  152 mm), 13 ft  $\pm$  0.5 ft (3.66 m  $\pm$  152 mm), and 19 ft  $\pm$  0.5 ft (6.10 m  $\pm$  152 mm), on the window side and 4.5 ft  $\pm$  0.5 ft (1.37 m  $\pm$  152 mm), 9.5 ft  $\pm$  0.5 ft (2.90 m  $\pm$  152 mm), and 16 ft  $\pm$  0.5 ft (4.88 m  $\pm$  152 mm) on the opposite side, as measured from the centerline of the gas burner.



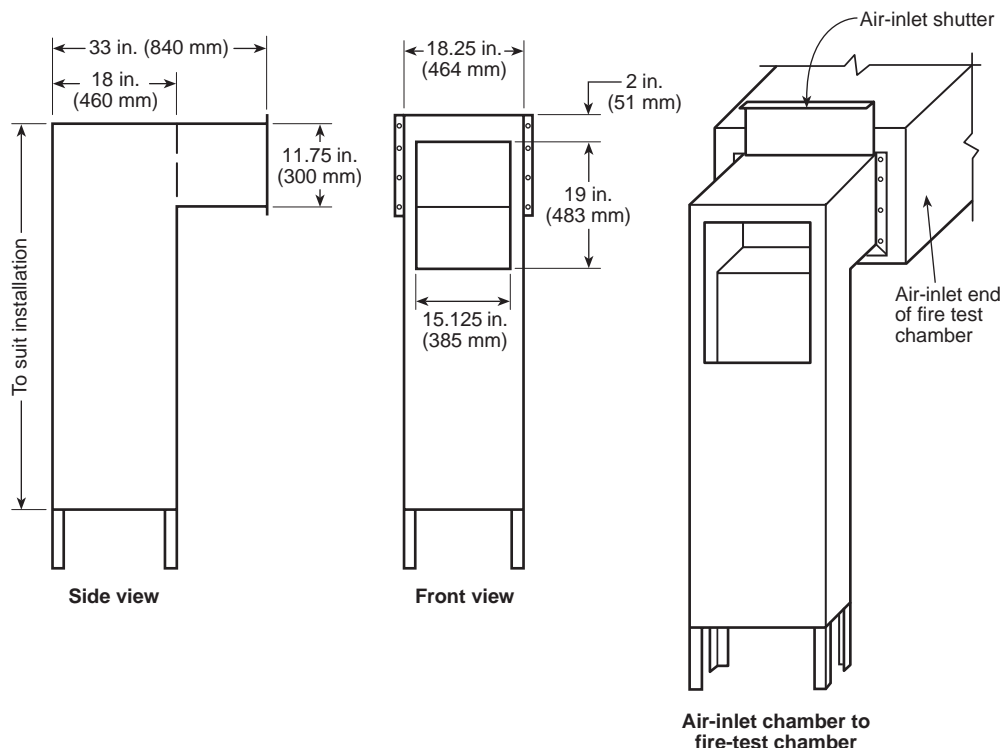


Figure 2-2.1 Schematic of the air-inlet chamber.

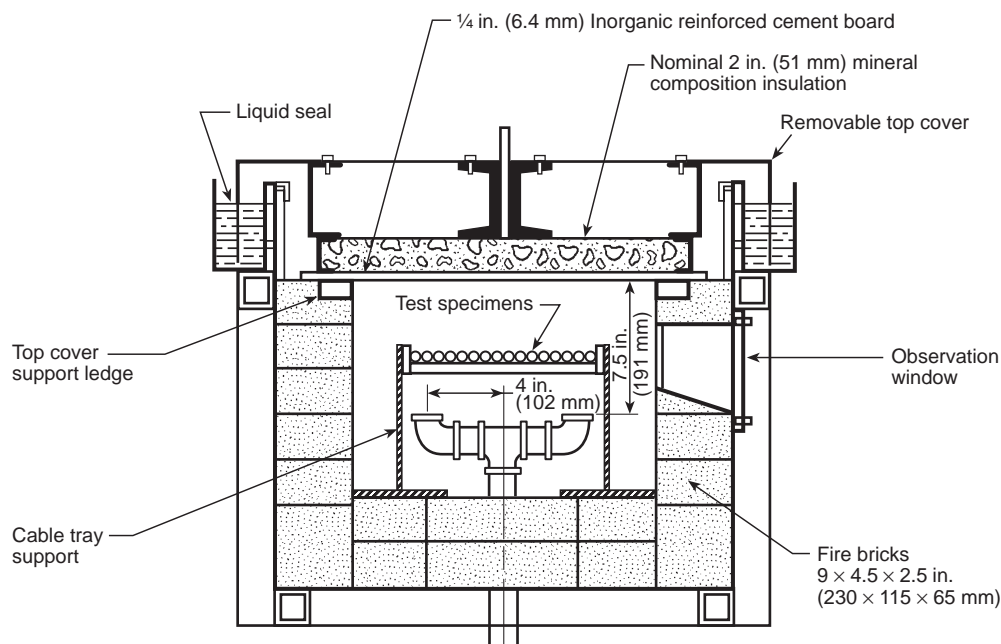

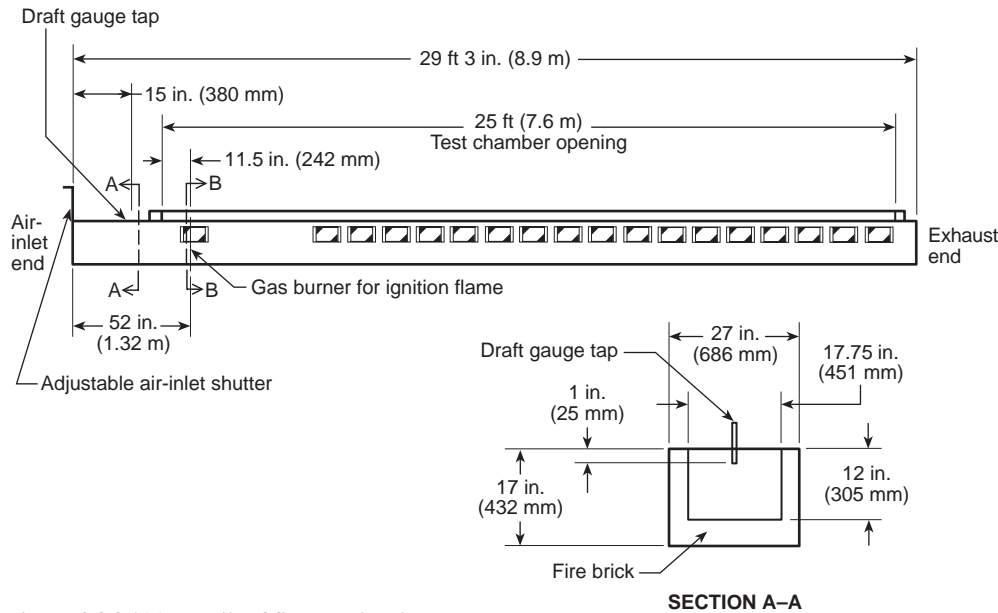

**2-2.3 Gas Burners.** One end of the test chamber, designated as the air-inlet end in Figure 2-2.2.1(a), shall be provided with a dual port gas burner, delivering flames upward, to engulf the test specimens. As shown in Figure 2-2.2.1(b), the burner shall be positioned transversely to each side of the centerline of the furnace so that the flame is evenly distributed over the width of the specimens. The burner shall be spaced 11.5 in.  $\pm$  0.5 in. (305 mm  $\pm$  13 mm) from the fire end of the test chamber, and 7.5 in.  $\pm$  0.25 in. (191 mm  $\pm$  6 mm) below the removable top cover. The burner shall be located

52 in.  $\pm$  2 in. (1320 mm  $\pm$  51 mm) downstream of the air-inlet shutter, as measured from the burner centerline to the outside surface of the shutter. Gas to the burner shall be provided through a single inlet pipe, distributed to each port burner through a tee-section. The outlet shall be a nominal  $3/4$  in. (19 mm) elbow. The plane of the ports shall be parallel to the furnace floor, such that the gas is directed upward toward the specimen. Each port shall be positioned with its centerline 4.0 in.  $\pm$  0.25 in. (102 mm  $\pm$  6 mm) on each side of the centerline of the fire-test chamber so that the ignition

burner flame is evenly distributed [see Figure 2-2.2.1(b)]. The controls used to maintain a constant flow of methane gas to the burners shall consist of the following:

- A pressure regulator
- A gas meter calibrated to read in increments of not more than 0.1 ft<sup>3</sup> (2.8 L)
- A gauge to indicate gas pressure in Pa (or inches of water)
- A quick-acting gas shutoff valve
- A gas metering valve
- An orifice plate in combination with a manometer to assist in maintaining uniform gas-flow conditions

Alternative control equipment, if shown to be equivalent, shall be permitted.

## 2-2.4 Removable Top Cover.

**2-2.4.1\*** The removable top cover shall consist of a metal and mineral insulation composite unit whose insulation consists of nominal 2 in. (51 mm) thick mineral composition material. The top unit is shown in Figure 2-2.2.1(b) and shall completely cover the fire-test chamber. The metal and mineral composite material shall have physical characteristics as follows:

- Maximum effective use temperature of not less than 1200°F (650°C)
- Bulk density of 21.0 lb/ft<sup>3</sup> ± 1.5 lb/ft<sup>3</sup> (335 kg/m<sup>3</sup> ± 20 kg/m<sup>3</sup>)
- Thermal conductivity of

$$0.50 \text{ to } 0.71 \frac{\text{Btu} \cdot \text{in.}}{\text{ft}^3 \cdot \text{hr} \cdot ^\circ\text{F}} \text{ at } 300 \text{ to } 700^\circ\text{F}$$

$$\left( 0.072 \text{ to } 0.102 \frac{\text{W}}{\text{m} \cdot \text{K}} \text{ at } 150 \text{ to } 370^\circ\text{C} \right)$$

- $K_{\rho c}$  product of

$$1 \text{ to } 4 \frac{\text{Btu}^2 \cdot \text{in.}}{\text{ft}^2 \cdot \text{hr} \cdot ^\circ\text{F}^2} \left( 1 \times 10^4 \text{ to } 4 \times 10^4 \frac{\text{W}^2 \cdot \text{sec}}{\text{m}^2 \cdot \text{K}^2} \right)$$

**2-2.4.2** The entire top-panel unit shall be protected with flat sections of high-density [nominally 110 lb/ft<sup>3</sup> (1760 kg/m<sup>3</sup>) 0.25 in. (6 mm) thick] mineral-fiber/cement board maintained in an unwarped and uncracked condition through continued replacement. While in place, the top panel shall rest on a nominal 1/8 in. (3 mm) thick woven fiberglass belting, positioned on the top cover support ledges. The top panel shall be completely sealed against the leakage of air into the fire-test chamber during the test. A water-filled trough, as shown in Figure 2-2.2.1(b) has been found suitable for this purpose.

## 2-2.5 Exhaust Transition.

**2-2.5.1** The exhaust end of the fire-test chamber shall be fitted with a transition piece. The exhaust transition shall consist of a stainless steel unit composed of a 35.5 in. ± 0.25 in. (902 mm ± 6 mm) long × 27 in. ± 0.25 in. (686 mm ± 6 mm) wide × 17.25 in. ± 0.25 in. (438 mm ± 6 mm) high rectangular section and an 18 in. ± 0.25 in. (457 mm ± 6 mm) long rectangular-to-round transition section connected to the 16 in. ± 0.125 in. (406 mm ± 3 mm) diameter exhaust duct. The outside of the transition section shall be insulated with a nominal 2 in. (51 mm) ceramic fiber blanket [nominal density 8 lb/ft<sup>3</sup> (130 kg/m<sup>3</sup>)]. The shape and size of the exhaust transition are shown in Figure 2-2.5.1.

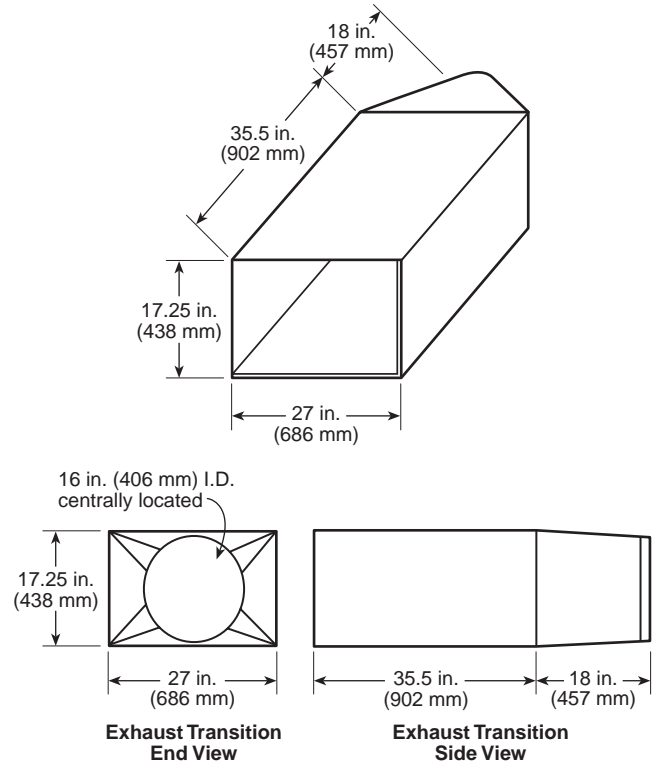


Figure 2-2.5.1 Schematic of the exhaust transition.

**2-2.5.2** The unit shall be secured to the exhaust end of the fire-test chamber.

**2-2.6 Exhaust System.** The exhaust system shall consist of the exhaust duct, smoke measurement system, exhaust duct damper, and a blower.

**2-2.6.1\* Exhaust Duct.** The 16 in. ± 0.125 in. (406 mm ± 3 mm) diameter exhaust duct shall be constructed from stainless steel and shall run 12 diameters horizontally in sufficient length downstream from the vent end of the rectangular-to-round transition, prior to location of instrumentation, to provide for a fully developed exhaust gas flow. It shall extend a minimum of 28 ft (8.5 m) from the vent end of the exhaust transition section. The duct shall be insulated with at least 2 in. (51 mm) of high-temperature mineral composition material from the end of the exhaust transition piece to the photometer location.

**2-2.6.2 Exhaust Duct Damper.** A single blade duct volume control damper, for a nominal 16 in. (406 mm) diameter duct, shall be positioned in the exhaust duct 5.5 ft ± 0.5 ft (1.7 m ± 0.2 m), downstream of the smoke measurement system. The relative locations of the exhaust transition piece, exhaust duct, smoke measurement system and exhaust duct damper are shown in Figure 2-2.6.2. To maintain airflow control throughout each test run, the exhaust-duct damper shall be controlled by a closed-loop feedback system with respect to the air inlet draft gauge static pressure.

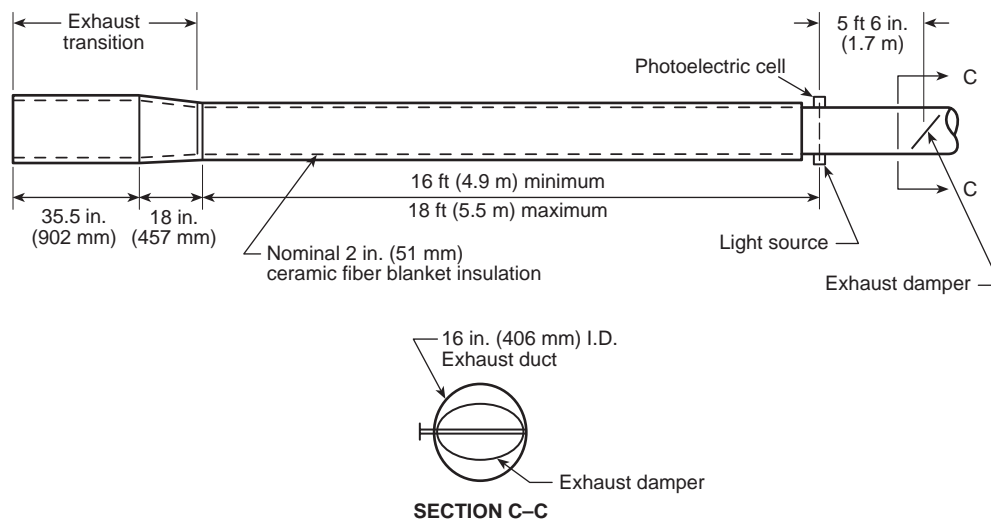


Figure 2-2.6.2 Location of exhaust transition, exhaust duct, smoke measurement system, and damper.

**2-2.7 Exhaust Blower.** The exhaust blower shall have the capacity to provide an average velocity of 240 ft/min  $\pm$  5 ft/min (1.22 m/sec  $\pm$  0.025 m/sec) at the inlet of the fire-test chamber during the test. The exhaust blower shall also have the capacity to develop at least 0.15 in. of water column (37 Pa) at the draft gauge tap, with the specimens in place, with the air shutter positioned to provide an air-inlet opening of 3 in.  $\pm$  0.06 in. (76 mm  $\pm$  2 mm), and with the exhaust duct damper in the wide-open position. (See 2-2.6.2.) The exhaust blower shall be located a minimum of 6 ft (1.8 m) downstream of the exhaust duct damper. (See 4-2.5.)

**2-3 Ladder Cable Tray.** The ladder-type cable tray used to support the open-cable test specimens or the cables-in-raceway test specimens is shown in Figure 2-3. The tray shall be fabri-

cated from cold-rolled steel of 50,000 psi (350 MPa) minimum tensile strength. The solid bar stock side rails shall be nominal 0.5 in.  $\pm$  0.125 in.  $\times$  0.37 in.  $\pm$  0.125 in. (38 mm  $\pm$  3 mm  $\times$  10 mm  $\pm$  3 mm), as shown in Section S-S in Figure 2-3. The C-shaped channel rungs shall be 0.5 in.  $\pm$  0.125 in.  $\times$  1 in.  $\pm$  0.125 in.  $\times$  0.125 in.  $\pm$  0.06 in. (13 mm  $\pm$  3 mm  $\times$  25 mm  $\pm$  3 mm  $\times$  3 mm  $\pm$  1 mm) structural channels, as shown in Section Q-Q in Figure 2-3. Each rung shall be 11.25 in.  $\pm$  0.125 in. (286 mm  $\pm$  3 mm) long. The rungs shall be welded to the side rails 9 in.  $\pm$  0.125 in. (229 mm  $\pm$  3 mm) on centers along the tray length. The tray shall consist of one or more sections having a total assembled length of 24 ft  $\pm$  2 in. (7.3 m  $\pm$  51 mm) and shall be supported with 16 supports equally spaced along the length of the tray. The supports, as shown in Figure 2-3, shall be fabricated from bar steel.

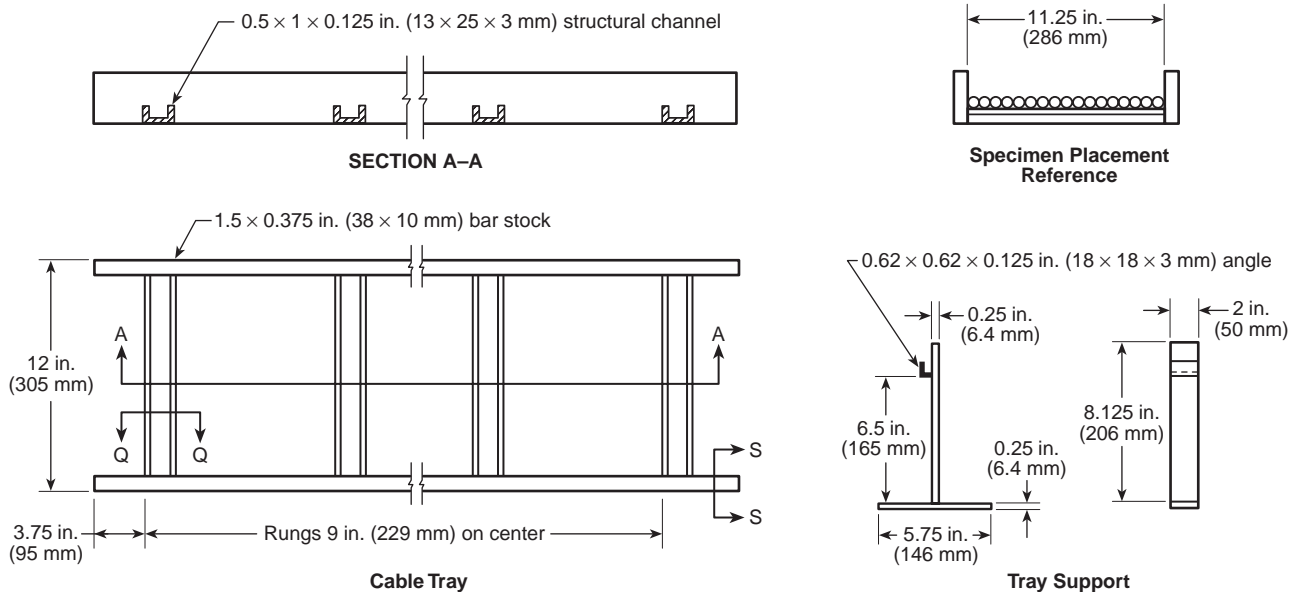


Figure 2-3 Details of ladder cable tray and supports.

## 2-4 Fire-Test Chamber Airflow System.

**2-4.1** An air intake, fitted with a vertically sliding shutter that extends the entire width of the test chamber, shall be provided at the fire end. The draft plate shall be positioned to provide an air-inlet port, as shown in Figure 2-2.1.

**2-4.2** Movement of air throughout the exhaust duct shall be by induced draft. The draft-inducing system shall have a total draft capacity of at least 0.15 in. of water column (37 Pa) with the specimens in place, with the shutter at the fire end open to its normal position, and with the damper in the wide-open position. (See Section C-C in Figure 2-2.6.2.) A draft-gauge manometer to indicate static pressure shall be inserted through the top at the mid width of the tunnel, 1.0 in.  $\pm$  0.5 in. (25 mm  $\pm$  13 mm) below the ceiling, and 15.0 in.  $\pm$  0.5 in. (380 mm  $\pm$  13 mm) downstream of the air intake shutter as shown in Section C-C of Figure 2-2.6.2.

**2-4.3** An automatic draft-regulator controller shall be mounted in the vent pipe downstream of the exhaust damper. Other manual, automatic, or special draft-regulation devices shall be permitted to be incorporated to maintain airflow control throughout each test run.

## 2-5 Smoke Measurement System.

**2-5.1\*** A 12-V sealed-beam, clear lens, auto spot lamp, operated at 12 V  $\pm$  0.05 V dc light source, shall be mounted on a horizontal section of the exhaust duct. (See Figure 2-5.1.) The lamp shall be located at a point that is preceded by a straight run of round pipe at least 12 diameters, or 16 ft  $\pm$  0.5 ft (4.88 m  $\pm$  0.005 m), from the vent end of the rectangular-to-round transition section. The lamp shall be placed where it is not affected by flame from the test chamber. The light beam shall be directed upward along the vertical axis of the vent pipe. The vent pipe shall be insulated with high-temperature mineral composition material from the vent end of the chamber to the photometer location. A photoelectric cell having an output directly proportional to the amount of light received shall be mounted over the light source, with an overall light-to-cell path distance of 36 in.  $\pm$  2 in. (910 mm  $\pm$  50 mm), 16 in. (406 mm) of which shall be taken up by the smoke in the exhaust duct, as shown in Section C-C of Figure 2-2.6.2. The light source and photoelectric cell shall be located such that they are open to the environment of the test room. The cylindrical light beam shall pass through 3-in. (76-mm) diameter openings at the top and bottom of the 16-in. (406-mm) diameter duct, with the resultant light beam centered on the photoelectric cell. The cell shall be connected to recording devices that indicate the attenuation of incident light due to particulate matter, and due to other effluents, in the passing smoke.

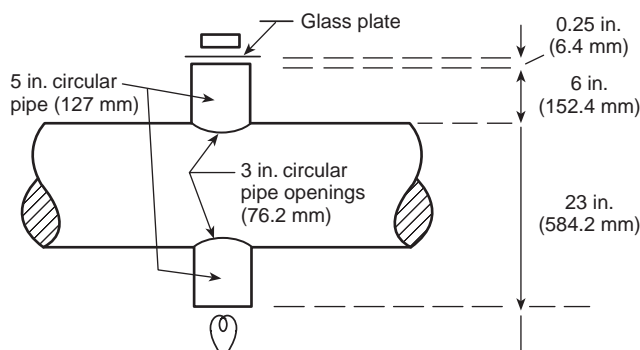


Figure 2-5.1 Light source mounting.

**2-5.2** The photoelectric cell output shall be connected to a data-acquisition device as specified in Section 2-7.

## 2-6 Fire-Test Chamber Temperature Measurement Instruments.

**2-6.1** A 19 AWG chromel-alumel thermocouple [nominal wire cross section of 0.0359 in. (0.912 mm)], with 0.375 in.  $\pm$  0.125 in. (10 mm  $\pm$  3 mm) of the junction exposed in the fire-chamber air, shall be inserted through the floor of the test chamber. The tip of the thermocouple shall be 1 in.  $\pm$  0.125 in. (25 mm  $\pm$  3 mm) below the top surface of the glass fiber belting, 23 ft  $\pm$  0.5 in. (7010 mm  $\pm$  13 mm) from the centerline of the burner ports, and at the center of the width of the chamber.

**2-6.2** A 19 AWG chromel-alumel thermocouple [nominal wire cross section of 0.0359 in. (0.912 mm)], embedded 0.125 in.  $\pm$  0.06 in. (3.2 mm  $\pm$  1.6 mm) below the floor surface of the test chamber, shall be mounted in refractory or portland cement (carefully dried to keep it from cracking) at distances of 13 ft  $\pm$  0.5 in. and 23.25 ft.  $\pm$  0.5 in. (4.0 m  $\pm$  13 mm and 7.1 m  $\pm$  13 mm) from the centerline of the burner.

**2-7 Data-Acquisition Equipment.** A digital data-acquisition system shall be used to collect and record light attenuation and temperature measurements. The speed and capacity of the data system shall be capable of collecting the data at intervals of 2 seconds. The data-acquisition system shall have an accuracy corresponding to at least 1°F (0.5°C) for the temperature-measuring channels and 0.01 percent of full-scale instrument output for all other instrument channels. A smoothing routine shall not be used to process the data.

## Chapter 3 Test Specimens

**3-1 Specimens.** Test specimens shall consist of 24 ft.  $\pm$  6 in. (7.32 m  $\pm$  152 mm) lengths of cables installed in a single layer across the bottom of the cable tray, as shown in Figure 2-2.2.1 (b).

## Chapter 4 Calibration and Maintenance of Test Equipment

**4-1 Frequency of Calibration.** The test apparatus shall be calibrated, as described in Sections 4-2 through 4-6 at a minimum of one month intervals.

### 4-2 Airflow.

**4-2.1** A 24 in.  $\pm$  0.125 in. (610 mm  $\pm$  3 mm)  $\times$  14 in.  $\pm$  0.125 in. (356 mm  $\pm$  3 mm)  $\times$  0.06 in.  $\pm$  0.03 in. (2 mm  $\pm$  1 mm) steel plate shall be placed on the top cover support ledges at the air-inlet end of the fire-test chamber, over the gas burner. Then three 8 ft  $\pm$  0.5 in. (2.44 m  $\pm$  13 mm)  $\times$  2 ft  $\pm$  0.5 in. (61 mm  $\pm$  13 mm)  $\times$  0.25 in.  $\pm$  0.125 in. (6 mm  $\pm$  3 mm) mineral-fiber/cement boards shall be placed to fill the remaining length of the fire-test chamber, placed end-to-end on the ledge of the furnace chamber, as shown in Figure 2-2.2.1 (b). The material for the board shall be as defined in 2-2.4.2. The removable top of the test chamber shall then be placed in position.

**4-2.2** The air supply shall be maintained at 73°F  $\pm$  5°F (23°C  $\pm$  3°C). Relative humidity shall be kept at 50 percent  $\pm$  5 percent during the test.

**4-2.3\* Air Leakage Test.** The draft shall be established to produce a static pressure 0.15 in. water column (37 Pa) reading on the draft manometer with the following conditions:

- (a) Board in position and removable top in place
- (b) Fire end shutter open 3 in.  $\pm$  0.06 in. (76 mm  $\pm$  2 mm)
- (c) Exhaust damper in the wide-open position

The fire end shutter shall then be closed and sealed. The manometer reading shall be increased to at least a 0.375-in. water column (93 Pa), which indicates that no excessive air leakage exists. The static pressure reading obtained shall be recorded.

**4-2.4 Supplemental Air Leakage Test.** In addition to the procedures of 4-2.3, a supplemental leakage test shall be conducted: A smoke bomb shall be activated in the fire chamber while the fire shutter and exhaust duct beyond the differential manometer tube are sealed. The bomb shall be ignited and the chamber pressurized to a 0.025-in. water column (6.2 Pa). All points of leakage observed in the form of escaping smoke particles shall be sealed.

**4-2.5\* Velocity Traverse Test.** A draft reading shall be established within the range of a 0.075–0.085-in. water column (17–19 kPa). The required draft-gauge reading shall be maintained throughout the test by regulating the controlled exhaust damper.

The air velocity at each of seven points, each located 23 in.  $\pm$  1 in. (7 m  $\pm$  3 mm) from the centerline of the gas burner, and 6 in.  $\pm$  0.25 in. (152 mm  $\pm$  6 mm) below the plane of the top cover support ledges, shall be recorded. These seven points shall be determined by dividing the width of the tunnel into seven equal sections and recording the velocity at the geometric center of each section.

During the measurement of velocity, the turbulence blocks shall be removed and straightening vanes, 24 in.  $\pm$  0.125 in. (670 mm  $\pm$  3 mm)  $\times$  12 in.  $\pm$  0.125 in. (305 mm  $\pm$  3 mm), shall be placed 16–18 ft (4.9–5.5 m) from the burner. The straightening vanes shall divide the chamber cross section into nine uniform sections. The average velocity shall be 240 ft/min  $\pm$  5 ft/min (1.22 m/sec  $\pm$  0.025 m/sec), determined using a velocity transducer. The air-inlet static pressure shall be recorded. Following calibration, this pressure shall be maintained to within  $\pm 5$  percent for all testing.

**4-3\* Smoke Measurement System Calibration Test.** The light source and photoelectric cell shall be calibrated using 10 neutral density filters with values of 0.1, 0.2, 0.3, 0.4, 0.5, 0.6, 0.7, 0.8, 0.9, and 1.0. Each filter shall be positioned in front of the photoelectric cell to cover the entire width of the light path. The light obscuration using the neutral density filters shall be used to calculate the optical density of smoke as follows:

$$OD = \log_{10} \frac{I_0}{I}$$

where:

OD = optical density

$I_0$  = clear beam photo detector signal

$I$  = photo detector signal with the neutral density filter

The calculated values of OD for each filter shall agree within 3 percent of the neutral density values. The total tolerance of all filters shall be within 1 percent.

**4-4\* Fuel.** The test fire, which produces 300,000 Btu/hr  $\pm$  7500 Btu/hr (88 kW  $\pm$  2 kW), shall be fueled with bottled methane gas of a minimum 98 percent purity and with a high heating value of 1000 Btu/ft<sup>3</sup>  $\pm$  15 Btu/ft<sup>3</sup> (37 MJ/m<sup>3</sup>  $\pm$  0.5

MJ/m<sup>3</sup>), determined using a gas calorimeter. The gas supply shall be adjusted initially to approximately 5000 Btu/min  $\pm$  125 Btu/min (88 kW  $\pm$  2 kW). The gas pressure, the pressure differential across the orifice plate, and the volume of gas used shall be recorded in each test. A length of coiled copper tubing shall be inserted into the gas line between the supply and the metering connection to compensate for possible errors in the indicated flow because of reductions in the gas temperature associated with the pressure drop and expansion across the regulator. Other applicable means of correction shall be permitted to be used provided equivalence has been demonstrated by reaching the appropriate fuel levels. With the draft and the gas supplies adjusted, as indicated in 4-2.5 and in this paragraph, the test flame shall extend downstream to a distance of 4.5 ft (1.37 m) over the specimens, with negligible upstream coverage.

#### 4-5 Chamber Temperature.

**4-5.1\* Temperature Preheat Test.** The fire-test chamber shall be preheated with the steel plate described in 4-2.1 and one layer of nominally  $\frac{1}{4}$  in. (6 mm) thick  $\times$  8 ft long mineral-fiber/cement board, wide enough to be placed on the ledge of the furnace chamber as shown in Figure 2-2.2.1 (b), with the material for the board as defined in 2-2.4.2, and with the removable top in place. The fuel supply shall be adjusted to the required flow to produce a 300,000 Btu/hr  $\pm$  7500 Btu/hr (88 kW  $\pm$  2 kW) flame, with the air-inlet shutter providing an opening of 3 in.  $\pm$  0.06 in. (76 mm  $\pm$  2 mm).

**4-5.2** Preheating shall be continued until the temperature indicated by the floor thermocouple at 23.9 ft  $\pm$  0.5 in. (7.28 m  $\pm$  13 mm) reaches 150°F  $\pm$  5°F (66°C  $\pm$  3°C).

**4-5.3** During the preheat test, the temperatures indicated by the buried thermocouple at the vent end of the test chamber, located 0.125 in. below the brick surface at 23.25 ft (7.1 m), shall be recorded at 15-second intervals. Results shall be compared to the preheat temperatures taken at the same intervals, from the representative curve of temperature as a function of time shown in Figure 4-5.3. If appreciable variation from the temperatures shown in the representative preheat curve occurs because of variations in the characteristics of the gas used, adjustments in the fuel supply shall be made prior to proceeding.

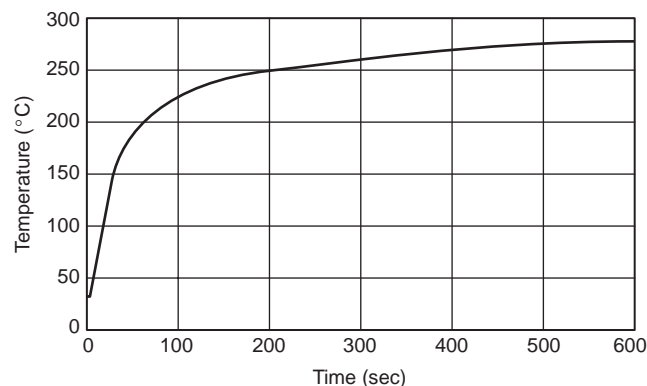


Figure 4-5.3 Representative preheat curve.

**4-5.4** The fire-test chamber shall be allowed to cool until the floor thermocouple at 13 ft (3.96 m) shows a temperature of 105°F  $\pm$  5°F (41°C  $\pm$  3°C).

**4-5.5 Temperature History Test.** The steel plate, three 8 ft long mineral-fiber/cement boards, and the removable top shall be placed, as in 4-5.1. The fuel supply shall be adjusted to the required flow to produce a  $300,000 \text{ Btu/hr} \pm 7500 \text{ Btu/hr}$  ( $88 \text{ kW} \pm 2 \text{ kW}$ ) flame, with the air-inlet shutter providing an opening of  $3 \text{ in.} \pm 0.06 \text{ in.}$  ( $76 \text{ mm} \pm 2 \text{ mm}$ ), for a test period of 10 minutes. During the preheat test, the temperatures indicated by the thermocouple in the fire-test chamber air at 23 ft (7.01 m) shall be recorded at 15-second intervals.

**4-5.6** The temperature history of the thermocouple in the chamber air at 23 ft (7.01 m) shall be compared to the temperature history taken at the same intervals from the representative curve of temperature as a function of time shown in Figure 4-5.3. If appreciable variation from the temperatures shown in the representative preheat curve occurs because of variations in the characteristics of the gas used, adjustments shall be made prior to proceeding.

#### 4-6 Standard Insulated Conductor Test.

**4-6.1** The furnace shall be allowed to cool after each test. As soon as the floor thermocouple at  $13 \text{ ft} \pm 0.5 \text{ in.}$  ( $3.96 \text{ m} \pm 13 \text{ mm}$ ), measured from the centerline of the burner, shows a temperature of  $105^\circ\text{F} \pm 5^\circ\text{F}$  ( $41^\circ\text{C} \pm 3^\circ\text{C}$ ), the next set of specimens shall be placed in position for test.

**4-6.2\*** A verification procedure shall utilize a standardized insulated conductor with known characteristics of flame travel distance, average optical density, and peak optical density. The standardized insulated conductor to be used is a nominal 0.225 in. (5.7 mm) outer diameter of specimen of extruded polyvinylidene fluoride (PVDF), with a No. 14 AWG annealed copper conductor. A total of 50 specimen lengths shall be used in the test. The conductor shall be tested with the same procedure as described in Chapter 6 to determine flame travel distance, average optical density of smoke, and peak optical density of smoke.

**4-6.2.1** The representative performance results of the standard insulated conductor have been determined to be as follows:

Maximum flame travel distance	2 ft
Average optical density of smoke	0.11
Peak optical density of smoke	0.28

**4-7 Maintenance.** Maintenance for the apparatus, which shall be conducted within 30 days of conducting a test, or as required, shall include the following procedures (with replacement of components as necessary):

- (a) Inspection of tunnel and wall bricks
- (b) Cleaning of windows
- (c) Inspection of the inorganic cement board
- (d) Inspection of the castable block mix

## Chapter 5 Test Specimen Preparation

**5-1 Specimen Conditioning.** Prior to testing, all cable specimens shall be conditioned for a minimum of 24 hours, in a controlled environment, at a temperature of  $73^\circ\text{F} \pm 5^\circ\text{F}$  ( $23^\circ\text{C} \pm 3^\circ\text{C}$ ) and a relative humidity of 50 percent  $\pm$  5 percent. Sam-

ples that are supplied on reels shall have any wrapping materials removed for conditioning.

#### 5-2 Determination of Specimen Diameter.

**5-2.1** The specimen diameter shall be determined using either a diameter tape, vernier caliper, or a micrometer with an accuracy of 0.001 in. (0.025 mm).

**5-2.2** The diameter tape shall be appropriate for specimens that are uniformly round. The tape shall be wrapped tightly around the specimen, but not so tightly that the specimen is compressed. An arithmetic average of three readings over 1 ft (0.3 m) length of the specimen shall be used as the specimen diameter.

**5-2.3** The vernier caliper shall be permitted to be used for all sizes of cable specimens and shall be considered for small diameter cables that are nonuniform in cross section.

**5-2.4** If the sample is round, the caliper shall be closed gently around the cable, carefully so as not to compress it, and the reading shall be taken. The measurement shall be repeated a minimum of five times over a length of 1 ft (0.3 m) of cable. The arithmetic average of the five readings shall be used as the cable specimen diameter.

**5-2.5** If the specimen is nonuniform in cross section, with the width-to-thickness ratio less than 2:1, three measurements shall be taken at wide points, and three measurements shall be taken at the narrow points of the sample. The arithmetic average of the six readings shall be used as the specimen diameter.

**5-2.6** If the width-to-thickness ratio is greater than 2:1, then the width of the specimen shall be used as the specimen diameter. The width of the specimen shall be measured at six locations on a 1 ft (0.3 m) length of the cable. The arithmetic average of the six readings shall be used as the specimen diameter.

**5-2.7** The micrometer shall be permitted to be used for a cable specimen with a uniform cross section. Five measurements of the specimen diameter over a 1 ft (0.3 m) length of the cable shall be taken. The arithmetic average of the five readings shall be used as the specimen diameter.

**5-3 Number of Cable Lengths.** The number of cable lengths used in the test shall be calculated as follows:

(a) The number of cable lengths shall equal  $11.25 \text{ in.}$  (width of the cable tray) divided by the diameter of specimen (in inches).

(b) The number of cable specimens shall equal the measured inside width of the rack divided by the cable diameter as determined using a diameter tape or equivalent (*see Section 5-2*). The result of the division shall be rounded off to the nearest lower whole number of specimens that fit in the tray, with consideration for the presence of cable fasteners.

#### 5-4 Cable Mounting.

**5-4.1** The specimens shall be laid into the tray in parallel, straight rows without any space between adjacent specimens other than that needed for the cable fasteners described in 5-4.2.

**5-4.2** Bare copper tie wires not greater than 18 AWG (nominal wire cross section of 1620 circular mils or  $0.823 \text{ mm}^2$ ) shall be used to fasten cable specimens to the rungs of the cable tray at two positions — that is, wires shall be tied to the first rung near the fire end and to the last rung near the exhaust end.



## Chapter 6 Test Procedure

**6-1 Procedure.** A test procedure shall be followed as described in 6-1.1 through 6-1.12.

**6-1.1** At the start of each test day the furnace shall be preheated as described in 4-5.1 through 4-5.3.

**6-1.2** The furnace shall be cooled as described in 4-5.4.

**6-1.3** The cable tray and supports shall be placed in the test chamber as shown in Figure 2-2.2.1 (b) and described in Section 2-3, with the tray end at the air-inlet end and not more than 1 in. (25 mm) downstream from the centerline of the burners.

**6-1.4** The cable specimens shall be installed as described in Section 5-4.

**6-1.5** The steel plate shall be placed in the fire-test chamber, as described in 4-2.1. One 0.25 in. (6 mm) × 4 ft (1.22 m) × 2 ft (0.6 m) section of mineral-fiber/cement board shall be placed on the top cover support ledges of the furnace chamber, to overlap the steel plate a maximum of 3 in. (76 mm), as shown in Figure 2-2.2.1 (b) at the fire end. The removable test-chamber top, protected by a full mineral fiber/cement board, shall be placed in position on top of the furnace side ledge.

**6-1.6** The air-inlet shutter shall be placed in position to provide an opening of 3 in. ± 0.06 in. (76 mm ± 2 mm). To maintain airflow control throughout each test run, the exhaust duct damper shall be controlled by a closed-loop feedback system with respect to the air-inlet draft gauge static pressure. Throughout the test the air supply shall be maintained at a temperature of 73°F ± 5°F (23°C ± 3°C) and a relative humidity of 50 percent ± 5 percent.

**6-1.7** The smoke measurement system shall be checked to ensure zero optical density.

**6-1.8** The fire-test chamber temperature at the floor thermocouple at 13 ft (3.96 m) shall be checked to ensure it is at a temperature of 105°F ± 5°F (41°C ± 3°C). If the temperature is below this range, the cable test specimens shall be removed and the fire-test chamber shall be preheated as described in 4-5.1 through 4-5.3. The furnace shall then be allowed to cool until the floor thermocouple at 13 ft (3.96 m) registers a temperature of 105°F ± 5°F (41°C ± 3°C). If the chamber has been cooled down and reheated, the cable test specimens shall be installed as described in Section 5-4.

**6-1.9** The exhaust shall be adjusted to establish to the airflow requirements of 4-2.5 in the test chamber. The initial photoelectric cell output shall be recorded.

**6-1.10** Simultaneously the test gas flame shall be ignited (as per Section 4-5) and the data-acquisition system shall be started. The distance and time of maximum flame travel distance shall be observed and recorded. The photoelectric cell output, the gas pressure, the pressure differential across the orifice plate, and the volume of gas used shall be recorded at intervals of 2 seconds continuously throughout the test.

**6-1.11** The test shall be continued for 20 minutes. The test shall be terminated by shutting off the fuel supply and stopping data acquisition.

**6-1.12** After the gas supply to the ignition flame is shut off, smoldering and other conditions within the furnace shall be

observed and recorded, and the specimens shall then be removed for examination.

## Chapter 7 Post-Test Cleanup and Inspection

**7-1 Debris.** All debris from the furnace shall be removed. Any molten debris, stuck to the brick, that cannot be removed physically, shall be destroyed by placing scrap lumber in the chamber, placing the removable top cover in position, and igniting the lumber with the burner until all the molten debris is consumed. All char and ash shall be removed from the fire-test chamber. An alternative method of removing any molten debris shall be to replace the affected bricks on the chamber floor.

**7-2\* Windows.** The windows shall be cleaned after each test.

**7-3\* Supports.** The ladder and supports shall be cleaned of debris.

**7-4 Damaged Boards.** The damaged mineral-fiber/cement board protecting the removable top cover shall be replaced after each test. The 0.25 in. (6 mm) × 4 ft (1.22 m) × 2 ft (0.6 m) section of mineral-fiber/cement board placed on the top cover support ledges shall be discarded after each test.

**7-5 Preparation for Next Test.** Cleaned trays and supports shall be placed in the fire-test chamber, and the removable top cover shall be positioned above the top cover support ledges.

**7-6 Cleanliness of Smoke Measurement System.** The smoke measurement system shall be cleaned and 100 percent light transmission shall be confirmed.

## Chapter 8 Calculations

### 8-1 Optical Density of Smoke.

**8-1.1** The smoke obscuration shall be calculated as optical density of smoke from the photoelectric cell data as follows:

$$OD = \log_{10} \frac{I_0}{I}$$

**8-1.2** The peak optical density shall be the maximum optical density as determined by using a three-point running average of optical density values recorded during the test.

**8-1.3** The average optical density ( $OD_{av}$ ) shall be calculated as follows:

$$OD_{av} = \frac{\Delta t \sum_{i=1}^{N-1} (0.5)(OD_i + OD_{i+1})}{1200}$$

where:

$\Delta t$  = scan time (seconds)

$N$  = number of data points

$i$  = data point counter

$OD_i$  = optical density value at each scan from  $i = 1$  to  $i = N-1$

1200 = test time in seconds (20 minutes)

The individual optical density of smoke values used in the equation shall be the values measured at each individual scan.

## Chapter 9 Report

**9-1 Data.** The report shall include the following information for each test:

- A detailed description of the wires or cables tested
- The number of lengths used as specimens for the test
- The maximum flame travel distance in feet
- The graph of flame travel distance versus time for the duration of the test
- The values of the peak optical density of smoke and average optical density of smoke
- The graph of the optical density of the smoke generated during the test versus time for the duration of the test
- Observations of the condition of the test specimens after completion of the test
- A description of the data-acquisition equipment used and the scan period used
- All other information required to be recorded

## Chapter 10 Precision and Bias

**10-1 Applicability.** The precision and bias of this test method has not been determined.

## Chapter 11 Referenced Publications

**11-1** The following documents or portions thereof are referenced within this standard as mandatory requirements and shall be considered part of the requirements of this standard. The edition indicated for each referenced mandatory document is the current edition as of the date of the NFPA issuance of this standard. Some of these mandatory documents might also be referenced in this standard for specific informational purposes and, therefore, are also listed in Appendix C.

**11-1.1 NFPA Publication.** National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*, 1996 edition.

### 11-1.2 Other Publications.

**11-1.2.1 ASTM Publication.** American Society for Testing and Materials, 100 Barr Harbor Drive, West Conshohocken, PA 19428-2959.

ASTM E 84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, 1994 edition.

**11-1.2.2 Underwriters Laboratories Publication.** Underwriters Laboratories Inc. 333 Pfingsten Road, Northbrook, IL, 60062.

UL 910, *Test Method for Fire and Smoke Characteristics of Electrical and Optical-Fiber Cables Used in Air Handling Spaces*, 1994 edition.

## Appendix A Explanatory Material

*Appendix A is not a part of the requirements of this NFPA document but is included for informational purposes only. This appendix contains explanatory material, numbered to correspond with the applicable text paragraphs.*

**A-1-1.1** This standard is referenced, including requirements for flame travel distance, peak optical density of smoke, and average optical density of smoke, in Sections 725-71(a), 760-71(d), 770-51(a), 800-51(a), 820-51(a), and 830-5(a)(2) of the 1999 edition of NFPA 70, *National Electrical Code*<sup>®</sup>. Wires and cables with a flame travel distance not exceeding 5 ft (1.52 m), a peak optical density of smoke not exceeding 0.5, and an average optical density not exceeding 0.15 are described as having adequate fire-resistant and low smoke-producing characteristics. It should be noted that the fire resistance described in NFPA 70 does not address the same issues that are addressed when testing by use of a temperature-time curve, such as described in NFPA 251, *Standard Methods of Tests of Fire Endurance of Building Construction and Materials*. Procedures describing testing of fire-resistive cables are described in UL 2196, *Standard for Tests of Fire Resistive Cables*.

**A-1-1.3** The changes made in equipment for this test were deemed necessary in order to obtain proper precision from the test when the equipment is used for small quantities of wire and cable, which produce much smaller quantities of heat release and smoke obscuration.

**A-1-2** It has been shown that results from this test method rank wires and cables in the same way as do the results of tests on wiring exposed to fires in simulated plenums.

### A-2-2.2.1

(a) *Firebrick.* The operation and calibration of this equipment is based on the use of insulating firebrick. The physical and thermal properties of the brick are as follows:

- Density: 51 lb/ft<sup>3</sup> (0.82 g/cm<sup>3</sup>)
- Specific heat: 0.25 Btu/lb °C (1.05 kJ/kg °F)
- Thermal conductivity:
  - $1.8 \frac{\text{Btu} \cdot \text{in.}}{\text{ft}^3 \cdot \text{hr} \cdot ^\circ\text{F}}$  at 400°F  $\left(0.26 \frac{\text{W}}{\text{m} \cdot ^\circ\text{C}} \text{ at } 205^\circ\text{C}\right)$
  - $2.1 \frac{\text{Btu} \cdot \text{in.}}{\text{ft}^3 \cdot \text{hr} \cdot ^\circ\text{F}}$  at 800°F  $\left(0.30 \frac{\text{W}}{\text{m} \cdot ^\circ\text{C}} \text{ at } 425^\circ\text{C}\right)$
  - $2.3 \frac{\text{Btu} \cdot \text{in.}}{\text{ft}^3 \cdot \text{hr} \cdot ^\circ\text{F}}$  at 1200°F  $\left(0.33 \frac{\text{W}}{\text{m} \cdot ^\circ\text{C}} \text{ at } 655^\circ\text{C}\right)$
  - $2.5 \frac{\text{Btu} \cdot \text{in.}}{\text{ft}^3 \cdot \text{hr} \cdot ^\circ\text{F}}$  at 1600°F  $\left(0.36 \frac{\text{W}}{\text{m} \cdot ^\circ\text{C}} \text{ at } 870^\circ\text{C}\right)$
  - $2.7 \frac{\text{Btu} \cdot \text{in.}}{\text{ft}^3 \cdot \text{hr} \cdot ^\circ\text{F}}$  at 2000°F  $\left(0.39 \frac{\text{W}}{\text{m} \cdot ^\circ\text{C}} \text{ at } 1095^\circ\text{C}\right)$

(b) *Inside glass panes.* A high-temperature glass acceptable for this purpose should contain 96 percent silica and 3 percent boric oxide (B<sub>2</sub>O<sub>3</sub>). The glass should have thermal conductivity of

- $6.9 \frac{\text{Btu} \times 10^{-4} \text{ in.}}{\text{ft}^3 \cdot ^\circ\text{F}}$  at -148°F  $\left(\frac{1.00 \times 10^{-4} \text{ W}}{\text{m} \cdot ^\circ\text{C}} \text{ at } -100^\circ\text{C}\right)$
- $8.7 \frac{\text{Btu} \times 10^{-4} \text{ in.}}{\text{ft}^3 \cdot ^\circ\text{F}}$  at 32°F  $\left(\frac{1.26 \times 10^{-4} \text{ W}}{\text{m} \cdot ^\circ\text{C}} \text{ at } 0^\circ\text{C}\right)$
- $9.8 \frac{\text{Btu} \times 10^{-4} \text{ in.}}{\text{ft}^3 \cdot ^\circ\text{F}}$  at 212°F  $\left(\frac{1.42 \times 10^{-4} \text{ W}}{\text{m} \cdot ^\circ\text{C}} \text{ at } 100^\circ\text{C}\right)$



The glass should have a nominal thickness of 6 mm (0.25 in.) and should withstand temperatures up to 1652°F (900°C).

The following product information is provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees. Vycor® glass, available from Fisher Scientific, 711 Forbes Avenue, Pittsburgh, PA, 15219-4785, telephone (412) 562-8300, or its equivalent, has been shown to be suitable for this purpose.

**A-2-2.2.2** Materials acceptable for this purpose should be suitable for very high temperatures. Examples include water-cooled structural-steel tubing and high-temperature furnace refractories — for example those based on zirconium materials (such as Zicron®). This product information is being provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees.

**A-2-2.4.1**  $K_p C$  is equal to the thermal conductivity times the density times the specific heat.

**A-2-2.6.1** The high-temperature mineral composition material should have the same physical characteristics as the material described in 2-2.4.1.

**A-2-5.1** The following product information is provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees.

(a) *Lamp.* A General Electric Model 4405 12-V sealed-beam clear auto spot lamp (Part Number 4405) has been found acceptable for this purpose. This light source can be procured from any electrical supplies vendor.

(b) *Recording device.* A meter suitable for this purpose is a Weston Instruments No. 856-990103BB photonic cell, which can be procured from Huygen Corp., P.O. Box 316, Wauconda, IL 60084.

**A-4-2.3** A downward trend in static pressure indicates leakage in the fire-test chamber or exhaust system.

**A-4-2.5** The following product information is provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees. A Thermo Systems Inc. Model 1610 velocity transducer (thermal anemometer or equivalent), using a readout accurate to 0.001 V, has been found acceptable for the purpose.

**A-4-3** The following product information is provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees. Wratten filters from the Kodak Company have been found suitable for this purpose. The part numbers of some of the filters are as follows: ND0.1-KF1702; ND0.3-KF1710; ND0.5-KF1718; and ND1.0-KF1740. The filters can be purchased from a professional photography supplies vendor.

**A-4-4** The igniting fire length of 4.5 ft (1.37 m) is controlled by the total gas input (300,000 Btu/hr) and the air draft (240 ft/min) through the tunnel.

The following product information is provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees. A Cutler-Hammer gas calorimeter has been found suitable for measuring this gas heating value.

**A-4-5.1** The preheating is for the purpose of establishing the conditions that exist following successive tests and to indicate control of the heat input into the test chamber.

**A-4-6.2** The following product information is provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees. A suitable insulated conductor is manufactured by Lucent Technologies and designated "Cable 910ST," Part No. COMCODE108210568.

**A-7-2** Oven cleaner fluid has been found suitable for this purpose. A putty knife or another appropriate instrument has also been found to be suitable for the cleaning purpose.

**A-7-3** A wire brush and putty knife have been found suitable for this purpose.

## Appendix B Airflow, Smoke, and Heat Release Measurements

*This appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.*

**B-1 General.** In this section, equipment, procedures, and calculations used for determination of airflow, heat, and smoke release rates are provided.

### B-2 Airflow Measurement.

#### B-2.1 Airflow Velocity Measuring Equipment.

**B-2.1.1** The velocity in the exhaust duct is determined by measuring the differential pressure in the flow path with a bidirectional probe connected to an electronic pressure gauge, or an equivalent measuring system and a thermocouple.

**B-2.1.2** The bidirectional probe consists of a stainless steel cylinder with a solid diaphragm in the center that divides the probe into two chambers. The probe is 1.75 in. (44 mm) long with a 0.87 in. (22 mm) inside diameter. The pressure taps on either side of the diaphragm are to support the probe.

**B-2.1.3** The axis of the probe is located at the centerline of the duct. The pressure taps are connected to a pressure transducer having a minimum resolution of 0.001 in. water (0.25 Pa).

**B-2.1.4** The temperature of the exhaust gas is measured upstream 6 in. (152 mm) from the probe and at the centerline of the duct, with a 28 AWG Type K thermocouple having an Inconel® sheath.

#### B-2.2 Airflow Calculations.

Linear velocity in the duct is calculated as follows:

$$V = k\sqrt{\Delta PT}$$

where:

$V$  = linear duct velocity (m/sec)

$k$  = constant for the bidirectional probe [m/sec (Pa<sup>-0.5</sup>) (K<sup>-0.5</sup>)]

$\Delta P$  = pressure difference recorded across the bidirectional probe (Pa)

$T$  = airflow temperature (K)

The constant  $k$  is determined experimentally by calibrating the bidirectional probe with a standard flow measuring device.

**B-2.2.1** The volumetric flow rate in the exhaust is then calculated as follows:

$$V_s = VA$$

where:

- $V_s$  = volumetric flow rate ( $\text{m}^3/\text{sec}$ )
- $V$  = linear duct velocity ( $\text{m}/\text{sec}$ )
- $A$  = duct area ( $\text{m}^2$ )

### B-3 Smoke Release Rate Measurement.

**B-3.1 Smoke Release Rate Equipment.** The smoke release rate equipment consists of a smoke measurement system described in Section 2-5 and the airflow measurement system described in Section B-2.

### B-3.2 Smoke Release Rate Calculations.

**B-3.2.1** The smoke release rate is calculated as follows:

$$SRR = \left( \frac{OD}{l} \right) \left( \frac{T_p}{T_s} \right) V_s$$

where:

- $SRR$  = smoke release rate ( $\text{m}^2/\text{sec}$ )
- $OD$  = optical density (calculated as described in 8-1.1)
- $l$  = path length for smoke measurement (duct diameter, m)
- $T_p$  = temperature at the photoelectric cell (K)
- $T_s$  = temperature at the bidirectional probe (K)
- $V_s$  = volumetric flow rate ( $\text{m}^3/\text{sec}$ )

**B-3.2.2** Peak smoke release rate is the maximum value of smoke release rate during the test.

**B-3.2.3** Total smoke release is calculated as follows:

$$\text{total smoke} = \Delta t \sum_{i=1}^{N-1} 0.5(SRR_{i+1} + SRR_i)$$

where:

- total smoke = total smoke release ( $1/\text{m}^2$ )
- $\Delta t$  = scan time (seconds)
- $N$  = number of data points
- $SRR_1$  = first smoke release rate value
- $i$  = data point counter
- $SRR_i$  = smoke release value from  $i = 1$  to  $i = N-1$

### B-4 Heat Release Rate Measurement.

#### B-4.1 Heat Release Rate Equipment.


**B-4.1.1** The heat release rate equipment consists of the airflow measurement system described in Section B-2 and gas analysis and sampling equipment described herein.

**B-4.1.2** The gas analysis and sampling equipment consists of the following:

- (a) Stainless steel gas sampling tube, located in the exhaust duct to obtain a continuously flowing sample, for determining the oxygen concentration of the exhaust gas as a function of time
- (b) Particulate filters to remove particulate smoke
- (c) Ice bath, drierite, and silica gel to remove moisture from the gas sample

- (d) Ascarite to remove carbon dioxide
- (e) Pump and flow control devices
- (f) Oxygen analyzer

The filters and water trap are placed in line ahead of the analyzer to remove particulate and water. The oxygen analyzer should be capable of measuring the oxygen concentration in the range from 0 percent to 21 percent with a full-scale accuracy of  $\pm 0.25$  percent. The signal from the oxygen analyzer is to be within 10 percent of its final value within 30 seconds after a step change is introduced in the composition of the gas stream flowing past the inlet to the gas sampling tube. A typical arrangement of the heat release rate gas sampling equipment is shown in Figure B-4.1.2.

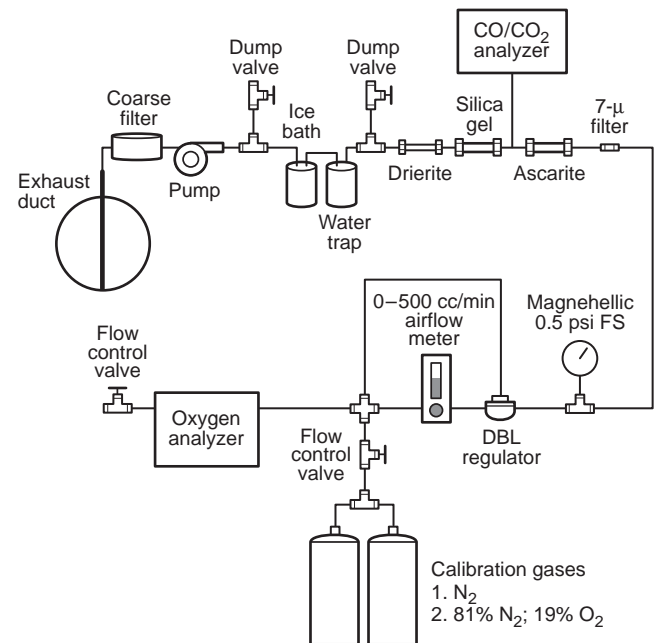

**Figure B-4.1.2** Schematic of gas sampling system.

**B-4.1.2.1** The following product information is being provided for informational purposes only and has not been independently verified, certified, or endorsed by NFPA or any of its technical committees. An analyzer found acceptable for this purpose is Siemens Oxyomat 5F Type Oxygen Analyzer. For information on the selection of the analyzer and the acceptable drift and noise characteristics, see Section B-5.

#### B-4.2 Procedures for Calibration of Test Equipment.

**B-4.2.1 Analyzer Calibration.** The oxygen analyzer is zeroed and spanned prior to the start of each day of testing. The analyzer is zeroed by introducing 100 percent nitrogen gas to the instrument at the same pressure and flow rate as set for sample gases. The analyzer is spanned by introducing ambient duct air via the sample probe and adjusting the span to 20.95 percent oxygen. The spanning and zeroing process is continued until adjustment-free accuracy is obtained. Following zeroing and spanning, linearity of the analyzer response curve is verified by introducing bottled gas of a known oxygen concentration (for example, 19 percent oxygen) to the analyzer. The delay time of the analyzer is checked by introducing ambient duct air to the analyzer and noting the time the analyzer readings reach 90 percent of the final reading.

**B-4.2.2** The delay time of the oxygen analyzer is determined at the flow velocities to be used during the test. The burner is ignited, allowed to reach steady state, and then turned off. The delay time of the analyzer is determined as the time difference between the time when steady state of the burner is reached and the time when the analyzer reading reaches 90 percent of the final reading. The delay time is used to time-shift all subsequent oxygen readings.

**B-4.2.3 Calibration Test.** A 5-minute heat release calibration test is performed at the start of testing each day. The heat release measurement instrumentation is calibrated by burning methane gas and comparing the total heat release measured from oxygen consumption and total heat release calculated from the metered gas input. The methane values for heat of combustion, 50.0 MJ/kg, and the corresponding heat of combustion per kg of oxygen consumed, 12.54 MJ/kg, are used for the calculations. The calibration constant,  $C_f$ , is calculated using the following equation:

$$C_f = \frac{\text{heat release rate based on gas consumed}}{\text{heat release based on calorimetry}} \\ = \frac{\text{gas flow rate} \times \text{heat content of gas}}{\text{average heat release rate of burner at steady state}}$$

For example, this equation takes the following form:

$$C_f = \frac{32785 \dot{V}}{\left[ \Delta t \sum_{i=1}^{N-1} 0.5(HRR_{i+1} + HRR_i) \right] / 180}$$

where:

32785 (kJ/m<sup>3</sup>) = heat produced (kJ) per unit volume (m<sup>3</sup>) of methane at 25°C

$\dot{V}$  = methane gas flow rate supplied to the burner (m<sup>3</sup>/sec)

$\Delta t$  = scan time in seconds = 2

$HRR$  = heat release rate as calculated using the equation in B-4.4.1 with  $C_f = 1$

$i$  =  $i$ th data point

$N$  = number of data points from 60 seconds to 240 seconds

$HRR_i$  = heat release value from  $i = 1$  to  $i = N-1$

180 = 60 percent of test time (seconds) during which the burner is at steady state

**B-4.2.4** The calibration constant is employed to adjust the heat release rate measured during testing to obtain the actual heat release rate. The formula for calculating the rate of heat release is specified in B-4.4.

### B-4.3 Heat Release Test Procedure.

**B-4.3.1** The power to the analyzers and pump are turned on. All filters are inspected and replaced if necessary. The ice for the cold trap is refilled. The flow meters are checked and adjusted if necessary.

**B-4.3.2** The procedures specified in B-4.2 are performed.

**B-4.3.3** The power to the digital acquisition equipment and the computer are turned on.

**B-4.3.4** The test is conducted with procedures described in Chapter 6.

### B-4.4 Heat Release Rate Calculations.

**B-4.4.1** The heat release rate is calculated using the following equation:

$$HRR = E' C_f M \left( \frac{0.2095 - Y}{1.105 - 1.5Y} \right)$$

where:

$HRR$  = heat release rate of the specimen and burner (kW)

$E'$  = heat produced (kJ) per unit volume (m<sup>3</sup>) of oxygen consumed at 25°C ( $E' = 17.2 \times 10^3$  for cable testing; and  $E' = 16.4 \times 10^3$  for calibration testing with methane gas)

$C_f$  = calorimeter calibration factor determined by the procedure defined in B-4.2.3 (when this equation is used during calibration tests,  $C_f = 1$ )

$M$  = volumetric flow rate in the duct (m<sup>3</sup>/sec) referred to 25°C

0.2095 = ambient mole fraction of oxygen

$Y$  = oxygen concentration (mole fraction)

1.5 = chemical expansion factor

1.105 = ratio of moles of combustion products to the moles of oxygen consumed

### B-4.4.2 Peak Heat Release Rate.

**B-4.4.2.1** The peak heat release rate is the maximum heat release rate for the duration of the test.

**B-4.4.3 Total Heat Released.** The total heat released is calculated as a time integral of the heat release rate calculated in B-4.4.1 using a trapezoidal rule as follows:

$$\text{Total heat released} = \Delta t \left[ 0.5(HRR_1) \left( \sum_{i=2}^{N-1} 0.5(HRR_{i+1} - HRR_i) \right) \right]$$

where:

total heat released = kJ

$\Delta t$  = scan time (seconds)

$N$  = number of data points

$HRR_1$  = first heat release rate value

$i$  =  $i$ th data point

$HRR_i$  = heat release value from  $i = 1$  to  $i = N-1$

### B-4.5 Heat Release Rate Post-Test Procedure.

**B-4.5.1** Inspect the drierite and ascarite used for the heat release measurements. Replace them if the drierite has turned pink or if the ascarite has become hard.

**B-4.5.2** Inspect the filters after each test. Replace them if they appear to be dirty.

**B-4.5.3** Inspect the water trap and remove any condensed water. If ice is used in the water trap, replenish as necessary.

**B-4.5.4** Blow out the holes of the gas sampling line and the bidirectional probe lines to remove any accumulated soot deposition.

## **B-5 Method for Determining Suitability of Oxygen Analyzers for Making Heat Release Measurements.**

**B-5.1 General.** The type of oxygen analyzer best suited for fire analysis is of the paramagnetic type. Electrotechnical analyzers or analyzers using zirconia sensors have generally been found not to have adequate sensitivity or suitability for this type of work. The normal range for this type of instrument is 0–25 volume percent oxygen. The linearity of the paramagnetic analyzers is normally better than can be checked by a user laboratory; thus, verifying their linearity is not necessary. It is important, however, to confirm the noise and short-term drift of the instrument used.

### **B-5.2 Procedure.**

**B-5.2.1** Connect two gas bottles having differing levels of oxygen approximately two percent points apart (for example 15 volume percent and 17 volume percent, or normal clean dry air and 19 volume percent) to a selector valve at the inlet of the analyzer.

**B-5.2.2** Connect the electrical power and let the analyzer warm up for up to 24 hours with one of the test gases flowing through it.

**B-5.2.3** Connect a data-acquisition system to the output of the analyzer. Quickly switch from the first gas bottle to the second bottle and immediately start collecting the data, taking one data point per second. Collect data for 20 minutes.

**B-5.2.4** Determine the drift by using a least-squares analysis fitting procedure to pass a straight line through the last 19 minutes of data. Extrapolate the line back through the first minute of data. The difference between the readings at 1 minute and 20 minutes on the fitted straight line represents the short-term drift. Record the drift in units of parts per million of oxygen.

**B-5.2.5** The noise is represented by the root-mean-square deviation around the fitted straight line. Calculate that root-mean-square value and record it in parts per million.

**B-5.2.6** The analyzer is suitable for use in heat release measurements if the sum of the drift plus the noise terms is  $\leq 50$  parts per million oxygen (note that both terms are expressed as positive numbers).

**B-5.3 Additional Precautions.** A paramagnetic oxygen analyzer is directly sensitive to barometric pressure changes at its outlet port and to flow rate fluctuations in the sample supply stream. It is essential that the flow stream be regulated. Use

either a flow rate regulator of the mechanical diaphragm type or an electronic mass flow rate controller. In order to protect against errors due to changes in barometric pressure, one of the following procedures should be used:

(a) Control the back pressure to the analyzer with a back pressure regulator of the absolute type.

(b) Measure the actual pressure electrically at the detector element and provide a signal correction for the analyzer output.

**B-6 Optional Data.** If optional heat and smoke release rate is measured, report the following:

(a) Peak *HRR*, kW, and time at which it occurred

(b) Graph of the heat release rate curve

(c) Total heat released (area under heat release rate curve) (MJ)

(d) Graph of the smoke release rate curve

(e) Total smoke released (area under the smoke release rate curve) ( $\text{m}^3$ )

(f) Peak smoke release rate ( $\text{m}^3/\text{seconds}$ )

(g) Graph of smoke release rate versus time

## **Appendix C Referenced Publications**

**C-1** The following documents or portions thereof are referenced within this standard for informational purposes only and are thus not considered part of the requirements of this standard unless also listed in Chapter 11. The edition indicated here for each reference is the current edition as of the date of the NFPA issuance of this standard.

**C-1.1 NFPA Publications.** National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 70, *National Electrical Code*®, 1999 edition.

NFPA 251, *Standard Methods of Tests of Fire Endurance of Building Construction and Materials*, 1995 edition.

### **C-1.2 Other Publication.**

#### **C-1.2.1 Underwriters Laboratories Publication.**

Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062.

UL 2196, *Standard for Tests of Fire Resistive Cables* (proposed).

## **Index**

©1999 National Fire Protection Association. All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document that it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of the National Fire Protection Association, Inc.

### **-A-**

**Air leakage tests** ..... 4-2.3 to 4-2.4, A-4-2.3  
**Airflow** ..... 2-2.2.3, 2-4, 6-1.6  
     Calibration of test equipment ..... 4-2  
     Exhaust adjustment for ..... 6-1.9  
     Measurement ..... B-2  
**Air-inlet chamber** ..... 2-2.1  
**Air-inlet end of test chamber** ..... 2-2.3, 6-1.3

**Air-inlet shutter** ..... 2-2.1, 2-2.1.1, 2-2.3, 4-5.5, 6-1.6  
**Air-inlet static pressure** ..... 4-2.5  
**Apparatus, fire-test** ..... See Fire-test apparatus

### **-B-**

**Boards, top cover** ..... 2-2.4.2, 6-1.5  
     Damaged ..... 7-4  
     Inspection ..... 4-7(c)

**-C-**

- Cable tray, ladder** . . . . . 1-4.1, 2-3, 3-1, 5-1, 5-3 to 5-4, 6-1.3  
 Cleaning of . . . . . 7-3, A-7-3  
 Preparation for next test . . . . . 7-5
- Calculations** . . . . .  
 Airflow . . . . . B-2.2  
 Heat release rate measurement . . . . . B-4.4  
 Optical density of smoke . . . . . 8-1  
 Smoke release rate . . . . . B-3.2
- Calibration** . . . . . Chap. 4, A-4  
 Airflow . . . . . 4-2  
 Chamber temperature . . . . . 4-5, A-4-5.1  
 Frequency of . . . . . 4-1  
 Fuel . . . . . 4-4, A-4-4  
 Heat release rate, equipment for measuring . . . . . B-4.2  
 Standard insulated conductor test . . . . . 4-6, A-4-6.2
- Cooling, of test chamber** . . . . . 6-1.2, 6-1.8

**-D-**

- Damper, exhaust duct** . . . . . 2-2.6.2, 4-2.3, 4-2.5, 6-1.6
- Debris removal, post-test** . . . . . 7-1
- Definitions** . . . . . 1-5
- Digital data-acquisition equipment** . . . . . 2-7
- Ducts** . . . . .  
 Exhaust . . . . . 2-2.6.1, 4-2.4, A-2-2.6.1, *See also* Damper, exhaust duct  
 Test chamber . . . . . 2-2.2.1  
 Wires and cables installed in . . . . . 1-2, 1-3.1, 1-4.1

**-E-**

- Exhaust system** . . . . . 2-2.6  
 Adjustment of . . . . . 6-1.9  
 Blower . . . . . 2-2.7  
 Damper . . . . . 2-2.6.2, 4-2.3, 4-2.5, 6-1.6  
 Ducts . . . . . 2-2.6.1, 4-2.4, A-2-2.6.1  
 Transition . . . . . 2-2.5

**-F-**

- Fire brick** . . . . . 2-2.2.1, 4-7(a), A-2-2.2.1(a)
- Fire shutter** . . . . . 4-2.3 to 4-2.4
- Fire-test apparatus** . . . . . 1-4.1, 2-2; *See also* Exhaust system;  
 Fire-test chamber  
 Airflow velocity measuring equipment . . . . . B-2.1  
 Air-inlet chamber . . . . . 2-2.1  
 Calibration . . . . . *See* Calibration  
 Data-acquisition equipment . . . . . 2-7  
 Heat release rate measurement; *See* Heat release rate  
 measurement  
 Maintenance . . . . . 4-7  
 Post-test cleanup and inspection . . . . . Chap. 7, A-7-2 to A-7-3  
 Smoke release rate . . . . . B-3.1
- Fire-test chamber** . . . . . 1-4.1, 2-2.2, A-2-2  
 Air-inlet end . . . . . 2-2.3, 4-2.1, 6-1.3  
 Controls . . . . . 2-2.3  
 Cooling . . . . . 4-5.4, 6-1.2, 6-1.8  
 Exhaust transition . . . . . 2-2.5  
 Gas burners . . . . . 2-2.3, 6-1.10 to 6-1.12  
 Post-test cleanup and inspection . . . . . Chap. 7, A-7-2 to A-7-3  
 Preheating . . . . . 4-5.1 to 4-5.3, 6-1.1, 6-1.8, A-4-5.1  
 Removable top cover . . . . . 2-2.4, 4-7(c), 6-1.5  
 Damaged boards in . . . . . 7-4  
 Temperature . . . . . *See* Temperature, test chamber
- Fire-test room** . . . . . 2-1
- Flame travel distance** . 1-3.1 to 1-3.2, 1-4, 4-6.2, 6-1.10, A-1-1.1, A-4-6.2  
 Definition . . . . . 1-5
- Fuel, test fire** . . . . . 4-4, A-4-4

**-G-**

- Gas analysis and sampling equipment** . . . . . B-4.1.2, B-4.2, B-4.3.1, B-4.5

- Gas burners** . . . . . 2-2.3, 6-1.10 to 6-1.12

**-H-**

- Heat release rate measurement** . . . . . 1-3.1, 1-4.1, B-4, B-4 to B-6  
 Calculations . . . . . B-4.4  
 Equipment . . . . . B-4.1  
 Calibration . . . . . B-4.2  
 Oxygen analyzers, suitability of . . . . . B-5  
 Post-test procedure . . . . . B-4.5  
 Optimal data . . . . . B-6  
 Peak heat release rate . . . . . B-4.4.2  
 Test procedure . . . . . B-4.3  
 Total heat released . . . . . B-4.4.3

**-I-**

- Insulated conductors** . . . . . *See also* Specimens, test  
 Purpose of test . . . . . 1-3.1  
 Scope of standard . . . . . 1-1.1 to 1-1.2, A-1-1.1  
 Significance of test . . . . . 1-2, A-1-2  
 Standard test . . . . . 4-6, A-4-6.2  
 Test method summary . . . . . 1-4.1

**-J-**

- Jacketed conductors** . . . . . *See* Insulated conductors

**-L-**

- Ladder cable tray** . . . . . *See* Cable tray, ladder

**-M-**

- Manometer** . . . . . 4-2.3 to 4-2.4

**-O-**

- Optical density of smoke (OD)** . . . . . 1-3.1 to 1-3.2, 1-4, 4-6.2, A-1-1.1, A-4-6.2  
 Calculations . . . . . 4-3, 8-1  
 Definition . . . . . 1-5

**-P-**

- Photoelectric cell** . . . . . 2-5.1 to 2-5.2, 4-3, 6-1.9 to 6-1.10, A-2-5.1, A-4-3
- Plenums, wires and cables installed in** . . . . . 1-2, 1-3.1, 1-4.1, A-1-2
- Preheating** . . . . . 6-1.1
- Preparation for next test** . . . . . 7-5
- Purpose of test** . . . . . 1-3

**-R-**

- Referenced publications** . . . . . Chap. 11, App. C
- Report of results** . . . . . 6-1.10 to 6-1.12, Chap. 9, B-6

**-S-**

- Scope of standard** . . . . . 1-1, A-1-1.1, A-1-1.3
- Shall (definition)** . . . . . 1-5
- Should (definition)** . . . . . 1-5
- Significance of standard** . . . . . 1-2, A-1-2
- Smoke, optical density of** . . . . . *See* Optical density of smoke (OD)
- Smoke measurement system** . . . . . 2-5, A-2-5.1  
 Calibration test . . . . . 4-3, A-4-3  
 Cleanliness of . . . . . 7-6  
 Data-acquisition equipment . . . . . 2-7  
 Inspection . . . . . 6-1.7
- Smoke release rate measurement** . . . . . 1-3.1, 1-4.1, B-3, B-6
- Specimens, test** . . . . . Chap. 3  
 Cable mounting . . . . . 6-1.4  
 Conditioning . . . . . 5-1  
 Diameter, determination of . . . . . 5-2  
 Holder . . . . . 1-4.1  
 Mounting of cable . . . . . 5-4, 6-1.4

Number of cable lengths ..... 5-3  
 Preparation ..... Chap. 5  
 Removal for examination ..... 6-1.12  
 Support for ..... *See* Cable tray, ladder  
**Standard (definition)** ..... 1-5  
**Standard insulated conductor test** ..... 4-6, A-4-6.2  
**Supports** ..... 6-1.3  
   Cable tray ..... 7-3, 7-5  
   Cleaning of ..... A-7-3  
   Ledges, test chamber ..... 7-4 to 7-5, A-2-2.2.2  
   Specifications ..... 2-2.2.2

### -T-

**Temperature, test chamber** ..... 4-5, 6-1.1 to 6-1.2, A-4-5.1  
   History test ..... 4-5.5 to 4-5.6  
   Measurement instrument, test chamber ..... 2-6 to 2-7, 6-1.8  
   Preheat test ..... 4-5.1 to 4-5.3, 4-5.5, A-4-5.1  
**Test apparatus** ..... *See* Fire-test apparatus  
**Test chamber** ..... *See* Fire-test chamber

### Test method

Bias ..... Chap. 10  
 Precision ..... Chap. 10  
 Purpose ..... 1-3  
 Scope ..... 1-1, A-1-1.1, A-1-1.3  
 Significance ..... 1-2, A-1-2  
 Summary ..... 1-4

**Test procedure** ..... Chap. 6

**Test specimens** ..... *See* Specimens, test

**Thermocouples** ..... 2-6.1 to 2-6.2, 4-5.2 to 4-5.5, 6-1.8

### -V-

**Velocity traverse system** ..... 4-2.5, A-4-2.5

### -W-

**Windows, test chamber** ..... 2-2.2.1  
   Cleaning ..... 4-7(b), 7-2, A-7-2  
   Specifications ..... A-2-2.2.1(b)

## Tentative Interim Amendment

### NFPA 262

#### Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces

#### 1999 Edition

#### Reference Entire Document

#### TIA 99-1 (NFPA 262)

Pursuant to Section 5 of the NFPA Regulations Governing Committee Projects, the National Fire Protection Association has issued the following Tentative Interim Amendment to NFPA 262, *Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces*, 1999 edition. The TIA was processed by the Fire Tests Committee, and was issued by the Standards Council on July 18, 2000, with an effective date of August 21, 2000.

Tentative Interim Amendment is tentative because it has not been processed through the entire standards-making procedures. It is interim because it is effective only between editions of the standard. A TIA automatically becomes a proposal of the proponent for the next edition of the standard; as such, it then is subject to all of the procedures of the standards-making process.

- (1) This TIA revises the test protocol of the apparatus and procedures used for testing of wires in plenum spacing to enhance the repeatability and reproducibility between testing laboratories. To reflect these changes, the document is revised as follows:

Copyright © 2000 All Rights Reserved  
NATIONAL FIRE PROTECTION ASSOCIATION

#### Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces

NOTICE: NOTICE: An asterisk (\*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Appendix A.

Information on referenced publications can be found in Chapter 11 and Appendix C.

### Chapter 1 General

**1.1.1 Scope\*** This standard describes the methodology to measure flame travel distance and optical density of smoke for insulated, jacketed, or both, electrical wires and cables and optical fiber cables that are to be installed in plenums and other spaces used to transport environmental air without being enclosed in raceways.

**1.1.2** This test method does not provide information on the fire performance of insulating materials contained in electrical or optical cables in fire conditions other than the ones specifically used in this standard, nor does it measure the contribution of the cables to a developing fire condition.

**1.1.3\*** Although this test uses equipment similar to that used in NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*, and ASTM E 84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, sufficient changes have been made to the chamber so that a test conducted in the apparatus used for NFPA 255 or ASTM E 84 cannot be considered identical or produce comparable results.

**1.1.4** The values stated in U.S. units are the standard. When a value for measurement is followed by a value in other units in parenthesis, the first stated value is the requirement.

**1.1.5** This standard does not purport to address all of the safety problems associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and to determine the applicability of regulatory limitations prior to use.

**1.2\* Significance.** This test is designed to provide comparative test data on insulated, jacketed, or both, electrical wires and cables and optical fiber cables that are to be installed in ducts, plenums, and other spaces used to transport environmental air without being enclosed in raceways. Such data are used to evaluate the potential for the spread of fire along electrical cables or wires or along optical fiber cables and to evaluate the potential for the development of high smoke levels in these spaces if the wires and cables are exposed to fire.

#### 1.3 Purpose.

**1.3.1** The purpose of this test is to measure and record the fire and smoke characteristics of insulated, jacketed, or both, electrical wires and cables and optical fiber cables that are to be installed in ducts, plenums, and other spaces used to transport environmental air without being enclosed in raceways. The test measures the flame travel distance and optical density of smoke when a specimen is exposed to the test fire. Optional measurements include heat and smoke release rates.

**1.3.2** Optical density of smoke and flame travel distance shall be recorded in this test. However, there is not necessarily a relationship between these measurements.

**1.3.3** This test method does not investigate circuit integrity characteristics or other such functionality performance during or after the fire test.

**1.3.4** This test method does not investigate the toxicity of the products of combustion or decomposition.

#### 1.4 Summary of Test Method.

**1.4.1** This test method uses the apparatus described in Chapter 2 to determine flame travel distance and optical density of smoke from insulated, jacketed, or both, electrical wires and cables and optical fiber cables that are to be installed in ducts, plenums, and other spaces used to transport environmental air without being enclosed in raceways. The apparatus is similar to that described in UL 910, *Test Method for Fire and Smoke Characteristics of Electrical and Optical-Fiber Cables Used in Air Handling Spaces*. The test method shall expose a set of wire or cable specimens, 24 ft (7.32 m) long, installed on a horizontal ladder type cable tray, to a controlled air and flaming fire expo-

sure in a fire-test chamber. A special specimen holder is used to expose the test specimens. The holder, ~~11.25 in. (286 mm) wide and approximately 4.25 in. (108 mm) below the ceiling of the test chamber,~~ is filled with one layer of test specimens. The specimens shall be exposed to a 294,000 ~~300,000~~ Btu/hr (86 ~~87.9~~ kW) fire, 4.5 ~~25~~ ft (1.37 m) long, for a period of 20 minutes, with an initial draft of 240 ft/min (73 m/min) through the chamber. During the test, flame travel distance and optical density of smoke shall be measured, and peak and average optical density of smoke shall be calculated. Optional measurements shall be permitted to include heat and smoke release rates from the burning sample.

### 1.5 Definitions.

**Flame Travel Distance.** Distance that the flame travels beyond the extent of the gas burner flame.

**Optical Density of Smoke (OD).** Smoke obscuration described in terms of logarithmic ratio of initial light intensity to instantaneous light intensity.

**Shall.** Indicates a mandatory requirement.

**Should.** Indicates a recommendation or that which is advised but not required.

**Standard.** A document, the main text of which contains only mandatory provisions using the word "shall" to indicate requirements and which is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions shall be located in an appendix, footnote, or fine-print note and are not to be considered a part of the requirements of a standard.

## Chapter 2 Test Apparatus

**2.1 Fire-Test Room.** The fire-test room in which the test chamber ~~and smoke measurement system are~~ is located shall have provision for a free inflow of air to maintain the room at controlled pressure of 0–0.05 in. (0–12 Pa) of water column greater than ambient barometric pressure and at a temperature of 73 °F ± 5°F (23°C ± 3°C) and relative humidity of 50 ± 5 percent throughout each test run. The fire-test room and smoke measurement area shall have controllable lighting.

**2.2 Fire-Test Apparatus.** The fire-test apparatus shall consist of the following:

- (a) Air-inlet chamber
- (b) ~~Fire test chamber~~
- (c) ~~Gas burners~~

~~(d) Removable top cover~~

~~(e) Exhaust transition~~

~~(f) Exhaust system~~

(b) Air-inlet shutter

(c) Fire-test chamber

(d) Gas burner

(e) Removable top cover

(f) Exhaust transition

(g) Exhaust duct

(h) Exhaust duct velocity measurement system

(i) Smoke measurement system

(j) Exhaust duct damper

**2.2.1 Air-Inlet Chamber.** The fire-test chamber air-inlet transition shall consist of an L-shaped galvanized steel unit secured to the air-inlet end of the fire-test chamber. The unit shall contain an 11.75 in. ± 0.25 in. (300 mm ± 6 mm) × 18.25 in. ± 0.25 in. (464 mm ± 6 mm) rectangular opening to allow air to enter the fire-test chamber through the chamber air-inlet shutter. A schematic of the air-inlet chamber is shown in Figure 2.2.1.

**2.2.1.1 Air-Inlet Shutter.** A vertically sliding shutter, extending the entire width of the test chamber, shall be provided at the air-inlet end of the fire-test chamber. The shutter shall be positioned to provide an air-inlet opening 3 in ± 0.06 in. (76 mm ± 2 mm) high, measured from the floor level of the test chamber and across the full width of the chamber, as shown in Figure 2.2.1. [See also Figure 2.2.2.1(a).]

### 2.2.2 Fire-Test Chamber.

**2.2.2.1\*** The fire-test chamber shall consist of a horizontal duct of the shapes and sizes shown in Figures 2.2.2.1(a) and (b). The sides and base of the duct shall be lined with

insulating masonry, consisting of refractory fire brick, as illustrated in Figure 2.2.2.1(b). One side shall be provided with a row of two panes of 1/4 in. (6 mm) thick high-temperature glass, pressure-tight observation windows, with the inside pane mounted flush with the inner wall. [See Figure 2.2.2.1(b).] The exposed window area shall be 2.75 in. ± 0.25 in. × 11 in. ± 1.5 in. (70 mm ± 6.4 mm × 280 mm ± 38 mm). The windows shall be located so that ~~the entire length of the specimens being tested is observable from outside the fire test chamber; the gas burner and the length of the specimens being tested, from the point at which the test fire ends, can be observed from outside the fire test chamber.~~



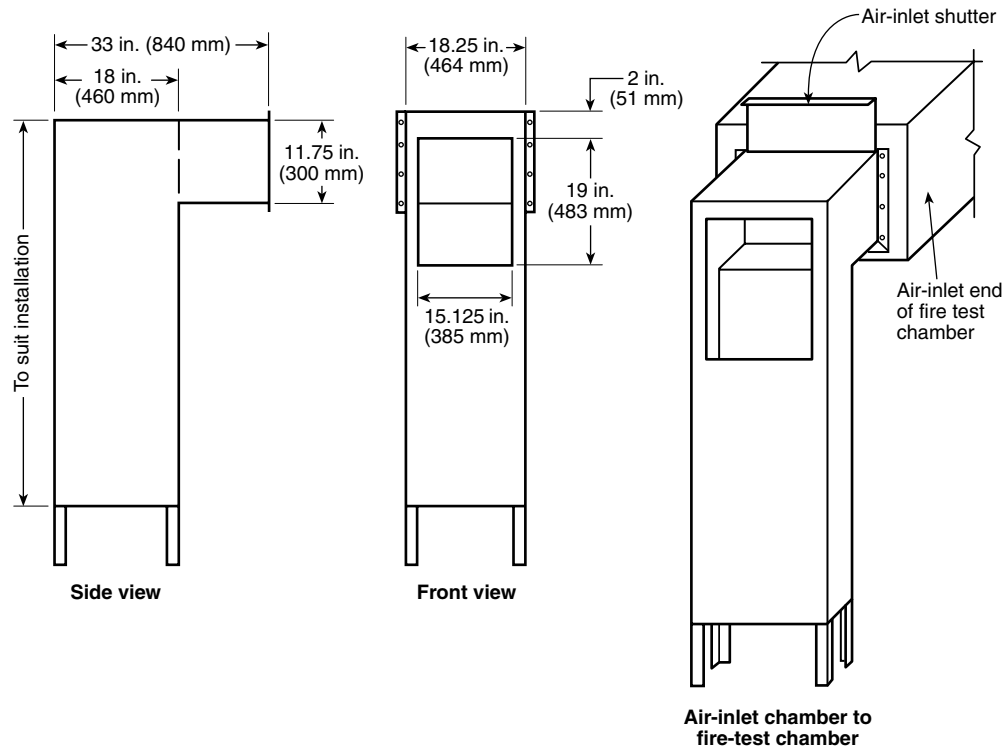


FIGURE 2.2.1 Schematic of the air-inlet chamber.

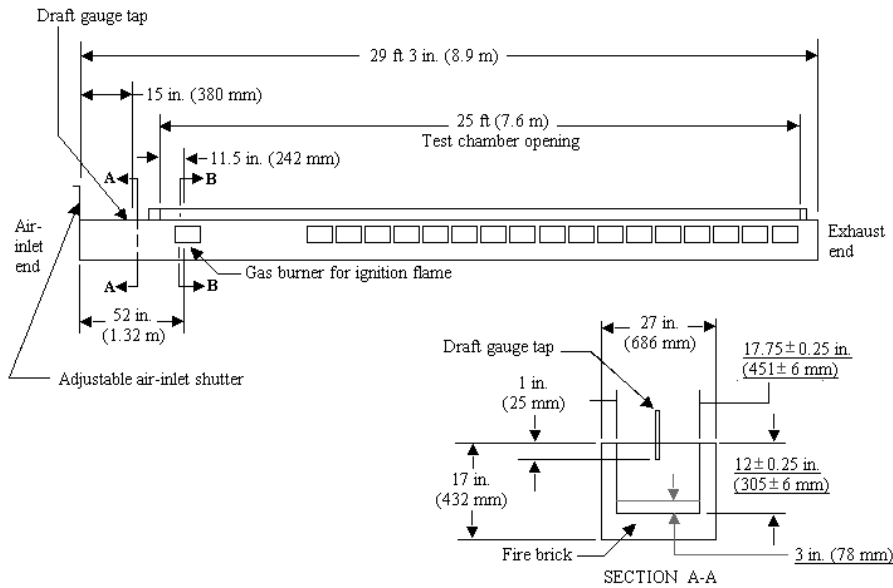


Figure 2-2.2.1(a) Details of fire-test chamber.

Tolerances are contained in applicable paragraphs.

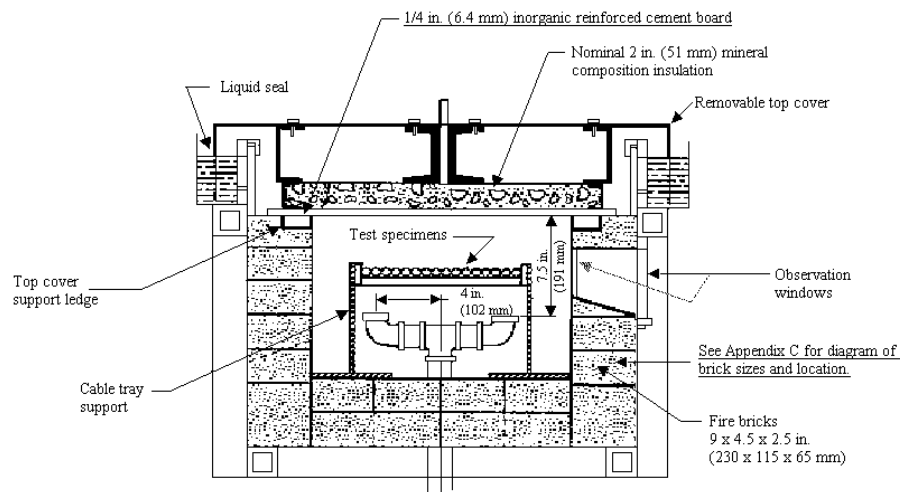


Figure 2-2.2.1(b) Cross section of the fire-test chamber (Section B-B, Figure 2-2.2.1(a))  
Tolerances are contained in applicable paragraphs.

**2.2.2.2\*** The top cover support ledges shall be fabricated of a structural material capable of withstanding abuse of continuous testing. The ledges shall be level with respect to length and width of the chamber and with respect to each other.

**2.2.2.3** To provide air turbulence for combustion, turbulence-inducing baffles shall be provided by positioning six 9 in. long  $\times$  4.5 in. wide  $\times$  2.5 in. thick (229 mm long  $\times$  114 mm wide  $\times$  64 mm thick) refractory fire bricks (long dimension vertical and 4.5-in. dimension parallel to the wall) along the side walls of the chamber at distances of  $6.5 \text{ ft} \pm 0.5 \text{ ft}$  (2.13 m  $\pm$  152 mm),  $13 \text{ ft} \pm 0.5 \text{ ft}$  (3.66 m  $\pm$  152 mm), and  $19 \text{ ft} \pm 0.5 \text{ ft}$  (6.10 m  $\pm$  152 mm) on the window side (do not obstruct the windows) and  $4.5 \text{ ft} \pm 0.5 \text{ ft}$  (1.37 m  $\pm$  152 mm),  $9.5 \text{ ft} \pm 0.5 \text{ ft}$  (2.90 m  $\pm$  152 mm), and  $16 \text{ ft} \pm 0.5 \text{ ft}$  (4.88 m  $\pm$  152 mm) on the opposite side, as measured from the centerline of the gas burner to the centerline of the fire bricks.

**2.2.3 Gas Burners.** One end of the test chamber, designated as the air-inlet end in Figure 2.2.2.1(a), shall be provided with a dual port gas burner, delivering flames upward, to engulf the test specimens. As shown in Figure 2.2.2.1(b), the burner shall be positioned transversely to each side of the centerline of the furnace so that the flame is evenly distributed over the width of the specimens. The burner shall be spaced  $11.5 \text{ in.} \pm 0.5 \text{ in.}$  ( $305 \text{ mm} \pm 13 \text{ mm}$ ) from the fire air-inlet end of the test chamber, and  $7.5 \text{ in.} \pm 0.25 \text{ in.}$  (191 mm  $\pm$  6 mm) below the removable top cover [see Figure 2.2.2.1(a) and (b)]. The burner shall be located  $52 \text{ in.} \pm 2 \text{ in.}$  (1320 mm  $\pm$  51 mm) downstream of the air-inlet shutter, as measured from the burner centerline to the outside surface of the shutter. Gas to the burner shall be provided through a single inlet pipe, distributed to each port burner through a tee-section. The outlet shall be a nominal 3/4 in. (19 mm) elbow. The plane of the ports shall be parallel to the furnace chamber floor, such that the gas is directed upward toward the specimen. Each port shall be positioned with its centerline  $4.0 \text{ in.} \pm 0.25 \text{ in.}$  (102 mm  $\pm$  6 mm) on each side of the centerline of the fire-test chamber so that the ignition burner flame is evenly distributed [see Figure 2.2.2.1(b)]. The gas burner should be ignited remotely using an electronic ignition system. The controls

used to maintain a constant flow of methane gas to the burners shall consist of the following:

- A pressure regulator
- A gas meter calibrated to read in increments of not more than  $0.1 \text{ ft}^3$  (2.8 L)
- A gauge to indicate gas pressure in Pa (or inches of water)
- A quick-acting gas shutoff valve
- A gas metering valve
- An orifice plate in combination with a manometer to assist in maintaining uniform gas-flow conditions

Alternative control equipment, if shown to be equivalent, shall be permitted.

## 2.2.4 Removable Top Cover.

**2.2.4.1\*** The removable top cover shall consist of a metal and mineral insulation composite unit whose insulation consists of nominal 2 in.  $\pm 0.25 \text{ in.}$  (51 mm  $\pm 6 \text{ mm}$ ) thick mineral composition material. The top unit is shown in Figure 2.2.2.1(b) and shall completely cover the fire-test chamber. The metal and mineral composite material shall have physical characteristics as follows:

- Maximum effective use temperature of not less than  $1200^\circ\text{F}$  ( $650^\circ\text{C}$ )
- Bulk density of  $21.0 \text{ lb/ft}^3 \pm 1.5 \text{ lb/ft}^3$  ( $335 \text{ kg/m}^3 \pm 20 \text{ kg/m}^3$ )
- Thermal conductivity of

$$0.50 \text{ to } 0.71 \frac{\text{Btu} \cdot \text{in.}}{\text{ft}^3 \cdot \text{hr} \cdot ^\circ\text{F}} \text{ at } 300 \text{ to } 700^\circ\text{F}$$

$$\left( 0.072 \text{ to } 0.102 \frac{\text{W}}{\text{m} \cdot \text{K}} \text{ at } 150 \text{ to } 370^\circ\text{C} \right)$$

- Kpc product of

$$1 \text{ to } \frac{4 \text{ Btu}^2 \cdot \text{in.}}{\text{ft}^2 \cdot \text{hr} \cdot ^\circ\text{F}} \left( 1 \times 10^4 \text{ to } \times 4 \frac{\text{W}^2 \cdot \text{sec}}{\text{m}^2 \cdot \text{K}^2} \right)$$

**2.2.4.2** The entire top-panel unit shall be protected with flat sections of high-density [nominally 110 lb/ft<sup>3</sup> (1760 kg/m<sup>3</sup>) 0.25 in. (6 mm) thick] mineral-fiber/cement board maintained in an unwarped and uncracked condition through continued replacement. While in place, the top panel shall rest on a nominal 1/8 in. (3 mm) thick woven fiberglass belting, positioned on the top cover support ledges. The top panel shall be completely sealed against the leakage of air into the fire-test chamber during the test. A water-filled trough, as shown in Figure 2.2.2.1(b) has been found suitable for this purpose.

## 2.2.5 Exhaust Transition.

**2.2.5.1** The exhaust end of the fire-test chamber shall be fitted with a transition piece. The exhaust transition shall consist of a stainless steel unit composed of a 35.5 in. ± 0.25 in. (902 mm ± 6 mm) long × 27 in. ± 0.25 in. (686 mm ± 6 mm) wide × 17.25 in. ± 0.25 in. (438 mm ± 6 mm) high rectangular section and an 18 in. ± 0.25 in. (457 mm ± 6 mm) long rectangular-to-round transition section connected to the 16 in. ± 0.125 in. (406 mm ± 3 mm) inside diameter (I.D.) exhaust duct. The outside of the transition section shall be insulated with a nominal 2 in. (51 mm) ceramic fiber blanket [nominal density 8 lb/ft<sup>3</sup> (130 kg/m<sup>3</sup>)]. The shape and size of the exhaust transition are shown in Figure 2.2.5.1.

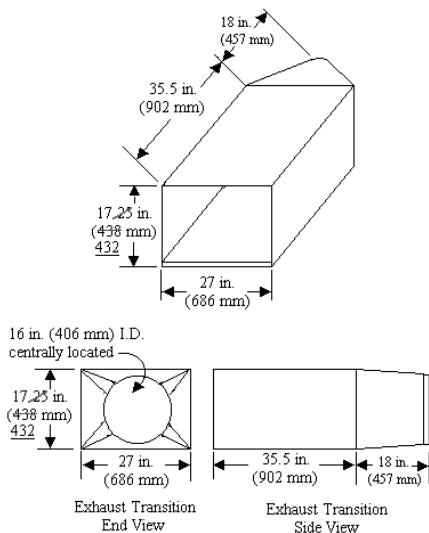


Figure 2-2.5.1 Schematic of the exhaust transition.  
Tolerances are contained in applicable paragraphs.

**2.2.5.2** The unit shall be secured to the exhaust end of the fire-test chamber.

**2.2.6 Exhaust System.** The exhaust system shall consist of the exhaust duct, smoke measurement system, exhaust duct damper, and a blower.

**2.2.6.1\* 2.2.6\* Exhaust Duct.** The 16 in. ± 0.125 in. (406 mm ± 3 mm) I.D. diameter exhaust duct shall be constructed from stainless steel and shall extend run 12 diameters 16 to 18 ft. horizontally in sufficient length downstream from the vent

end of the rectangular-to-round transition to the centerline of the smoke measurement system, prior to location of instrumentation, to provide for a fully developed mixed exhaust gas flow. It shall extend a minimum of 28 ft (8.5 m) from the vent end of the exhaust transition section. The exhaust duct shall be insulated with at least 2 in. (51 mm) of high-temperature mineral composition material from the end beginning of the exhaust transition piece to the photometer location, up to and including the smoke measurement system.

## 2.2.7 Exhaust Duct Velocity Measurement

### 2.2.7.1 Exhaust Duct Velocity Measuring Equipment

**2.2.7.1.1** The velocity in the exhaust duct is determined by measuring the differential pressure in the flow path with a bi-directional probe connected to an electronic pressure gauge, or an equivalent measuring system and a thermocouple.

**2.2.7.1.2** The bi-directional probe consists of a stainless steel cylinder with a solid diaphragm in the center that divides the probe into two chambers. The probe is to be manufactured 1.75 in. (44 mm) long with a cylinder length nominally two times the 0.87 in. (22 mm) inside outside diameter of the cylinder, with a minimum length of 1.0 in. (25 mm) and a maximum length of 2.0 in. (50 mm). The pressure taps on either side of the diaphragm are to support the probe.

**2.2.7.1.3** The axis of the probe is located at the centerline of the duct. The pressure taps are connected to a pressure transducer having a minimum resolution of 0.001 in. water (0.25 Pa).

**2.2.7.1.4** The temperature of the exhaust gas is measured upstream 6 in. (152 mm) from the probe and at the centerline of the duct, with a 28 AWG Type K thermocouple having an Inconel® sheath.

## 2.5 2.2.8 Smoke Measurement System.\*

**2.5.1\*** A 12-V sealed-beam, clear lens, auto spot lamp, operated at 12 V ± 0.05 V de light source, shall be mounted on a horizontal section of the exhaust duct. (See Figure 2.2.8 2.5.1.) The lamp shall be located at a point that is preceded by a straight run of round pipe at least 12 diameters, or 16 ft ± 0.5 ft (4.88 m ± 0.005 m) 16 ft (4.9 m) and not greater than 18 ft (5.5 m), from the vent end of the rectangular-to-round exhaust transition section. The lamp shall be placed where it is not affected by flame from the test chamber. The light beam shall be directed upward along the vertical axis of the vent pipe exhaust duct. The vent pipe shall be insulated with high-temperature mineral composition material from the vent end of the chamber to the photometer location. A photoelectric cell having an output directly proportional to the amount of light received shall be mounted over the light source, with an overall light-to-cell path distance of 36 in. ± 2 in. (910 mm ± 50 mm), 16 in. (406 mm) of which shall be taken up by the smoke in the exhaust duct, as shown in Section C-G of Figure 2.2.6.2. The light source and photoelectric cell shall be located such that they are open to the environment of the test room. The cylindrical light beam shall pass through 3-in. ± 1/8 in. (76 mm ± 3 mm) diameter openings at the top and bottom of the 16-in. (406-mm) diameter I.D. duct, with the resultant light beam centered on the photoelectric cell. The cell shall be connected to recording devices that indicate the attenuation of incident light due to particulate matter, and due to other effluents, in the passing smoke. Detailed engineering drawings are located in Appendix C.

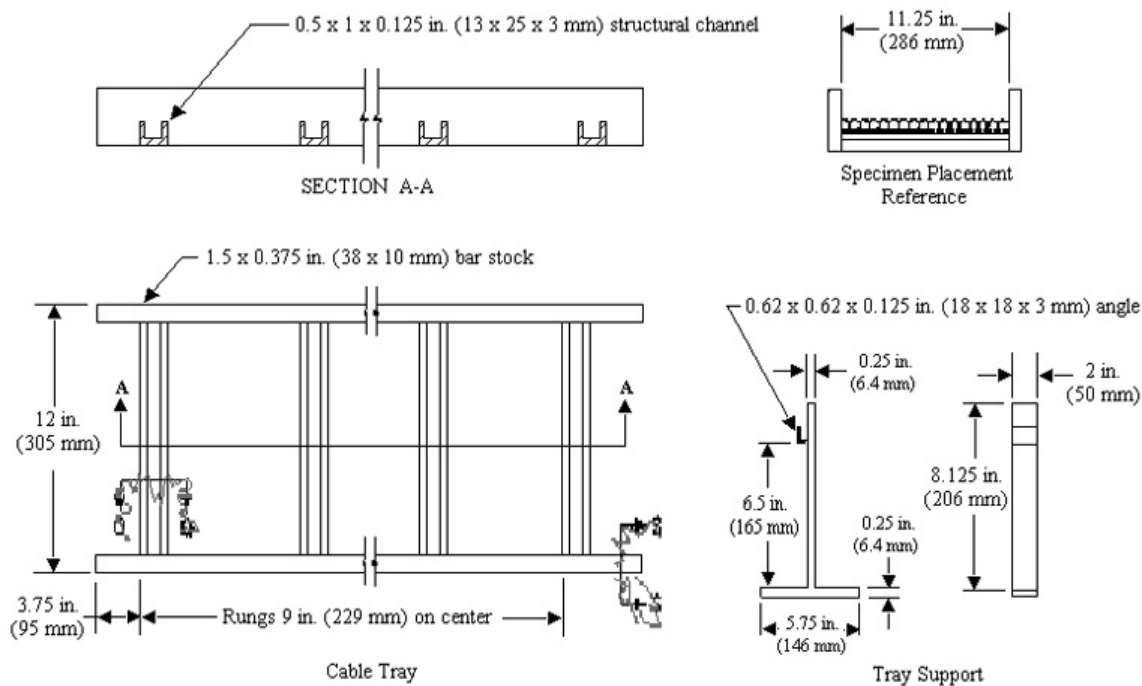


Figure 2-4 Details of ladder cable tray supports.  
Tolerances are contained in applicable paragraphs.

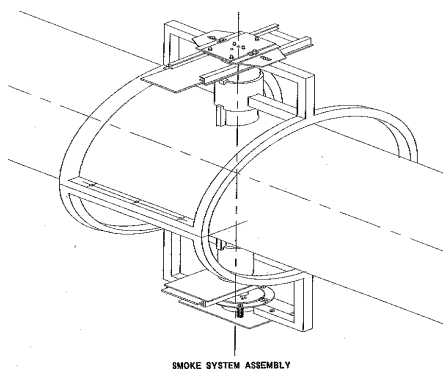


FIGURE 2.5.1 2.2.8\* ~~Light source mounting, Smoke Measurement System~~

**2.5.2** The photoelectric cell output shall be connected to a data acquisition device as specified in Section 2.7.

**2.2.6.2 2.2.9 Exhaust Duct Damper.** A single blade duct volume control damper, for a nominal 16 in. (406 mm) diameter I.D. duct, shall be positioned in the exhaust duct 5.5 ft  $\pm$  0.5 ft

(1.7 m  $\pm$  0.2 m), downstream of the smoke measurement system, centerline to centerline. The relative locations of the exhaust transition piece, exhaust duct, smoke measurement system, and exhaust duct damper are shown in Figure 2.2.6.2. To maintain airflow control throughout each test run, the exhaust duct damper shall be controlled by a closed-loop feedback system with respect to the air-inlet draft gauge static pressure.

**2.2.7 2.2.10 Exhaust Blower.** ~~The exhaust blower shall have the capacity to provide an average velocity of 240 ft/min  $\pm$  5 ft/min (1.22 m/sec  $\pm$  0.025 m/sec) at the inlet of the fire test chamber during the test.~~ The exhaust blower shall ~~also~~ have the capacity to develop at least 0.15 in. (37 Pa) of water column at the draft gauge tap, with the specimens in place, with the air shutter positioned to provide an air-inlet opening of 3 in.  $\pm$  0.06 in. (76 mm  $\pm$  2 mm), and with the exhaust duct damper in the wide-open position. (See 2.2.6.) The exhaust duct connecting the exhaust duct damper to the exhaust blower shall be 16 in. (406 mm) I.D. and shall be a straight section for a minimum of 6 ft from the centerline of the exhaust duct damper. Provisions shall be provided for an airtight expansion joint between the exhaust duct damper and exhaust blower. The exhaust blower shall be located a minimum of 6 ft (1.8 m) downstream of the exhaust duct damper. (See 4.2.5.)

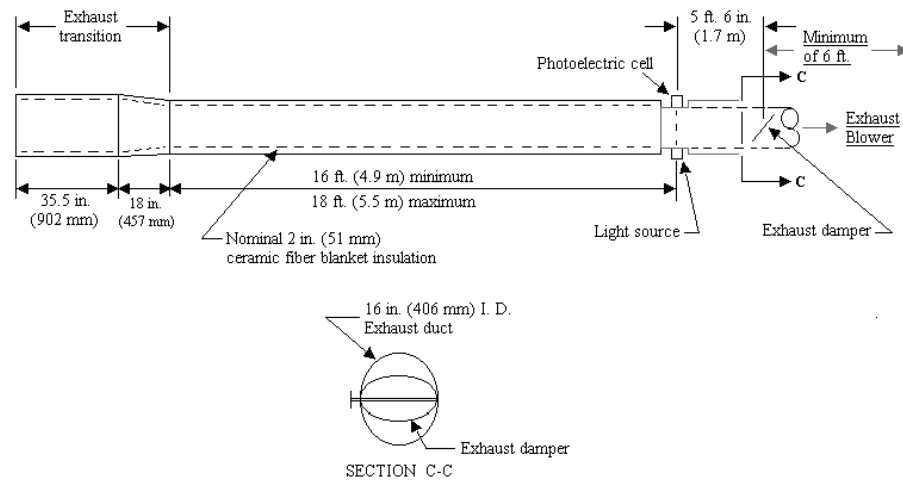


Figure 2-2.6 Location of exhaust transition, exhaust duct, smoke measurement system, and damper.  
Tolerances are contained in applicable paragraphs.

## 2.4 2.3 Fire-Test Chamber Airflow System.

**2.4.1 2.3.1** An air intake, fitted with a vertically sliding shutter that extends the entire width of the test chamber, shall be provided at the fire air-inlet end. The draft plate shall be positioned to provide an air-inlet port, as shown in Figure 2.2.1.

**2.4.2 2.3.2** Movement of air throughout the exhaust duct shall be by induced draft. The draft-inducing system shall have a total draft capacity of at least 0.15 in. of water column (37 Pa) with the specimens in place, with the shutter at the fire air-inlet end open to its normal position, and with the exhaust damper in the wide-open position. (See Section C-C in Figure 2.2.6.2 2.2.6.) A draft-gauge manometer to indicate static pressure shall be inserted through the top at the mid width of the tunnel, 1.0 in.  $\pm$  0.5 in. (25 mm  $\pm$  13 mm) below the ceiling, and 15.0 in.  $\pm$  0.5 in. (380 mm  $\pm$  13 mm) downstream of the air intake shutter as shown in Section C-C A-A of Figure 2.2.6.2. 2.2.2.1(a).

**2.4.3** ~~An automatic draft regulator controller shall be mounted in the vent pipe downstream of the exhaust damper. Other manual, automatic, or special draft regulation devices shall be permitted to be incorporated to maintain airflow control throughout each test run.~~

**2.3 2.4 Ladder Cable Tray.** The ladder-type cable tray used to support the open-cable test specimens or the cables-in-raceway test specimens is shown in Figure 2.3. The tray shall be fabricated from cold-rolled steel of 50,000 psi (350 MPa) minimum tensile strength. The solid bar stock side rails shall be ~~nominal 0.5~~ 1.5 in.  $\pm$  0.125 in.  $\times$  0.37 in.  $\pm$  0.125 in. (38 mm  $\pm$  3 mm  $\times$  10 mm  $\pm$  3 mm), as shown in Section S-S in Figure 2.3 2.4. The C-shaped channel rungs shall be 0.5 in.  $\pm$  0.125 in.  $\times$  1 in.  $\pm$  0.125 in.  $\times$  0.125 in.  $\pm$  0.06 in. (13 mm  $\pm$  3 mm  $\times$  25 mm  $\pm$  3 mm  $\times$  3 mm  $\pm$  1 mm) structural channels, as shown in Section Q-Q A-A in Figure 2.3 2.4. Each rung shall be 11.25 in.  $\pm$  0.125 in. (286 mm  $\pm$  3 mm) long. The rungs shall be welded to the side rails 9 in.  $\pm$  0.125 in. (299 mm  $\pm$  3 mm) on centers along the tray length. The tray shall consist of one or more sections having a total assembled length of 24 ft  $\pm$  2 in. (7.3 m  $\pm$  51 mm) and shall be supported with a total of 16 supports equally

spaced along the length of the tray. The tray supports, as shown in Figure 2.3 2.4, shall be fabricated from bar steel.

## 2.6 2.5 Fire-Test Chamber Temperature Measurement Instruments.

**2.6.1 2.5.1** A 19 AWG chromel-alumel thermocouple ~~with nominal wire cross section of 0.0359 in. (0.912 mm)~~, with 0.375 in.  $\pm$  0.125 in. (10 mm  $\pm$  3 mm) of the junction exposed in the fire-chamber air, shall be inserted through the floor of the test chamber. The tip of the thermocouple shall be 1 in.  $\pm$  0.125 in. (25 mm  $\pm$  3 mm) below the top surface of the glass fiber belting, 23 ft  $\pm$  0.5 in. (7010 mm  $\pm$  13 mm) from the centerline of the burner ports, and at the center of the width of the chamber.

**2.6.2 2.5.2** A 19 AWG chromel-alumel thermocouple ~~with nominal wire cross section of 0.0359 in. (0.912 mm)~~, embedded 0.125 in.  $\pm$  0.06 in. (3.2 mm  $\pm$  1.6 mm) below the floor surface of the test chamber, shall be mounted in refractory or portland cement (carefully dried to keep it from cracking) at distances of 13 ft  $\pm$  0.5 in. and 23.25 ft  $\pm$  0.5 in. (4.0 m  $\pm$  13 mm and 7.1 m  $\pm$  13 mm) from the centerline of the burner and at the center of the width of the chamber.

**2.7 2.6 Data Acquisition Equipment.** A digital data-acquisition system shall be used to collect and record light attenuation, temperature, flame spread, and velocity measurements. ~~The speed and capacity of~~ The data system shall be capable of collecting the data at intervals of 2 seconds. The data-acquisition system shall have an accuracy corresponding to at least  $\pm$  2°F (0.5°C) for the temperature channels and 0.01 percent of full-scale instrument output for all other instrument channels. A smoothing routine shall not be used to process the data.

## Chapter 3 Test Specimens

**3.1 Specimens.** Test specimens shall consist of 24 ft  $\pm$  6 in. (7.32 m  $\pm$  152 mm) lengths of cables installed in a single layer across the bottom of the cable tray, as shown in Figure 2.2.2.1(b).

## Chapter 4 Calibration and Maintenance of Test Equipment

**4.1 Maintenance.** Maintenance for the apparatus shall be conducted routinely every 30 days, which shall include the following procedures (with replacement of components as necessary):

- (a) Inspection of tunnel and wall bricks
- (b) ~~Cleaning~~ Inspection of windows
- (c) Inspection of the inorganic cement board
- (d) Inspection of the castable block mix

~~4.1~~ **4.2 Frequency of Calibration.** The test apparatus shall be calibrated, as described in Sections 4.3 through 4.6 at a minimum of one-month intervals.

### ~~4.2~~ 4.3 Airflow.

~~4.2.1~~ **4.3.1** A 24 in.  $\pm 0.125$  in. (610 mm  $\pm 3$  mm)  $\times$  14 in.  $\pm 0.125$  in. (356 mm  $\pm 3$  mm)  $\times$  0.06 in.  $\pm 0.03$  in. (2 mm  $\pm 1$  mm) steel plate shall be placed on the top cover support ledges at the air-inlet end of the fire-test chamber, over the gas burner. Then three 8 ft  $\pm 0.5$  in. (2.44 m  $\pm 13$  mm)  $\times$  2 ft  $\pm 0.5$  in. (61 mm  $\pm 13$  mm)  $\times$  0.25 in.  $\pm 0.125$  in. (6 mm  $\pm 3$  mm) mineral-fiber/cement boards shall be placed to fill the remaining length of the fire-test chamber, placed end-to-end on the ledge of the furnace chamber, as shown in Figure 2.2.2.1(b). The material for the board shall be as defined in 2.2.4.2. The removable top of the test chamber shall then be placed in position.

~~4.2.2~~ **4.3.2** The air supply shall be maintained at 73°F  $\pm 5$ °F (23°C  $\pm 3$ °C). Relative humidity shall be kept at 50 percent  $\pm 5$  percent during the test.

~~4.2.3\*~~ **4.3.3\* Air Leakage Test.** The draft shall be established to produce a static pressure 0.15 in. water column (37 Pa) reading on the draft manometer with the following conditions:

- (a) Board in position and removable top in place
- (b) ~~Fire~~ Air-inlet end shutter open 3 in.  $\pm 0.06$  in. (76 mm  $\pm 2$  mm)
- (c) ~~Exhaust damper in the wide open position~~ Manually adjusted exhaust damper

The ~~fire~~ air-inlet end shutter shall then be closed and sealed. The manometer reading shall be increased to at least a 0.375-in. water column (93 Pa), which indicates that no excessive air leakage exists. The static pressure reading obtained shall be recorded.

~~4.2.4~~ **4.3.4 Supplemental Air Leakage Test.** ~~In addition to the procedures of 4.2.3, a supplemental leakage test shall be conducted. A smoke bomb shall be activated. Conduct a supplemental air leakage test by activating a smoke bomb in the fire chamber while the fire air-inlet shutter and exhaust duct beyond the differential manometer tube are sealed. The bomb shall be ignited, and the chamber pressurized to a 0.025-in. water column (6.2 Pa). All points of leakage observed in the form of escaping smoke particles shall be sealed.~~

~~4.2.5\*~~ **4.3.5\* Velocity Traverse Test.** ~~A draft reading shall be established within the range of a 0.075–0.085 in. water column (17–19 Pa). An air-inlet static pressure at the draft gauge tap shall be established to obtain the specified air velocity. The~~

required draft-gauge reading shall be maintained throughout the test by regulating the controlled exhaust damper.

The air velocity at each of seven points, each located 23 in.  $\pm 1$  in. (7 m  $\pm 3$  mm) from the centerline of the gas burner, and 6 in.  $\pm 0.25$  in. (152 mm  $\pm 6$  mm) below the plane of the top cover support ledges, shall be recorded. These seven points shall be determined by dividing the width of the tunnel into seven equal sections and recording the velocity at the geometric center of each section.

During the measurement of velocity, the turbulence blocks shall be removed and the leading edge of the straightening vanes, 24 in.  $\pm 0.125$  in. (670 mm  $\pm 3$  mm)  $\times$  12 in.  $\pm 0.125$  in. (305 mm  $\pm 3$  mm), shall be placed 16 ~~48~~ ft (4.9 ~~5.5~~ m) from the centerline of the burner. The straightening vanes shall divide the chamber cross section into nine uniform vertical sections. The average velocity shall be 240 ft/min  $\pm 5$  ft/min (1.22 m/sec  $\pm 0.025$  m/sec), determined using a ~~velocity transducer~~ bi-directional probe. If deviation exists, adjust the exhaust damper position to obtain a velocity of 240  $\pm 5$  ft/min (1.22  $\pm 0.025$  m/sec). The air-inlet static pressure shall be recorded. Following calibration, this pressure shall be maintained to within  $\pm 5$  percent for all testing.

~~4.3\*~~ **4.4\* Smoke Measurement System Calibration Test.** With the light source voltage established at a minimum of 8 V and the photoelectric cell voltage established at a minimum of 30 mV (clear beam), the system and photoelectric cell shall be calibrated using 10 neutral density filters with values of 0.1, 0.2, 0.3, 0.4, 0.5, 0.6, 0.7, 0.8, 0.9, and 1.0. Each filter shall be positioned in front of the photoelectric cell to cover the entire width of the light path. The light obscuration using the neutral density filters shall be used to calculate the optical density of smoke as follows:

$$OD = \log_{10} \frac{I_0}{I}$$

where:

OD = optical density

$I_0$  = clear beam photo detector signal

$I$  = photo detector signal with the neutral density filter

The calculated values of OD for each filter shall be plotted on the X-axis, with the corresponding neutral density value on the y-axis. The slope of a best-fit line shall be determined using least-squares error technique. The slope of the best-fit line shall be 1  $\pm 0.2$ . The coefficient of regression,  $r^2$ , shall be greater than 0.99. Following calibration, all subsequent OD calculations shall be corrected, using the slope of the line obtained, agree within 3 percent of the neutral density values. The total tolerance of all filters shall be within 1 percent. If deviation exists outside the required tolerances, the light source voltage and photoelectric cell resistance shall be adjusted. Adjustments shall be quantified by re-calibration.

~~4.4\*~~ **4.5\* Fuel.** The test fire, which produces 294,000  $\pm 7300$  ~~300,000 Btu/hr  $\pm 7500$  Btu/hr (86.88 kW  $\pm 2$  kW),~~ shall be fueled with bottled methane gas of a minimum 98 percent purity and with a high heating value of 1000 Btu/ft<sup>3</sup>  $\pm 15$  Btu/ft<sup>3</sup> (37 MJ/m<sup>3</sup>  $\pm 0.5$  MJ/m<sup>3</sup>), determined using a gas calorimeter or as documented by the fuel supplier. The gas supply shall be adjusted initially to approximately 294,000  $\pm 7300$  ~~5000 Btu/min  $\pm 125$  Btu/hr (86.88 kW  $\pm 2$  kW).~~ The gas pres-