NFPA 302
Fire Protection
Standard for
Pleasure and
Commercial
Motor Craft

1998 Edition



Copyright © National Fire Protection Association, Inc. One Batterymarch Park Quincy, Massachusetts 02269

IMPORTANT NOTICE ABOUT THIS DOCUMENT

NFPA codes and standards, of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in its codes and standards.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on this document. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making this document available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of this document. Nor does the NFPA list, certify, test or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

NOTICES

All questions or other communications relating to this document and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA documents during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

Users of this document should be aware that this document may be amended from time to time through the issuance of Tentative Interim Amendments, and that an official NFPA document at any point in time consists of the current edition of the document together with any Tentative Interim Amendments then in effect. In order to determine whether this document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments, consult appropriate NFPA publications such as the *National Fire Codes*® Subscription Service, visit the NFPA website at www.nfpa.org, or contact the NFPA at the address listed above.

A statement, written or oral, that is not processed in accordance with Section 16 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

The NFPA does not take any position with respect to the validity of any patent rights asserted in connection with any items which are mentioned in or are the subject of this document, and the NFPA disclaims liability of the infringement of any patent resulting from the use of or reliance on this document. Users of this document are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Users of this document should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

Licensing Policy

This document is copyrighted by the National Fire Protection Association (NFPA). By making this document available for use and adoption by public authorities and others, the NFPA does not waive any rights in copyright to this document.

- 1. Adoption by Reference Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.
- 2. Adoption by Transcription A. Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rule-making process. B. Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.
- **3. Scope of License Grant** The terms and conditions set forth above do not extend to the index of this document. (For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

NFPA 302

Fire Protection Standard for Pleasure and Commercial Motor Craft

1998 Edition

This edition of NFPA 302, *Fire Protection Standard for Pleasure and Commercial Motor Craft*, was prepared by the Technical Committee on Motor Craft and acted on by the National Fire Protection Association, Inc. at its Annual Meeting held May 18–21, 1998, in Cincinnati, OH. It was issued by the Standards Council on July 16, 1998, with an effective date of August 5, 1998, and supersedes all previous editions.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

This edition of NFPA 302 was approved as an American National Standard on August 6, 1998.

Origin and Development of NFPA 302

This Fire Protection Standard for Pleasure and Commercial Motor Craft represents the cumulative result of over 69 years of attention to fire safety of power boats by the NFPA. The first edition of this standard was adopted by the Association in 1937. Successive editions adopted are as follows: 1939, 1948, 1950, 1951, 1952, 1953, 1954, 1955, 1957, 1960, 1964, 1966, 1968, 1972, 1980, 1984, 1989, and 1994.

Prior to 1937, the information was contained in Appendix D of NFPA 301, Fire Prevention Regulations for the Construction and Maintenance of Vessels.

For the 1994 edition, NFPA 302 was completely revised to improve its usability and adoptability, to make it compatible with industry practice and other industry standards, as well as to create a new chapter on lightning protection systems for boats. The Committee on Motor Craft also amended the existing provisions in Chapter 6 on gas-fueled equipment as well as added provisions for new fuels being used for cooking appliances on boats. In 1984, the title of the document was officially changed to *Standard for Pleasure and Commercial Motor Craft*. The 1998 revision of NFPA 302 incorporates complete revisions to Chapters 9 and 10. The requirements for lightning protection were referenced to another marine industry standard, ABYC E-4, *Lightning Protection*, in which the fire protection equipment requirements were updated to reflect the recent advancements and changes pertaining to clean agent extinguishing systems, and alternatives to halons.

Technical Committee on Motor Craft

J. Anthony Stimatz, U.S. Coast Guard (G-OPB), DC [E]

Robert Adriance, Jr., Boat/U.S., VA [C] Robert A. Carlson, Hubbell Inc., CT [M]

Russell Chiasson, Trident Marine Consultants, Inc., PQ, Canada

Desmond Connolly, Buzzards Bay, MA [I] Rep. Nat'l Assn. of Marine Surveyors Inc.

Bruce F. Dining, Marine Energy Systems, Inc., NH [IM] Rep. Nat'l Propane Gas Assn.

Bolling F. Douglas, Marine Assoc., Inc., GA [SE] **E. Charles Game,** E. C. Game Engr, NC [SE]

Gilles R. Gareau, Transport Canada, ON, Canada [E] Thomas M. Hale, American Boat and Yacht Council,

MD [U]
Paul O. Huston, Paul Huston & Assoc., AL [SE]
Ralph E. Lambrecht, Independent Marine Engineer, IL
[SE]

Robert Loeser, Underwriters Laboratories Inc., FL [RT] Kim I. MacCartney, CIGNA Property and Casualty, PA [I]

Jonas L. Morehart, Punta Gorda, FL [SE]

Donald B. Pray, Donald B. Pray Marine Surveyor, MA [SE]

Donald C. Smutz, U.S. Coast Guard Auxiliary, CA [U] **Timothy G. Stillman,** Ft. Lauderdale, FL [U]

Rep. NFPA Fire Service Section

Robert J. Strople, Walter Kidde Portable Equipment Co., NC [M]

Rep. Fire Equipment Mfrs. Assn.

Michael Taylor, Taylor Marine Services Inc., MA [SE] Kenneth J. Weinbrecht, Ocean-Bay Marine Services, Inc., NY [I]

Rep. Society of Accredited Marine Surveyors

Alternates

Philip J. Cappel, U.S. Coast Guard, DC [E]
(Alt. to J. A. Stimatz)
Jeffrey Hall, Underwriters Laboratories Inc., NC [RT]
(Alt. to R. Loeser)

Patricia Kearns, American Boat & Yacht Council, MD [U] (Alt. to T. M. Hale)
Bruce J. Swiecicki, Nat'l Propane Gas Assn., IL [IM] (Alt. to B. F. Dining)

Martha H. Curtis, NFPA Staff Liaison

This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of this document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on fire prevention and protection of motor craft and the encouragement of their use by designers, builders and owners.

CONTENTS **302–**3

Contents

Chapte	er 1 General	7-4	Power Distribution System Negative
1-1	Scope		Connections
1-2	Purpose	7-5	Continuously Energized Parts 302–21
1-3		7-6	Marking
	Equivalency	7-7	Ambient Temperature
1-4	Units	7-8	Ignition Sources
1-5	Definitions	7-9	Overcurrent Protection
Chant	209 7	7-10	Switches
Спари	er 2 Hull	7-11	Appliances and Equipment
2-1	General Arrangement	7-12	System Wiring
2-2	Spaces Open to the Atmosphere	7-12	Wiring Installation
2-3	Connecting Compartments or Spaces	7-13	Wiring Connections
	by a Natural Ventilation System	7-14	
2-4	Natural Ventilation		Receptacles
2-5	Powered Ventilation System	7-16	Plug Connectors
2-6	Arrangements of Openings 302–10	Chantar	Altomoting Current (ac) Floatrical
	intangement of openings in the transfer	Chapter	r 8 Alternating Current (ac) Electrical Systems on Boats
Chapte	er 3 Engines		
2.1	Exposed Engine Surface	8-1	General
3-1	Temperatures	8-2	Requirements—General
	Temperatures	8-3	Marking
Chante	er 4 Engine Exhaust Systems	8-4	System Voltage
Chapte	·	8-5	Ambient Temperature
4-1	General Requirements	8-6	Ignition Source
4-2	Materials	8-7	Shore Power Polarity Devices 302–31
4-3	Hose Connections	8-8	Overcurrent Protection
4-4	Temperature Protection 302–11	8-9	Main Supply
		8-10	Branch Circuits
Chapte	er 5 Fuel Systems	8-11	Ground-Fault Circuit Interrupters
5-1	Scope		(GFCI)
5-2	General Requirements 302–11	8-12	Appliances and Equipment 302–35
5-3	Fuel Tank Materials	8-13	Conductors and Flexible Cords 302– 35
5-4	Fuel Tank Design and Construction 302 –12	8-14	Installation
5-5	Fuel Tank Installation	8-15	Receptacles
5-6	Fuel Lines, Fittings, and Related	8-16	Main Panelboard
3 0	Accessories	8-17	Alternating-Current (ac) Generators 302–41
	Accessories	8-18	Isolation of Galvanic Currents
Chapte	er 6 Cooking, Heating, and Auxiliary	8-19	Shore Power
1	Appliances	8-20	Devices Employing Isolation
		0-20	Transformers
	General	8-21	
6-2	Cooking Appliances Installation 302–14	0-41	
6-3	Coal, Charcoal, and Wood Burning		Circuits
	Appliances	Chanter	r 9 Lightning Protection
6-4	Liquid Fuel Appliances	Chapter	5 Lightning Protection
6-5	Liquefied Petroleum Gas (LPG) and	9-1	General
	Compressed Natural Gas (CNG)		
	Systems for Permanently Installed	Chapter	r 10 Fire Protection Equipment 302–42
	Appliances	10-1	General Requirements
6-6	Heating Equipment		Portable Fire-Extinguishing
6-7	Auxiliary Appliances	10-2	
6-8	Electric Stoves	10.9	Equipment
6-9	Installation of Electric Stoves	10-3	Fixed Fire Protection Systems 302–43
		10-4	Installation of Fixed Systems and Portable
Chapte	er 7 Electrical Systems Under 50 Volts 302–19		Extinguishers
7-1	General	Chanter	r 11 Referenced Publications 302–44
7-2	Requirements—General	Chapter	22 ZEEEEGOOG Z GOMONIOUS
7-3	Batteries	Append	lix A Explanatory Material 302–45
		11.	*

1.1	Portable Fire Extinguishers and Fixed Systems	Appendix D	Referenced Publications	302 –53
Appendix C	Operation and Maintenance 302–51	Index		302 –53

GENERAL **302–**5

NFPA 302

Fire Protection Standard for

Pleasure and Commercial Motor Craft 1998 Edition

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Appendix A.

Information on referenced publications can be found in Chapter 11 and Appendix D.

Chapter 1 General

1-1 Scope.

- **1-1.1** This standard provides minimum requirements for the prevention of fire and explosion and for life safety in case of fire. This standard also provides minimum requirements for the following:
- (a) Elimination of ignition sources
- (b) Ventilation of accommodation spaces, fuel tanks, and machinery
- (c) Use of combustible materials
- (d) Fire extinguishing equipment and fire exits
- (e) Control of fire extinguishing agents in machinery spaces
- **1-1.2** This standard shall apply to boats of less than 300 gross tons used for pleasure or commercial purposes that meet one of the following conditions:
- (a) Motor craft
- (b) Boats that use cooking, heating, or auxiliary appliances (see Chapter 6)
- (c) Boats that have permanently installed ignition source(s) *Exception: Personal watercraft.*
- **1-1.3** No requirement of this standard shall be construed as reducing applicable federal regulations.
- **1-1.4** This standard does not apply to the control of carbon monoxide or toxic gases as a result of internal combustion, external combustion, or appliances.

1-2 Purpose.

- **1-2.1** The purpose of this standard is to minimize the loss of life and property due to fires and explosions aboard pleasure and commercial motor craft. The intent of this standard is to make motor craft as free from the hazards of fire as practicable.
- 1-2.2 The requirements of this standard shall be considered necessary to provide a reasonable level of protection from loss of life and property from fire and explosion. These requirements reflect the conditions and the state of the art at the time the standard was issued.
- 1-2.3 Applicability. Unless otherwise noted, it is not intended that the provisions of this standard be applied to facilities, equipment, structures, or installations existing or approved for construction or installation prior to the effective date of the standard, except in those cases where it is determined by the authority having jurisdiction that the existing situation involves a distinct hazard to life or adjacent property.

1-3 Equivalency. Nothing in this standard shall be intended to prevent the use of systems, methods, or devices of equivalent or superior quality, strength, fire resistance, effectiveness, durability, and safety in place of those required by the standard, provided technical documentation is submitted to the authority having jurisdiction to demonstrate equivalency.

1-4* Units. Metric units of measurement in this standard are in accordance with the modernized metric system known as the International System of Units (SI). The liter unit, which falls outside of but is recognized by SI, is used commonly in international fire protection. These units are listed in Table 1-4 with their conversion factors.

Table 1-4 Unit Conversion Factors

Name of Unit	Unit Symbol	Conversion Factor
Millimeter	mm	1 in. = 25.4 mm
Meter	m	1 in. = 0.0254 m
Square centimeter	cm^2	$1 \text{ in.}^2 = 6.452 \text{ cm}^2$
Square meter	m^2	$1 \text{ ft}^2 = 0.093 \text{ m}^2$
Cubic centimeter	cm^3	$1 \text{ in.}^3 = 16.39 \text{ cm}^3$
Cubic meter	m^3	$1 \text{ ft}^3 = 0.0283 \text{ m}^3$
Grams	g	1 oz = 28.35 g
Liter	L	1 gal = 3.785 L
Kilopascal	kPa gauge	1 psi = 6.90 kPa gauge
Bar	Bar	14.50 psi = 1 bar
Cubic meters per minute	m^3/min	$1 \text{ cfm} = 0.0283 \text{ m}^3/\text{min}$

1-4.1 If a value for a required measurement in this standard is followed by an equivalent value in metric units, the first stated value shall be regarded as the requirement. The equivalent value that follows is approximate.

Exception: For motor craft under the jurisdiction of Canadian authorities, the metric unit value shall be the requirement.

- **1-4.2** SI units have been converted by multiplying the quantity by the conversion factor and then rounding the result to the appropriate number of significant digits.
- **1-5 Definitions.** For the purpose of this standard, the following terms are defined as follows:

Accessible. Capable of being reached for inspection, maintenance, or removal without disturbing the permanent hull structure.

Accommodation Space. Space designed for living purposes.

Alternating Current (ac) Grounded Conductor. A current-carrying conductor intentionally maintained at ground potential that is connected to the side of the source.

Alternating Current (ac) Grounding Conductor (Green). A normally noncurrent-carrying conductor that connects the exposed metallic noncurrent-carrying parts of electrical equipment to the ac system and engine negative terminal or its bus for the purpose of minimizing shock hazard to personnel.

Approved.* Acceptable to the authority having jurisdiction.

Authority Having Jurisdiction.* The organization, office, or individual responsible for approving equipment, an installation, or a procedure.

Battery Cold Cranking Rating. The discharge load in amperes that a battery at 0°F (-17.8°C) can deliver for 30 seconds while maintaining a voltage of 1.2 volts per cell or higher.

Battery Reserve Capacity. The number of minutes for which a new, fully charged battery at 80°F (26.7°C) can be discharged at 25 amperes while maintaining a voltage of 1.75 volts per cell or higher (10.5 volts for a 12-volt battery or 5.25 volts for a 6-volt battery).

Bonding Conductor. A normally noncurrent-carrying conductor that is not intended to carry leakage current from either the ac or the dc system. Bonding conductors connect underwater metallic objects as part of any cathodic protection system and serve as lightning grounding conductors. If used, they shall be colored green or shall be of bare copper.

Butane. See LPG (Liquefied Petroleum Gas).

Clean Agent. Electrically nonconducting, volatile, or gaseous fire extinguishant that does not leave a residue upon evaporation. The word "agent" as used in this document means "clean agent" unless otherwise indicated.

CNG (Compressed Natural Gas).* A natural lighter-thanair gas that consists principally of methane in gaseous form plus naturally occurring mixtures of hydrocarbon gases.

Direct Current (dc) Grounded Conductor. A current-carrying conductor connected to the side of the source that is intentionally maintained at boat ground potential.

Direct Current (dc) Grounding Conductor. A normally noncurrent-carrying conductor used to connect metallic noncurrent-carrying parts of a direct current device to the engine negative terminal or its bus for the purpose of minimizing stray current corrosion.

Double Insulation System. An insulation system comprised of insulation and supplementary insulation, with each insulation physically separated and so arranged to prevent its simultaneous subjection to the same level of deteriorating influences (temperature, contaminants, and the like) as the other.

Engine Exhaust System. The means by which products of combustion are conducted from the engine exhaust manifold to an outboard terminus. This system includes related accessories that can be metallic or nonmetallic, such as pipes, mufflers, silencers, turbochargers, spark arresters, and all necessary connecting and supporting fittings. Wet exhaust systems are provided with water injection into the exhaust gas stream; dry exhaust systems do not have this provision.

Engine Negative Terminal. The point on the engine at which the negative battery cable is connected.

Galvanic Isolator. A device installed in series with the ac grounding (green) conductor of the shore power cable to block, in effect, the low voltage dc galvanic current flow, yet permit the passage of ac current normally associated with the ac grounding (green) conductor.

Galvanically Compatible.* Metals that are related closely to each other in the galvanic series.

Gross Ton. Identical to document tonnage; generally related to the total internal volume of the vessel. Gross tonnage is a measurement of volume, not displacement.

Ground. The electrical potential of the earth's surface. The boat's ground is established by a conducting connection (intentional or accidental) with the earth, including any conductive part of the wetted surface of a hull.

Grounded Conductor. A current-carrying conductor intentionally maintained at ground potential that is connected to the side of the source.

Ground-Fault Circuit–Interrupter (GFCI). A device intended for protection of personnel that functions to deenergize a circuit or portion thereof within an established period of time when a fault current-to-ground exceeds some predetermined value that is less than that required to operate the overcurrent protective device of that supply circuit.

Ground-Fault Protector (GFP). A device intended to protect equipment by interrupting the electric current to the load when a fault current-to-ground exceeds some predetermined value that is less than that required to operate the overcurrent protection device of that supply circuit.

Halogenated Agents. Halogenated agents referenced in this standard are the following types:

- (a) Halons: bromochlorodifluoromethane (Halon 1211), bromotrifluoromethane (Halon 1301), and mixtures of Halon 1211 and Halon 1301 (Halon 1211/1301)
- (b)* Halocarbons: hydrochlorofluorocarbon (HCFC), hydrofluorocarbon (HFC), perfluorocarbon (PFC), and fluoroiodocarbon (FIC)

Ignition Protection. The design and construction of a device such that under the designed operating conditions:

- (a) Device does not initiate ignition when surrounded by a flammable hydrocarbon mixture if an ignition source causes an internal explosion
- (b) Device is incapable of releasing sufficient electrical or thermal energy to ignite a hydrocarbon mixture
- (c) Source of ignition is hermetically sealed

A flammable hydrocarbon mixture is a mixture of gasoline and air or propane plus air between the lower explosive limit (LEL) and upper explosive limit (UEL).

Ignition Source. Any item or substance capable of an energy release of a type and magnitude sufficient to ignite any flammable mixture of gases or vapors that could occur onboard the vessel.

Inboard Engine. Any internal combustion engine other than an outboard engine permanently mounted within the hull.

Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

Listed.* Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the

HULL 302–7

equipment, material, or service meets identified standards or has been tested and found suitable for a specified purpose.

LPG (**Liquefied Petroleum Gas**).* Terms "liquefied petroleum gas," "LP-Gas," and "LPG" that are synonymous and include any product composed predominantly of any of the following gaseous hydrocarbons: propane, propylene, butane, isobutane, butylenes, or a mixture thereof.

Machinery Space. Any space containing an internal combustion engine.

Motor Craft. Any boat that is not solely propelled by wind or human power.

Open to the Atmosphere. A space or compartment that has at least 15 in. 2 /ft³ (97.5 cm²/m³) of net open area directly exposed to the atmosphere of net compartment volume.

Overcurrent Protection Device. A device, such as a fuse or circuit breaker, designed to interrupt the circuit when the current flow exceeds a predetermined value.

Panelboard. An assembly of devices for the purpose of controlling or distributing, or both, power on a boat. It can include devices such as circuit breakers, fuses, switches, instruments, and indicators. Panelboards are intended to be installed in enclosures and are accessible from the front or rear.

Permanently Installed. Fastened in place and not intended for ready removal except for service, repair, or replacement.

Personal Watercraft. A vessel less than 13 ft (4 m) in length that uses an internal combustion engine powering a water jet pump as its primary source of propulsion, and is designed to be operated by a person or persons sitting, standing, or kneeling on rather than within the confines of the hull.

Pigtail. An external conductor that originates within an electrical component or appliance installed by the manufacturer.

Polarized System (dc). A system in which the grounded (negative) and ungrounded (positive) conductors are connected identically in relation to all terminals or leads on all devices in the circuit.

Polarized System (ac).* A system in which the grounded (white) and ungrounded conductors are connected identically in relation to all terminals or fixture leads on all devices in the circuit, including the shore power connections.

Propane. See LPG (Liquefied Petroleum Gas).

Readily Accessible. Capable of being reached quickly and safely for effective use under emergency conditions without the aid of tools.

Self-Limiting. A machine with a maximum output restricted to a specified value by its magnetic characteristics.

Shall. Indicates a mandatory requirement.

Sheath. A material, such as overlapping electrical tape, molded rubber, molded plastic, or flexible tubing, used as a continuous protective covering around one or more insulated conductors.

Shore Power Inlet. A reverse service-type fitting designed for mounting on a boat that requires a female connector on the shore power cable in order to make the electrical connection.

Should. Indicates a recommendation or that which is advised but not required.

Standard. A document, the main text of which contains only mandatory provisions using the word "shall" to indicate requirements and which is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions shall be located in an appendix, footnote, or fine-print note and are not to be considered a part of the requirements of a standard.

Transformer, Isolation. A transformer installed in the shore power supply circuit of a boat to isolate electrically all ac system conductors, including the ac grounding conductor (green) on the boat, from the ac system conductors of the shore power supply.

Transformer, Polarization. A transformer ("dry-type" lighting transformer) installed in the shore power supply circuit on the boat to isolate electrically the normally current-carrying ac system conductors, but not the ac grounding conductor (green), from the normally current-carrying conductors of the shore power supply.

Trip-Free Circuit Breaker. A thermally or magnetically, or thermally and magnetically operated overcurrent protection device designed so that the resetting means cannot be pressed in manually to override the current-interrupting mechanism.

Watertight. So constructed that water does not enter the enclosure under test conditions specified in NEMA/ANSI 250, *Enclosures for Electrical Equipment (1000 Volts Maximum).*

Weatherproof.* Constructed or protected so that exposure to the weather does not interfere with successful operation.

Ventilation. The changing of air within a compartment by natural or mechanical means. Ventilation can be achieved by introduction of fresh air to dilute contaminated air or by local exhaust of contaminated air.

Chapter 2 Hull

2-1 General Arrangement.

- **2-1.1** The hull shall be arranged so that all compartments are accessible and all escape hatches are unobstructed and readily accessible.
- **2-1.1.1** Every boat having enclosed accommodation spaces shall have a readily accessible and unobstructed means of egress.
- **2-1.1.2** Every boat having enclosed accommodation spaces shall have a second accessible means of egress if it is possible for one exit to be blocked by a fire in a galley or machinery area.
- **2-1.1.3** The means of egress in 2-1.1.1 and 2-1.1.2 shall provide for minimum clear opening dimensions of $14\frac{1}{2}$ in. \times $18\frac{1}{2}$ in. (36.8 cm \times 47 cm) (rectangular); or 18 in. diameter (45.7 cm) (circular); or 270 in. (1741 cm²) with a minimum dimension of $14\frac{1}{2}$ in. (36.8 cm) (oval).
- **2-1.1.4** Any hatch that is required for egress shall have a means of being operated from the inside and a means of being operated from the outside when not secured from the inside. All hinged hatches shall have a means or method to support the hatch in an open position.
- 2-1.2* Bulkheads or enclosures shall be installed between machinery spaces and accommodation spaces. These bulkheads or enclosures shall be continuous, except for necessary

penetrations, to minimize the escape of fire-extinguishing agents discharged into the machinery space.

2-1.3 Bilges of spaces containing fuel line fittings shall be separated from bilges of accommodation spaces and other enclosed spaces containing sources of ignition by bulkheads that shall not permit more than 0.25 fl oz (7.4 m) of leakage per hour when the liquid in the bilge is at a height of 12 in. (30 cm) or one-third the maximum height of the bulkhead, whichever is less. Above heights of 12 in. (30 cm) or one-third the maximum height, the bulkhead shall be permitted to have openings for the passage of conductors, piping, ventilation ducts, mechanical equipment, doors, hatches, and access panels, provided the maximum annular space around each item is not greater than ½ in. (6.4 mm).

Exception: Boats using diesel fuel only.

- **2-1.4** Machinery spaces shall be readily accessible.
- **2-1.5** Materials used for thermal and acoustical insulation in any compartment or enclosure containing an internal combustion engine or heater shall have a flame spread index of 75 or less. Material shall be labeled or listed as having been tested to meet the requirements of NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*.
- **2-1.6** Materials used for thermal and acoustical insulation shall not disintegrate in the presence of hydrocarbon vapor.
- **2-1.7** Materials used for thermal and acoustical insulation shall be designed and installed such that hydrocarbon vapors cannot accumulate within the material and thereby reduce its flame spread rate.

2-2 Spaces Open to the Atmosphere.

- **2-2.1** Compartments or spaces connecting with engine or portable fuel tank spaces that are open to the atmosphere shall require ventilation if the connecting space has an open area of less than 15 in.²/ft³ (2.8 cm²/m³) of its net volume. The open area shall be open either to the atmosphere or to another open space, provided that, for the combined net volumes of the connecting spaces, there is a total area open to the atmosphere of at least 15 in.²/ft³ (2.8 cm²/m³).
- **2-2.2** Long, narrow spaces formed by side panels or accommodation floors shall have openings at both ends or along the sides if they are to be considered open to the atmosphere.

2-3 Connecting Compartments or Spaces by a Natural Ventilation System.

- **2-3.1** A natural ventilation system shall be provided for each compartment in a boat that includes the following:
- (a) A permanently installed gasoline engine
- (b) Openings between the compartment and a compartment that requires ventilation, where the aggregate of those openings exceeds 2 percent of the area between the compartments, except as provided in 2-3.1(e)(2)
- (c) A permanently installed fuel tank and an electrical component without ignition protection
- (d) A portable fuel tank
- (e) A nonmetallic fuel tank that
 - 1. Has an aggregate permeability rate exceeding 1.2 g (0.04 oz) of fuel loss in 24 hours per cubic foot of net compartment volume.
 - 2. Is located where the net compartment volume is less than 1 ${\rm ft}^3$ (0.0283 ${\rm m}^3$). The nonmetallic fuel tank shall

have a permeability rate not exceeding $1.2~\mathrm{g}$ (0.04 oz) of fuel loss in 24 hours.


Reference fuel "C" at 104°F ± 36°F (40°C ± 2°C) from ASTM D 471, Standard Test Method for Rubber Property-Effect of Liquids, shall be used in determining the permeability rate.

Exception: Compartments open to the atmosphere.

- **2-3.2** Each required supply opening shall be located on the exterior surface of the boat.
- **2-3.3** An accommodation compartment located above a compartment requiring ventilation that is separated from the compartment requiring ventilation by a deck or other enclosure shall not be considered a connecting compartment.

2-4* Natural Ventilation.

- **2-4.1** Each compartment not open to the atmosphere shall be provided with a natural ventilation system when such a compartment includes the following:
- (a) A permanently installed gasoline engine.
- (b)* A portable fuel tank that vents into the compartment. Space under a motor well in outboard boats that is large enough to accommodate a 6-gal (23-L) portable fuel tank but is not intended for such usage shall be labeled to prohibit its use for fuel storage.
- (c) A fuel tank and an electrical component without ignition protection.
- **2-4.2** Each natural ventilation system shall be constructed with at least one intake and one exhaust opening that shall be located on the boat's exterior surface.
- **2-4.3*** Each compartment requiring natural ventilation shall be equipped with an exhaust duct(s) originating in the lower one-third of the compartment, with the duct opening permanently fixed above the normal accumulation of bilge water. If the compartment is an engine compartment, the exhaust duct(s) shall be located as near below the engine(s) as practicable
- **2-4.4** If an exhaust duct is fitted with a cowl or its equivalent, it shall face aft.
- **24.5** Air intake openings inside a compartment shall be separated from exhaust duct openings inside the compartment by at least 24 in. (610 cm), compartment dimensions permitting.
- **2-4.6** The minimum aggregate internal cross-sectional area of intake ducts or openings shall be as shown in Figure 2-4.6.
- **2-4.7** The minimum aggregate internal cross-sectional area of exhaust ducts or openings shall be calculated in the same manner as for intakes. (*See 2-4.6.*)
- 2-4.8 Duct size shall be based on nominal diameters and shall be at least 2.5 in. (64 mm) in diameter. Openings shall be of at least equivalent cross-sectional area. See Table 2-4.8 for standard duct sizes.
- **2-4.9** The minimum cross-sectional area of terminal fittings for flexible ventilation ducts shall not be less than 80 percent of the required internal cross-sectional area of the flexible ventilation duct.

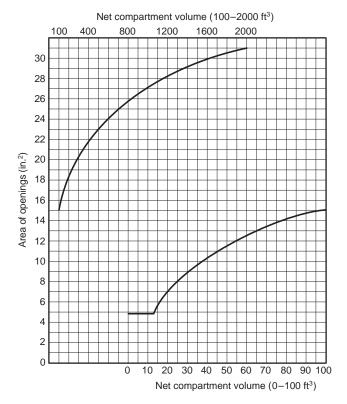

Note: The values in Figure 2-4.6 are based on the following equation: $A = 5 \log_e \left(\frac{V}{5} \right)$

Figure 2-4.6 Area of openings.

Table 2-4.8 Standard Duct Sizes

in. ²	cm ²	in. dia.	cm
4.91	31.7	2½	6.4
7.07	45.6	3	7.6
9.62	62.1	3½	9
12.57	81.1	4	10
19.63	126.6	5	13

2-5 Powered Ventilation System.


2-5.1 Each compartment, not open to the atmosphere, that has a permanently installed gasoline engine with a cranking motor shall be ventilated by an exhaust blower.

2-5.2 Blowers.

2-5.2.1 Blowers shall be rated for continuous operation at 120 percent of nominal voltage.

2-5.2.2* Blowers shall meet the external ignition protection requirements of UL 1128, *Standard for Safety Marine Blowers*, or UL 1500, *Standard for Safety Ignition-Protection Test for Marine Products*.

2-5.2.3 Blowers shall be rated for airflow in cubic feet per minute, at nominal voltage, in accordance with Figure 12 of AMCA/ANSI 210, *Laboratory Methods of Testing Fans for Rating*,

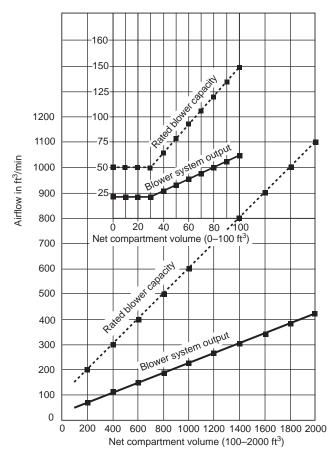

Note: The blower capacity curve is included for informational purposes and represents the average relationship of capacity to performance.

Figure 2-5.2.3 Minimum blower capacity and system performance.

or UL 1128, Standard for Safety Marine Blowers. (See Figure 2-5.2.3.)

2-5.3 Installation of Powered Ventilation.

2-5.3.1 Blower(s) capacity shall be selected in accordance with the blower capacity curve in Figure 2-5.2.3. More than one blower shall be permitted.

2-5.3.2 As installed, the blower system(s) shall exhaust air from the boat at a rate in accordance with the system performance curve in Figure 2-5.2.3 when the engine is not operating and the blower is operating at the electrical system's nominal voltage.

2-5.3.3 Blowers shall be mounted above the normal level of accumulated bilge water.

Exception: Submersible blower motors.

2-5.3.4 Blowers shall be installed with ducts having intake openings that are as follows:

- (a) Permanently secured
- (b) Located in the lower one-third of the compartment
- (c) Located above the normal level of accumulated bilge water

- (d) Located as near below the engine(s) that they serve as practicable
- **2-5.3.5** Electrical wiring shall be installed in accordance with Chapter 7 or Chapter 8.
- **2-5.3.6** Each boat that requires a powered ventilation system shall display a warning label located in plain view of the operator, and shall be located as close as practicable to each ignition switch (including auxiliary equipment). The warning label shall read as follows:

CAUTION

Gasoline Vapors Can Explode

Before Starting Engine:

- 1. Check Engine Compartment for Gasoline or Vapors.
- 2. Operate Blower for 4 Minutes.

2-6 Arrangements of Openings.

- **2-6.1** Ventilation openings shall be located to prevent the entrance of water in amounts that could impair the stability or handling of the vessel or that could cause machinery malfunction under conditions of maximum heel or trim, reverse operation, eccentric loading or wave action, and all operating conditions.
- **2-6.2** External openings of intakes and exhausts shall be located to minimize re-entry of exhausted fumes.
- **2-6.3*** External openings of intakes and exhausts shall be located and oriented to prevent entry of fuel vapors. In no instance shall the location of intake and exhaust ventilation openings be within 15-in. (380-mm) of the fuel fill and fuel vent fittings. The 15 in. (380 mm) separation distance shall be measured from the fuel fill or fuel vent to a ventilation opening in a straight line, or across any intervening surface (s).
- **2-6.4** Ventilation openings shall be unobstructed by side curtains, cockpit enclosures, dodgers, and other weather enclosures.

Chapter 3 Engines

3-1 Exposed Engine Surface Temperatures. Exposed engine surfaces shall not exceed 225°C (437°F) under normal operating conditions. An audible or visual device shall be installed to warn of excessive engine temperature.

Exception: Short branch connections between liquid-cooled exhaust manifolds and cylinder head exhaust ports, or hot spots on intake manifolds.

3-1.1 Gasoline engine fuel pumps of the diaphragm type shall be designed so that fuel shall not be released to the engine space if primary diaphragm failure occurs. Means shall be provided to determine that diaphragm failure has occurred without dismantling the fuel pump.

3-1.2* Marine Carburetors.

- **3-1.2.1** Marine carburetors shall not leak more than 5 cm³ (0.17 fl oz) of fuel in 30 seconds when the float valve is open, the carburetor is at half throttle, and the engine is cranked without having been started or when the fuel pump is delivering the maximum pressure specified by its manufacturer.
- **3-1.2.2** Each updraft and horizontal draft carburetor shall have a device that collects and holds fuel that flows out of the carburetor venturi section toward the air intake, prevents

collected fuel from being carried out of the carburetor assembly by the shock wave of a backfire or by reverse airflow, and returns collected fuel to the engine induction system after the engine starts.

3-1.2.3* Spark ignition engine air intakes shall be fitted with a means of backfire flame control bearing a U.S. Coast Guard approval number, or meeting the requirements of UL 1111, Standard for Safety Marine Carburetor Flame Arresters, or SAE J1928, Devices Providing Backfire Flame Control for Gasoline Engines in Marine Applications.

Exception: In accordance with 46 CFR, Part 58.10-5(b)(3)(ii), an engine-air and fuel induction system, which provides adequate protection from propagation of backfire flame to the atmosphere equivalent to that provided by an acceptable backfire flame arrester. A gasoline engine utilizing an air and fuel induction system, and operated without an approved backfire flame arrester shall either include a reed valve assembly or be installed in accordance with SAE J1928.

3-1.3 Electrical components for engines shall comply with Chapters 7 and 8, as applicable.

3-1.4 Air-Cooled Engines.

- **3-1.4.1** Permanently installed air-cooled engines with self-contained fuel systems shall be located only on open decks or on cabin tops. Any housing over such units shall be open whenever the engine is operating.
- **3-1.4.2** If air-cooled engines are enclosed, the following shall apply:
- (a) Factory installed engine air-cooling shrouding shall be constructed and mounted to trap all engine-cooling air and lead it to a point from which it can be discharged outside the hull or engine box by means of ducting.
- (b) Ducts for engine-cooling air shall have a flame spread index of 75 or less. Material shall be labeled or listed as having been tested to meet the requirements of NFPA 255, Standard Method of Test of Surface Burning Characteristics of Building Materials.
- (c) Engine-cooling air shall not be used as a direct source of cabin heating.
- **3-1.5** Portable gasoline engines with integral fuel tanks or portable gasoline fuel tanks shall be stowed securely in an open or ventilated space in accordance with Sections 2-2 and 7-8 so that fuel or vapors cannot reach interior spaces.
- **3-1.6** Nonpropulsion engines intended for automatic operation shall be equipped with an automatic shutdown device actuated by low oil pressure, excessive engine overheat, and excess heat from exhaust pipe or exhaust gas ducting.
- **3-1.7*** High tension cable assemblies shall conform to SAE J2031, *Standard for High Tension Ignition Cable.*
- **3-1.8*** Ignition distributors shall conform to UL 1500, *Standard for Safety Ignition-Protection Test for Marine Products*.

Chapter 4 Engine Exhaust Systems

4-1 General Requirements.

- **4-1.1** Exhaust systems shall comply with the following:
- (a) Be gastight to hull interiors
- (b) Have all connections accessible

FUEL SYSTEMS 302–11

- (c) Be supported to minimize failure from vibration, shock, expansion, and contraction
- (d) Have no threaded fittings into nonmetallic exhaust system components
- (e) Have no discharge from other devices into the exhaust *Exception: Engine-cooling water.*
- **4-1.2** Wherever personnel or combustibles can come in contact with hot surfaces, effective protection shall be provided by water-jacketing, lagging, or shielding, or by guards or engine enclosures.
- **4-1.3** Hangers, brackets, or other means used to support metallic exhaust systems shall be noncombustible.
- (a) Within 6 ft (1.8 m) of the engine connection(s) for wet exhaust systems
- (b) For the full length of dry exhaust systems
- **4-1.4** A means to indicate loss of exhaust-cooling water shall be provided so that it is effective at all helm positions.

Exception: Outboard engines.

- **4-1.4.1** Auxiliary engines shall be permitted to use an automatic shutdown device in place of an audible or visual device for response to high-exhaust temperature.
- **4-1.5** A separate exhaust system shall be provided for each engine.

4-2 Materials.

4-2.1 Materials used in engine exhaust systems shall be resistant to fuels, heat, water, corrosion, and the products of combustion. Nonmetallic exhaust system components shall meet the requirements of UL 1129, *Standard for Safety Wet Exhaust Components for Marine Engines* or SAE J2006, *Standard on Marine Exhaust Hose*, and shall be so marked.

Exception No. 1: Components furnished as part of an OEM engine assembly.

Exception No. 2: Stern-drive and jet-drive installations that exhaust through the drive system.

- **4-2.2** Copper shall not be used in contact with dry diesel exhaust gases or within six pipe diameters downstream from the point of water entry in water-cooled exhaust systems.
- **4-2.3** As installed, nonmetallic exhaust system components shall retain watertight integrity for 2 minutes after a total loss of cooling water, with the engine operating at full power.
- **4-3 Hose Connections.** Hose connections shall be double clamped.

Exception: Single-clamped hose furnished for specific use as part of an OEM engine assembly.

4-4 Temperature Protection. The exhaust turbine side of nonwater-jacketed turbochargers and unjacketed, single-wall, dry exhaust components shall be installed so that the temperature of adjacent combustible surfaces shall not exceed 200°F (94°C).

Chapter 5 Fuel Systems

5-1 Scope.

5-1.1 The requirements of this chapter shall apply to the design, construction, choice of materials, and installation of permanently installed fuel systems (except compressed gas)

that run from the fuel fill opening to the connections at each engine or at auxiliary equipment.

5-1.2 The requirements of this chapter shall apply to all tanks that are permanently installed. Any tanks with a capacity of more than 7 gal (27 L) shall be permanently installed.

5-2 General Requirements.

- **5-2.1** Fuel systems shall be liquidtight and vaportight with respect to hull interiors. Individual system components and the system as a whole shall be designed and installed to withstand the stresses of and exposure to marine service such as pressure, vibration, shock, movement, grease, lubricating oil, bilge solvents, high aromatic fuels, and corrosive environments.
- **5-2.2** All individual components of the fuel system, as installed in the boat, shall be capable of withstanding a 2½-minute exposure to free-burning fuel without a failure that results in leakage of liquid or vapor.

Exception No. 1: Fuel distribution lines on boats shall not be required to comply with 5-2.2 if a break at any point in the line will cause a discharge of not more than 5.0 fl oz (150 ml) of fuel within 2½ minutes. (See 5-6.2.2.)

Exception No. 2: Self-draining fuel tank vent hose located outside the engine compartment shall not be required to comply with 5-2.2.

- **5-2.3** To ground static electricity, the resistance between ground and each metallic or metallic-plated component of the fuel fill system and fuel tank that is in contact with fuel shall be less than 1 ohm.
- **5-2.4** Pressurized fuel tanks shall not be used.

5-3 Fuel Tank Materials.

- **5-3.1** Gasoline fuel tanks shall not be integral with the hull structure.
- **5-3.1.1** Diesel tanks shall be permitted to be integral with the hull. If cored composite construction is used where the tank is integral with the hull structure, the core material shall not deteriorate from contact with diesel fuel and shall not permit diesel fuel to migrate.
- **5-3.2** Materials for fuel tanks shall be corrosion resistant. Materials meeting the specifications of 5-3.2.1 through 5-3.2.3 and Table 5-3.2 shall be considered as satisfying this corrosion resistance requirement. Any departure from these specifications shall be noted on the label required by 5-4.9.
- **5-3.2.1** Steel tanks used for fuel shall be as follows:
- (a) Galvanized inside and outside by the hot-dip process *Exception: Diesel fuel tanks shall not be galvanized on the inside.*
- (b) Constructed of aluminized steel
- (c) Not constructed of terneplate steel
- **5-3.2.2** Aluminized steel tanks with a wall thickness of less than 0.0785 in. (2 mm) shall be installed only above the cockpit floor or above the deck if no clearly defined cockpit exists.
- **5-3.2.3*** Stainless steel diesel fuel tanks shall have a minimum wall thickness of 0.0747 in. (14 gauge) and shall be supported to avoid crevice and pitting corrosion from entrapment of moisture by welded brackets of like material, or other such support material permanently bonded to the tank surface with impermeable nonhygroscopic adhesive.

Table 5-3.2 Metallic Fuel Tank Material and Fabrication Requirements for Corrosion Resistance

Material ¹	Specification	Minimum Nominal Sheet Thickness	Gauge
Nickel-copper	ASTM B 127, Class A	0.031 in. (0.79 mm)	22 U.S. std.
Copper-nickel	ASTM B 122	0.045 in. (1.14 mm)	17 AWG
Copper	ASTM B 152, Type E.T.P.	0.057 in. (1.45 mm)	15 AWG
Copper-silicon	ASTM B 97, Types A, B and G	0.050 in. (1.27 mm)	16 AWG
Steel sheet	ASTM A 93	0.0747 in. (1.90 mm)	14 Mfrs.
Aluminized steel	ASTM A 463	0.0478 in. (1.21 mm)	18 Mfrs.
Aluminum	Alloy 5052, 5083, or 5086	0.090 in. (2.29 mm)	
Stainless steel	316L or 317L	0.0747 in. (1.9 mm) 0.031 in. (0.79 mm) ²	14 Mfrs. 22 U.S. std. (2)

Note: For SI Units, 1 in. = 2.5 cm.

Exception: Stainless steel fuel tanks of less than 20 gal (76 L) capacity of cylindrical construction with domed heads shall only require a wall thickness of 0.031 in. (22 gauge).

5-3.3 Nonmetallic materials meeting the applicable requirements of Chapter 5 shall be permitted to be used for tanks, provided the aggregate permeability rate of such tanks does not exceed 0.04 oz/m^3 (1.2 g/ft³) in 24 hours of fuel loss of net compartment volume, or if the compartment volume is less than 1 ft³ (0.03 m³), the permeability rate does not exceed 0.04 oz (1.2 g) of fuel loss in 24 hours. (*See 5-5.4.*)

5-4 Fuel Tank Design and Construction.

5-4.1 Fuel tanks shall conform to the following:

- (a) No openings shall be in the bottom, sides, or ends.
- (b) Openings for fill, vent, and feed pipes and level gauges (if installed) shall be at or above the topmost surface of tanks.
- (c) Clean-out plates shall not be installed.
- (d) Plates used for fittings shall be secured in such a manner that they cannot be used for clean-out purposes.

Exception: Diesel fuel tanks shall not be required to comply with 5-4.1.

5-4.2 Tanks shall be constructed so that, when installed, exterior surfaces shall not trap water.

5-4.3 Threaded fittings shall conform to Table 5-4.3.

Table 5-4.3 Minimum Thread Engagement

Thread Engagement in.	Minimum Length of IPS in.				
1/4	3/8				
3/8	3/8				
1/2	1/2				
3/4	9/16				
1	5/8				
11/4	5/8				
1½	5/8				
2	¹¹ ⁄ ₁₆				

Note: For SI units, 1 in. = 2.5 cm.

- **5-4.4** Fuel tanks with a capacity of 25 gal (95 L) or greater shall not leak when subjected to the pressure impulse test requirement of Title 33, *Code of Federal Regulations*, Subpart 183.586.
- **5-4.5** Fuel tanks with a capacity of less than 25 gal (95 L) shall not leak when subjected to the shock test requirement of Title 33, *Code of Federal Regulations*, Subpart 183.584.
- **5-4.6** Fuel tanks with a capacity of 200 gal (760 L) or more shall not leak when subjected to the slosh test requirement of Title 33, *Code of Federal Regulations*, Subpart 183.588.
- **5-4.7** All metal tanks and the metal fitting plates of nonmetallic fuel tanks shall be provided with a bonding terminal suitable for the attachment of a No. 8 AWG bonding conductor.
- **5-4.8** Indentations for labeling or other identification shall not weaken the fuel tank.
- **5-4.9** Fuel tanks shall be marked or identified permanently with the following information in a location that is visible and readable for inspection after installation:
- (a) Manufacturer's name or logo and address
- (b) Month (or lot or serial number) and year of manufacture
- (c) Capacity in U.S. gallons (capacity also shall be permitted to be expressed in liters)
- (d) Construction material and thickness
- (e) Fuel for which tank is intended
- (f) Maximum test pressure
- (g) Model number, if applicable
- (h) Statement that reads: "This tank has been tested under Title 33, Code of Federal Regulations, Subpart 183.510(a)."

Exception: Diesel fuel tanks.

- (i) Statement that reads: "Must be installed aft of the half-length of the boat," if the tank has been tested under Title 33, Code of Federal Regulations, Subpart 183.584, at less than 25 G vertical accelerations
- **5-4.10** Fuel tank(s) shall be tested by the manufacturer or builder for fuel tightness at 3.0 psi (21 kPa gauge) or 1.5 times the maximum static head to which the tank(s) can be subjected during service as specified by the boat manufacturer, whichever is greater.

¹See American Welding Society recommendations for welding processes.

²Only cylindrical stainless steel tanks with domed heads and a capacity of less than 20 gal (76 L) are permitted.

FUEL SYSTEMS 302–13

- **5-4.11** Because the tank can flex in service, the design of the pickup tube shall preclude damage to the tank bottom.
- **5-4.12** The use of gauge glasses shall be restricted to day or service tanks of diesel fuel systems.

5-5 Fuel Tank Installation.

- **5-5.1** Fuel tank connections and fittings shall be accessible.
- **5-5.2** The tank(s) shall be installed in such a manner that means for maintenance or replacement is provided or indicated so that it can be accomplished without compromising the structural integrity of the vessel.

Exception: Integral diesel tanks.

- **5-5.3** Fuel tanks shall be installed and secured to prevent permanent deformation and to provide immobilization to the extent practicable.
- **5-5.4** Nonmetallic fuel tanks that expand dimensionally after exposure to fuel shall comply with the following:
- (a) Be installed in accordance with the fuel tank manufacturer's instructions and shall indicate clearly in diagram form the clearances required
- (b) Be provided with a warning that includes the following information:

CAUTION

To prevent hull and tank damage due to expansion of the tank while in service, installation shall be in accordance with the manufacturer's instructions.

- **5-5.5** In order to permit free circulation of air, contact between metallic fuel tanks and other structures shall be limited to necessary structural supports.
- **5-5.6** All abrasive or absorbent surfaces of tank supports and braces shall be insulated effectively from contact with tank surfaces by a nonabrasive and nonabsorbent material.
- **5-5.7** Aluminized steel tanks of thicknesses less than 0.0785 in. (2 mm) shall be installed above the cockpit deck or above deck if there is no clearly defined cockpit.
- **5-5.8** Nonferrous and nonmetallic fuel tanks shall be permitted to be foamed in place if they comply with the requirements of Title 33, *Code of Federal Regulations*, Subpart 183.516. (*See* 5-5.4.)
- **5-5.9** Fuel tanks shall not be installed above the engine or other sources of ignition.

5-6 Fuel Lines, Fittings, and Related Accessories.

5-6.1 For the purposes of this section, fuel lines shall mean all pipes, tubing, or hose that conduct fuel from the deck fill plate to the engine connection. Related accessories shall include any attachments to fuel lines such as valves, filters, strainers, pumps, and connecting fittings.

5-6.2 General Requirements.

- **5-6.2.1** All fuel tank fittings shall be galvanically compatible with the fuel tank material. Copper-bearing fittings shall be isolated from aluminum tanks by a galvanic barrier, including but not limited to a 300 series stainless steel fitting.
- **5-6.2.2** Flexible nonmetallic fuel hose shall be USCG Type A-1 or A-2 hose where 2½-minutes minimum fire resistance is required or shall be USCG Types A-1, A-2, B-1, or B-2 hose where 2½-minutes minimum fire resistance is not required. (*See 5-2.2.*)

5-6.2.3 Fuel lines, connections, and accessories shall be accessible.

- **5-6.2.4*** Plastic pipe and fittings shall not be used in fuel distribution lines, vent lines, and fill lines. (*See 5-2.2.*)
- Exception No. 1: Components of deck fill fittings, vent fillings, carburetor fittings, fuel pump fittings, and fuel filter fittings.

Exception No. 2: Engineering grade plastics such as glass-reinforced nylons.

- **5-6.2.5** Fuel lines shall be secured as follows.
- **5-6.2.5.1** Fuel lines shall be secured against movement or vibration by the use of noncombustible clips or straps without rough surfaces or sharp edges.
- **5-6.2.5.2** Clips and straps used to hold fuel lines in position to maintain anti-siphon protection shall be capable of withstanding a 2-½-minute fire test.
- **5-6.2.6** Where making up threaded pipe connections, a gasoline-resistant sealing compound or tape shall be used.
- **5-6.2.7** Where making flared tubing connections, tubing shall be cut squarely and flared by tools designed for that purpose. Tubing shall be deburred, and copper tubing shall be annealed prior to being flared.
- **5-6.2.8** Outlets for drawing fuel from the system are prohibited.

Exception: Filter bowl plugs provided for the purpose of servicing only.

5-6.2.9 Manually operated multiposition valves shall be required to indicate only their open and closed positions. Manually operated stop valves shall be designed with positive stops in the open and closed positions.

5-6.3 Installation of Fill and Vent Pipes.

- **5-6.3.1** Fuel tank fill and vent pipes shall be located to prevent the escape of liquid and vapor overflow to the inside of the hull and to provide protection from the flow of vapors escaping into the hull.
- **5-6.3.2** No liquid fuel shall enter the boat from the fill due to an overflow rate of 5 gpm (19 L/min) for 5 seconds when the boat is in its static floating position.
- **5-6.3.3*** The vent pipe shall terminate as remotely as practicable from any hull opening and shall be installed to minimize the intake of water without resisting the release of vapor. Overflow from the vent at a rate of 2 gpm (7.7 L/min) shall not enter the boat.
- **5-6.3.4** The minimum inside diameter of the fill pipe system shall be $1\frac{1}{4}$ in. (3.2 cm) [a minimum hose diameter of $1\frac{1}{2}$ in. (3.8 cm)].
- **5-6.3.5** The fill pipe shall run as directly as possible, preferably in a straight line, from the deck plate or other closable plate to the tank top spud.
- **5-6.3.6** The fuel fill shall be identified by a permanent marking indicating the type of fuel.
- **5-6.3.7** If a nonmetallic hose is used in the fill pipe system, it shall be secured tightly with a minimum of two corrosion-resistant metal clamps of $\frac{1}{2}$ in. (12.7 mm) minimum width at each end of the hose. Clamps depending solely on spring tension shall not be used.
- **5-6.3.8*** Bonding wire ends shall not be clamped between the fill pipes and the flexible tubing.

- **5-6.3.9** There shall be no blow-back of fuel through the fill fitting while filling at a rate of 9 gpm (35 L/min) and to a level of one-quarter to three-quarters of the capacity indicated by the tank label.
- **5-6.3.10** The vent pipe connection shall be at the highest point of the tank, when installed in the boat, under conditions of normal trim.
- **5-6.3.11** The minimum inside diameter of any component of the vent line system shall be not less than $\frac{7}{16}$ in. (11 mm).
- **5-6.3.12** The fittings at the hull vent line opening shall be corrosion resistant. Each fuel tank vent system shall have a flame arrester that can be cleaned, unless the vent system itself is a flame arrester.

Exception: If metallic vent lines are used and serve as effective flame arresters, the hull vent fitting shall not be required to be a flame arrester.

5-6.4* Installation of Fuel Feed Lines and Accessories.

5-6.4.1* Electric fuel supply pumps shall operate only when the engine is operating, when the cranking motor is energized, or when they are operated by a momentary switch for priming and shall be located either on or within 12 in. (30 cm) of the engine. Hose installed on the pressure side of the fuel pump shall be USCG Type A-1.

Exception: Priming pumps in outboard motor fuel systems.

- **5-6.4.2** Fuel lines shall be run with as few connections as practicable. Fuel lines that run over dry sections of the engine exhaust system shall be metallic and shall contain no joints, fittings, or components other than at the point of termination.
- **5-6.4.3*** Gasoline fuel distribution systems shall be provided with anti-siphon protection by at least one of the following:
- (a) Keeping all parts of fuel distribution and return lines above the level of the tank top from the tank to the carburetor inlet or its equivalent (e.g., throttle body, port fuel injection), or to a location where fuel leakage cannot enter the boat when it is in a static floating position.
- (b) Installing an anti-siphon device at the tank withdrawal fitting, or along the line, with a rated siphon protection head and flow rate greater than required for the installation.
- (c) Installing an electrically operated valve at the tank fitting, or along the line, to be energized open only when the engine ignition switch is on and the engine is running. A momentary type override shall be permitted to be used for starting.
- (d) Installing a manual shutoff valve directly at the fuel tank connection, arranged to be readily accessible for operation from outside the compartment if the fuel tank top is located below the level of the carburetor inlet and the fuel line is rigid metal or USCG Type A-1 hose. If the length of fuel line from the tank outlet to the engine inlet is greater than 12 ft (3.6 m), a second manual shutoff valve shall be installed at the fuel inlet connection to the engine.
- **5-6.4.4*** A readily accessible manual shutoff valve shall be installed on all fuel tanks directly at the tank connection, except on those fuel systems provided with anti-siphon protection. If the fuel tank(s) is located in machinery space(s), a remotely operated means of closing the valve(s) without opening machinery spaces shall be provided.
- **5-6.4.5** That part of the fuel feed line secured to the hull members shall be separated from that part secured to the

engine by a flexible section meeting the requirements of 5-6.9.9

5-6.4.6 The fixed fuel line shall be fastened to structures within 4 in. (10 cm) of the connection to the flexible section to secure against vibration and movement.

Chapter 6 Cooking, Heating, and Auxiliary Appliances

6-1* General.

- **6-1.1** Printed instructions for proper installation, operation (including refueling, where applicable), and maintenance shall be provided with each appliance. The instructions shall include information on the hazards associated with appliance air consumption and installer information regarding the proper display of a warning label.
- **6-1.2** Appliances using gasoline in liquid or solid form for priming or fuel shall be prohibited.
- **6-1.3*** The design and installation of appliances shall consider the air consumption of the appliances and the venting of exhaust products.
- **6-1.4** An appliance shall be mounted in accordance with the manufacturer's instructions and shall be fastened securely when in use or stored.
- **6-1.5** A burner system shall be capable of operation without creating a fire hazard during periods of boat pitch and roll at angles up to 30 degrees from horizontal in any direction sustained for 15 seconds and shall be capable of continuous operation at angles of heel up to 30 degrees.
- **6-1.6** A durable and permanently legible sign mounted to be readily visible and detailing the proper operation and any unique hazards of the appliance shall be provided.
- **6-1.7** Operating controls shall be located to be easily accessible and to reduce the likelihood of injury from burners or elements while in use.
- **6-1.8** Appliances with automatic igniter glow plugs or continuously lighted pilot lights for burner ignition shall be prohibited

Exception No. 1: Automatic igniter glow plugs in appliances using sealed combustion chambers.

Exception No. 2: An oven control flame that operates only when the stove is in use.

- **6-1.9** Appliances shall be marked or identified permanently with the following information in a location visible after installation:
- (a) Manufacturer's name or trademark
- (b) Model number
- (c) Serial number, if applicable
- (d) Fuel/energy used
- (e) Maximum power consumption in kW when operating at capacity

6-2 Cooking Appliances Installation.

6-2.1 Exposed materials and finishes within 24 in. (61 cm) of heat-generating surfaces of appliances shall have a flame spread index of not more than 75 as determined in accordance with NFPA 255, Standard Method of Test of Surface Burning Characteristics of Building Materials.

- **6-2.2** Fabrics located above and within 39 in. (1 m) of a galley stove top, used for decorative or other purposes, shall be flame resistant in accordance with NFPA 701, *Standard Methods of Fire Tests for Flame-Resistant Textiles and Films*.
- **6-2.3** With the appliance installed, the temperature of vertical combustible surfaces below and surrounding heat-generating surfaces shall not rise more than 150°F (65°C) above the compartment's ambient temperature when using the temperature test of UL 858, *Standard for Safety Household Electric Ranges*, Section 53.

6-3 Coal, Charcoal, and Wood Burning Appliances.

- **6-3.1** Solid-fuel burning appliances shall not be installed in gasoline-powered boats.
- **6-3.2** Coal, charcoal, and wood burning stoves shall be either mounted on a noncombustible base (preferably hollow tile) or mounted on legs providing a clearance of at least 5 in. (13 cm) between the stove bottom and the deck, and the deck shall be insulated with a noncombustible material or sheathing. The sides and backs of uninsulated stoves shall have a minimum clearance of 9 in. (23 cm) from the exposed materials and finishes, which shall meet the requirements of 6-2.1 or shall be separated by fire-resistant thermal insulation. The sides and backs of insulated stoves shall have a minimum clearance as specified by the manufacturer.
- **6-3.3** Single-wall smoke pipes and stacks shall have a minimum clearance of 9 in. (23 cm) from combustible materials, including painted surfaces, or shall be separated by fire-resistant thermal insulation. Listed and labeled double- or triple-wall smoke stacks shall be installed with a minimum clearance specified by the manufacturer.

Exception: At decks equipped with water irons.

- **6-3.4** Permanently installed solid-fuel burning appliances shall be equipped with a double- or triple-wall smoke pipe or stack that shall terminate above deck, with smoke heads designed to minimize water entry, spark emission, and backdraft.
- Exception No. 1: Solidified alcohol galley stoves.

Exception No. 2: Exterior mounted grilles.

- **6-3.4.1** Double- or triple-wall smoke stacks meeting the requirements of UL 103, *Standard for Safety Factory-Built Chimneys for Residential Type and Building Heating Appliances*, shall be installed in accordance with the specifications of the manufacturer.
- **6-3.5** To prevent spontaneous combustion, charcoal shall be kept dry and stored in a closed, dry metal container.

6-4 Liquid Fuel Appliances [Does not include LPG (Liquefied Petroleum Gas)].

- **6-4.1** Both pressure and gravity-fed burners shall be permitted.
- **6-4.2** Fuel supply tanks shall be constructed of corrosion-resistant metal or of metal having a corrosion-resistant finish or coating.
- **6-4.2.1** Pressurized liquid fuel tanks that are integral with an appliance shall withstand an internal pressure of four times the relief valve setting or 200 psi (1400 kPa gauge), whichever is greater. The tanks shall be shielded or insulated so that, under continuous operation at maximum heat, the pressure in the tank shall not exceed 50 percent of the relief valve

- setting. The complete system shall be tested up to the pressure of the relief valve setting.
- **6-4.2.2** Pressure tanks for remote installation shall be able to withstand a test pressure of at least 100 psi (700 kPa gauge) or twice the appliance relief valve setting, whichever is greater. The tanks shall be secured rigidly in an accessible location, allowing convenient filling and pump operation.
- **6-4.2.3** Gravity tanks installed in the compartment with the appliance shall be located or shielded so that, when installed and under continuous operation at maximum heat output, the fuel temperature shall not rise more than 25°F (-4°C) above the compartment temperature.
- **6-4.2.4** No gravity tank shall have a capacity exceeding 2.1 gal (8 L). Tanks of larger capacity shall meet the requirements of Section 5-3 and shall be capable of withstanding a pressure of 3 psi (21 kPa gauge).
- **6-4.2.5** Nonintegral gravity tanks shall have provisions for filling and venting at a distance of at least 39 in. (1 m) from open flame unless separated by a vaportight partition or bulkhead.
- **6-4.2.6** A readily accessible shutoff valve, not integral with the appliance, shall be located near liquid fuel gravity tanks and at or on all remote-pressure fuel supply tanks. The valve shall close against fuel flow and shall clearly indicate the closed and open positions.
- **6-4.2.7** Liquid fuel supply lines from remote tanks shall be installed as a continuous run from the shutoff valve at the tank to the appliance or to the flexible section located immediately before a gimbaled stove.

Flexible liquid fuel supply hose sections shall be compatible with the fuel used.

- **6-4.2.8*** The fill openings for remote fuel tanks shall be identified to indicate the type of fuel to be used with the system. The word "fuel" shall not be used alone.
- **6-4.2.9** In diesel fuel or other liquid-fuel burning appliances having remote gravity tanks, provisions shall be made to relieve any excess pressure in the fuel line between the tank shutoff valve and the burner valve.
- **6-4.2.10** Liquid-fuel priming pans or troughs shall be secured to the burner or generator so that their mutual function is maintained.
- **6-4.2.11** A liquidtight, nonflammable drip pan at least ¾ in. (19 mm) deep shall be provided below all burners and shall be readily accessible for cleaning.
- **6-4.2.12** Appliances with integral tanks supplying fuel by gravity or pressure shall display a permanently affixed, legible warning sign that provides the following minimum information and instruction:

CAUTION

Fire and explosion hazard; severe burns. Before filling, turn off burners.

- **6-4.2.13** Pressurized fuel tanks shall be equipped with relief valves.
- **6-4.2.14** Unpressurized stoves with fuel held in absorbent matter designed with a fuel container removed for filling shall display a permanently affixed, legible sign that provides the following minimum information and instruction:

CAUTION

Fire and explosion hazard; severe burns. Before filling, turn off all stove burners. Remove fuel container from stove. Fill fuel container away from stove. Follow filling instructions provided.

- **6-4.3** If solidified alcohol is used as stove fuel, the container shall be secured on a fixed base to prevent sliding or overturning due to a sudden roll of the vessel.
- **6-4.4** Stacks and stoves shall comply with the applicable requirements of Section 6-3.
- **6-4.5** Sealed combustion chamber heaters that burn fuel oil shall be permitted to be used if they are designed to provide complete separation of the combustion system from the atmosphere in the boat. A combustion air inlet and flue gas outlet shall be provided as integral parts of the appliance.
- **6-4.6** Stove operating controls shall be located to be easily accessible and to minimize possible injury from burners or elements while in use. The operation of controls shall not require reaching over or across burners or heated elements.
- **6-4.7** Means shall be provided on stove top cooking surfaces to prevent both deep and shallow cooking utensils from sliding across or off the stove.
- **6-4.8** Oven doors shall be provided with a means to prevent their unintentional opening due to the force of sliding food and utensils.
- **6-4.9** A permanent, legible sign shall be affixed in a conspicuous location on or adjacent to fuel burning stoves or ranges and shall provide the following information and instruction:

CAUTION

Open-flame cooking appliances consume oxygen. Lack of oxygen can cause asphyxiation or death. Maintain open ventilation when appliance is in use. Do not use appliances for comfort heating.

- 6-5* Liquefied Petroleum Gas (LPG) and Compressed Natural Gas (CNG) Systems for Permanently Installed Appliances.
- **6-5.1** The installation for use and storage of stoves with attached (integral) LPG containers of more than 8 oz (230 g) capacity weight of gas shall be prohibited in accommodation spaces in the boat interior.
- **6-5.2** LPG and CNG appliances shall be permanently installed.

Exception: Those appliances employing integral butane cylinders containing no more than 8 oz (230 g) of fuel complying with 6-5.11.7.

- **6-5.3** All components of LPG systems subject to cylinder pressure shall have a rated working pressure of at least 250 psi (1725 kPa gauge); components of CNG systems subject to cylinder pressure shall have a working pressure of at least 133 percent of the maximum fill pressure of the cylinder.
- **6-5.4* Ignition Protection of Electrical Devices.** On boats equipped with LPG or CNG systems, potential sources of ignition of an electrical nature that can function or cycle on and off automatically without the presence of a person, located below the main deck, shall be provided with ignition protection in accordance with UL 1500, *Standard for Safety Ignition-Protection Test for Marine Products*, if located in compartments

containing LPG or CNG appliances, cylinders, fittings, valves, or regulators.

Exception No. 1: Accommodation spaces.

Exception No. 2: Open compartments having at least 15 in.² (97 cm²) of open area per cubic foot of net compartment volume exposed to the open atmosphere outside the craft.

- **6-5.5** Only systems using cylinders of the vapor withdrawal type shall be permitted. Cylinders designed or installed to admit LPG into any other part of the system shall be prohibited.
- **6-5.6** With each LPG or CNG system installed on a boat, at least two signs required by 6-1.1 and 6-1.6 shall be provided. These signs shall include the following:
- (a) The signal word "WARNING."
- (b) The introductory statement "To Avoid Fire and Explosion."
- **6-5.6.1** These signs shall also provide information in accordance with the following sample wording and shall include:
- (a) An applicable statement: "This system is designed for use with (insert LPG or CNG) only. Do not connect (insert CNG or LPG) to this system."

Exception: This statement shall not be required on the sign at the container.

- (b) The following instructions:
- Close container valves when boat is unattended and in case of leak or fire.
- 2. Close all appliance valves before opening container valves.
- Always apply the source of ignition to burner before opening burner valve.
- 4. Test system for leakage whenever system is used, when system is serviced, or when container is changed as follows:
 - (a) With the appliance valves closed and all other valves open, note pressure on the gauge.
 - (b) Close container valve.
 - (c) Ensure pressure remains constant for at least 5 minutes.
 - (d) If pressure drops, locate the leakage by application of soapy water solution at all connections.
 - (e) Repeat test for each container in multicontainer systems
 - (f) Never use flame to check for leaks. Never use soap containing ammonia.

If a leak detection device is installed, these instructions shall be permitted to be modified as appropriate.

- 5. Mark container locker "For storage of (insert LPG or CNG) containers only."
- Keep valves closed and plugged on empty or unconnected containers.

Exception: This statement shall not be required on the sign at the appliance.

6-5.6.2 On boats that have gasoline engines, the sign shall also provide the following minimum information and instruction:

CAUTION

Avoid fire or explosion. Open-flame appliances can ignite gasoline vapor, causing fire or explosion.

Turn off all open-flame appliances while fueling.

6-5.6.3 The required warning signs shall be installed in plainly visible locations on the outside of each container enclosure and adjacent to each consuming appliance.

6-5.7 Containers.

- **6-5.7.1** Containers shall be constructed, tested, marked, maintained, requalified for continued service, and refilled in accordance with the following:
- (a) U.S. Department of Transportation (DOT) regulations for containers in LPG or CNG service
- (b) Equivalent specifications or regulations determined by the authority having jurisdiction
- **6-5.7.2** Containers shall be withdrawn from service when they leak, when corrosion, denting, bulging, or other evidence of rough usage exists to the extent that the container has been weakened, or when exposed to fire.

6-5.8 Container Valves and Safety Relief Devices.

6-5.8.1 Each container shall have a manually operated shutoff valve installed directly into the container outlet opening that can be operated without the use of tools.

Exception: Nonrefillable containers.

- **6-5.8.2** In addition to the valve required by 6-5.8.1, a readily accessible manual or electrically operated (solenoid) shutoff valve shall be located in the low- or high-pressure line at the fuel supply. The valve or its control shall be operable from within the vicinity of the appliance(s). If the cylinder valve is readily accessible from within the vicinity of the appliance, the shutoff valve on the supply line shall not be required. The location of the shutoff valve or control shall not require reaching across flame- or heat-generating surfaces for operation.
- **6-5.8.3** All containers shall be provided with safety relief devices as required by DOT regulations or equivalent regulations.
- **6-5.8.4** LPG container valves and safety relief devices shall have direct connection with the vapor space of the cylinder.
- **6-5.8.5** In addition to the valve required at the cylinder, a multiple cylinder system shall be provided with a manual positive shutoff valve or automatic check valve at the cylinder manifold such that each cylinder shall be isolated from the pressure feedback from other cylinders.
- **6-5.8.6** All relief valves shall discharge to the open atmosphere at a point at least 2 ft (0.6 m) from any opening to a cabin or hull interior or from an engine exhaust terminus.
- **6-5.8.7** Valve outlets on containers shall be equipped with a plug or cap for thread protection and to keep out foreign material. This plug or cap shall be in place whenever the container is not connected for use, and the valve shall be kept tightly closed.

6-5.9 Reducing Regulators.

6-5.9.1 Each system shall be provided with a pressure-regulating device, specifically designed for the type of gas being used and so adjusted as to deliver gas to the distribution piping at a pressure not to exceed 14 in. (36 cm) water column, approximately 0.735 psi (5.0 kPa gauge) for LPG systems, or 6 in. (15 cm) water column, approximately 0.22 psi (1.5 kPa gauge) for CNG systems.

- **6-5.9.2** A low-pressure relief valve shall be integral with each regulator. It shall discharge at between 1.7 and 3 times the delivery pressure of the regulator.
- **6-5.9.3** The relief valve vent outlet shall be located and designed to prevent water from entering the discharge system.
- **6-5.9.4*** Each reducing regulator shall be fitted with a pressure gauge on the high-pressure side. A leak detector shall be permitted to be used in addition to the gauge.
- **6-5.9.5** Each CNG system shall be supplied with a high-flow check valve located on the container pressure side of the regulating device. The high-flow check valve shall actuate and control gas flow through the vent or vent systems to the atmosphere in the event of regulator malfunction and shall maintain this gas flow within designed pressure limits of the vent system. Relief high-flow restrictor vent outlets shall conform to the requirements of 6-5.8.6.
- **6-5.9.6** CNG pressure regulators shall be connected directly to the cylinder shutoff valve, using one CGA series 350 connection.

6-5.10 Piping, Hose, and Fittings—LPG and CNG Distribution Systems.

- **6-5.10.1 Piping.** Low-pressure distribution piping between the regulator and appliances shall be galvanically compatible for a marine environment and shall be as specified below:
- (a) In LPG systems, piping shall be either copper tubing of standard Type K or Type L, or equivalent, with a minimum wall thickness of at least 0.032 in. (0.8 mm) nominal.
- (b) In CNG systems, piping shall be of internally tinned copper tubing of standard Type K or Type L, or equivalent, with a minimum wall thickness of at least 0.032 in. (0.8 mm) nominal.

6-5.10.2 Flexible Hose.

- **6-5.10.2.1 Hose Specifications.** Hose specifications shall comply with the following:
- (a) LPG flexible distribution hose shall meet the requirements of UL 21, Standard for Safety LP-Gas Hose.
- (b) CNG flexible hose shall meet the requirements of NFPA 52, Compressed Natural Gas (CNG) Vehicular Fuel Systems.
- **6-5.10.2.2** In both LPG and CNG systems, flexible hose shall be labeled for the fuel being used.
- **6-5.10.3** Connecting fittings shall be accessible. Metallic connections, if soldered, shall be soldered or brazed with a material having a melting point exceeding 840°F (450°C).
- **6-5.10.4** Distribution lines shall be protected from physical damage and shall be accessible for inspection.
- **6-5.10.4.1** Lines shall be secured against vibration.
- **6-5.10.4.2** Lines shall be protected from abrasion wherever they pass through decks or bulkheads.
- **6-5.10.4.3** Each appliance shall be served by a separate low-pressure regulated supply line, which shall originate inside the locker or protective enclosure.
- **6-5.10.4.4** Flexible supply hose shall have permanently attached end fittings, such as a swaged sleeve or a sleeve and threaded insert.
- **6-5.10.5** Metal tube or piping shall be connected by means of flare fittings or other fittings designed for resistance to

loosening due to vibration or movement. Metal-to-metal compression sleeve-type fittings shall not be used.

- **6-5.10.6** Flexible hose sections connecting appliances to their supply shall be nonmetallic. Flexible metallic connectors shall not be used.
- **6-5.10.7** A flexible hose section shall be installed to allow the free swing of gimbaled stoves without stress to end fittings at expected extremes of travel.
- **6-5.10.8** Fuel supply lines shall be continuous lengths of tubing, piping, or hose from the regulating device, solenoid valve or leak detector (if installed), or manifold to the appliance.

Exception: Flexible hose installed to connect tube or piping to a device.

6-5.10.9 Metallic fuel supply lines shall not be used for electrical grounding or bonding.

6-5.11 Appliances.

6-5.11.1 Appliances with automatic igniters for burner ignition are prohibited.

Exception: Appliances with sealed combustion chambers.

6-5.11.2 All gas-fueled appliances shall incorporate a flame failure device on each burner or oven control flame to prevent gas flow if flame is not present.

Exception: Stoves with integral gas cylinders not exceeding 8 oz (230 g) capacity.

- **6-5.11.3** Cabin space heaters, water heaters, gas-fueled refrigerators, and air conditioners shall be of the sealed combustion chamber type, designed to provide complete separation of the combustion system from the atmosphere in the boat. A combustion air inlet and flue gas outlet shall be provided as integral parts of the appliance.
- **6-5.11.4** Burner controls shall be equipped or designed to provide a push-turn or other two-phase operation when moved from the "off" position to the "on" position.
- **6-5.11.5** Cooking appliances shall meet the combustion requirements of ANSI Z21.57, *Recreational Vehicle Cooking Gas Appliances*.
- **6-5.11.6** A permanent, legible sign shall be affixed in a conspicuous location on or adjacent to appliances not having sealed combustion chambers that shall include the following information and instruction:

CAUTION

Open-flame appliances consume oxygen. Lack of oxygen can cause asphyxiation or death. Maintain open ventilation when appliance is in use.

- **6-5.11.7** Means shall be provided on stove top cooking surfaces to prevent both deep and shallow cooking utensils from sliding across or off the stove at boat pitch or roll up to 30 degrees horizontal in any direction.
- 6-5.11.8 Cooking Equipment with Integral Fuel Cylinders.
- **6-5.11.8.1** Printed instructions for proper installation, operation, fuel storage, refueling, and maintenance shall be provided with each stove.
- **6-5.11.8.2** Fuel cylinders with 8 oz (230 g) maximum capacity shall be DOT approved 2P/2Q cylinders with rim vent release.
- **6-5.11.8.3** Where used in the boat interior, stoves shall be secured in a designated location with a positive means of

mechanical retention. The installation shall meet the requirements of Section 6-2.

- **6-5.11.8.4** A means shall be provided for storing all unattached fuel cylinders in a protected, self-draining location on the exterior of the boat where vapors can flow overboard only.
- **6-5.11.8.5** The appliance shall have a label to indicate the location of the device relative to all combustible surfaces, meeting the requirements of Section 6-2. The label shall identify the type of fuel to be used with the appliance.

6-5.12 Location and Installation.

6-5.12.1 LPG and CNG containers, regulating devices, and safety equipment shall be as follows:

- (a) Rigidly secured
- (b) Readily accessible for operation of valves and testing for leakage
- (c) Protected by a dedicated locker

Exception No. 1: Containers located on open decks such that escaping vapor cannot accumulate in a cockpit or enclosed spaces, provided regulators, tank valves, and fittings are protected against mechanical damage by a vented housing, shield, or guard.

Exception No. 2: CNG systems where a single container of a capacity not greater than 100 ft^3 (2.8 m^3) at 14.5 psi (1 bar) and 70°F (21°C) is connected to the system. CNG containers of a capacity greater than 100 ft^3 (2.8 m^3) shall be installed in accordance with the same requirements as LPG containers.

6-5.12.1.1 A protective dedicated locker shall be as follows:

- (a) Located above the waterline
- (b) Vaportight to the hull interior
- (c) Provided with a means to latch its cover
- (d) Vented to the atmosphere
- (e) Located so that, with its cover open or closed, escaping vapor cannot reach the bilges, machinery spaces, accommodations, or other enclosed spaces
- **6-5.12.1.2** Venting of LPG container lockers shall be from the bottom by means of a vent pipe of at least ½ in. (13 mm) internal diameter that shall lead outboard, without pockets that can trap water, passing through the hull above the waterline at a point lower than the locker bottom, that is at least 2 ft (0.6 m) distant from, and not directly above, any hull opening, including the engine exhaust.
- **6-5.12.1.3** Compartments and lockers in which CNG cylinders are stored shall have a ventilation opening located above the level of the cylinder of at least $\frac{1}{2}$ in. (13 mm) internal diameter.
- **6-5.12.2** Installation of gas equipment in lockers or housing shall be such that, when the means of access to the lockers or housing is open, the container valves can be conveniently and quickly operated and the system pressure gauge dials are fully visible.
- **6-5.12.3** Lockers or housings shall not be used for storage of any other equipment, nor shall quick access to the gas system be obstructed in any way.
- **6-5.12.4** Provisions for storage of unconnected reserve containers, filled or empty, shall be the same as those for containers in use.
- **6-5.12.5*** After installation, distribution tubing shall be tested prior to its connection to the regulator and appliance

using an air pressure of not less than 5 psi (34.5 kPa gauge) above ambient. The container valve shall be tested for leakage at its outlet and at its connection to the container by application of a soapy water solution prior to connection of the system. After these tests and when appliances and high-pressure equipment have been connected, the entire system shall be subjected to the following test:

- (a) With appliance valves closed, solenoid valve or master shutoff valve at the appliance open, and one container valve open, note the pressure on the gauge.
 - (b) Close the container valve.
 - (c) Ensure pressure remains constant for at least 5 minutes.
- (d) If the pressure drops, locate the leakage by application of soapy water solution at all connections.
 - (e) Never use flame to check for leaks.
- **6-5.12.6** CNG cylinders shall not be installed in compartments containing an internal combustion engine.
- **6-5.12.7** CNG-cylinder storage compartments shall not have openings that communicate with the engine space above the level of the pressure regulator.

6-6 Heating Equipment.

6-6.1 Service Water Heating Units and Cabin Heaters.

- **6-6.1.1** Vent stacks shall lead to the atmosphere and shall be equipped with an effective device for preventing flame extinguishment or flareback from backdraft and entrance of rain or spray.
- **6-6.1.2** Dampers shall not be installed in vent stacks.

6-7 Auxiliary Appliances.

6-7.1 Lamps.

- **6-7.1.1** Gasoline shall not be used for fuel.
- 6-7.1.2 Oil lamps shall have metal bodies and shall be hung in gimbals.
- **6-7.1.3** Oil lamps shall not be located directly over galley stoves or heating units.
- **6-7.1.4** Metal shields shall be secured above chimneys.

6-8 Electric Stoves.

- **6-8.1** Electric stoves shall meet the requirements of UL 858, *Standard for Safety Household Electric Ranges*.
- **6-8.2** Electric stoves equipped with a lid or cover shall incorporate an automatic power disconnect switch that turns off all surface burners when the lid or cover is lowered over the heating elements.
- **6-8.3** Electric stoves shall have a light indicating when one or more heating elements are energized.
- **6-9 Installation of Electric Stoves.** Electric stoves shall be installed in accordance with the manufacturer's instructions.

Chapter 7 Electrical Systems Under 50 Volts

7-1 General. The standards and practices of this chapter establish requirements for the design and installation of direct current (dc) electrical systems on boats that operate at potentials of 50 volts or less.

Exception: Any wire permanently attached to an outboard engine and extending not more than 72 in. (183 cm) from the outboard engine.

7-2 Requirements—General.

7-2.1 Two-Wire System. Branch circuits shall be of the two-wire type and shall use insulated conductors to and from each item of equipment. The feed and return wires shall be run together from the power source to the equipment. If a common return is used, it shall be of equal wire gauge to the panelboard feeder. See Figures 7-2.1(a) and 7-2.1(b).

Exception No. 1: The electrical system on a propulsion or auxiliary engine shall be permitted to be of the one-wire type with the negative side of the system connected directly to the engine block.

Exception No. 2: In the case of outboard engines, the accessory negative bus shall be permitted to be connected to the battery.

7-2.2 Return Circuit. A metal hull, bonding conductor, or grounding conductor shall not be used as a return circuit.

Exception: See Section 7-11.

- **7-2.3 Grounded Systems.** If one side of a two-wire dc system is connected to ground, it shall be the negative side, and the system shall be polarized.
- **7-2.4 Multiple Engine Installation.** If a boat has more than one inboard propulsion or auxiliary engine, grounded cranking motor circuits shall be connected to each other by a common conductor that can carry the starting current of each of the grounded cranking motor circuits. Outboard engines shall be connected at the battery negatives.
- **7-2.5** Crossover (Parallel) Cranking Motor Circuits. In multiple inboard engine installations (including auxiliary generators) with crossover (parallel) cranking motors systems, the engines shall be connected together with a cable large enough to carry the cranking motor current of the largest cranking motor. This cable and its terminations shall be in addition to and independent of any other electrical connections to the engines, including those required by 7-2.4.

Exception No. 1: Installations using ungrounded dc electrical systems.

Exception No. 2: Outboard engines.

7-3 Batteries.

- **7-3.1** Batteries shall be accessible for inspection and maintenance.
- **7-3.2** Batteries shall not be tapped for voltages other than the total voltage of all the cells comprising the battery.
- **7-3.3*** A vent system or other means shall be provided to allow the discharge from the boat of hydrogen gas released by the battery. Battery boxes with a cover that forms a pocket over the battery shall be vented.
- **7-3.4*** Batteries shall be secured to provide immobilization to the extent practicable.
- **7-3.5** Batteries shall be located in a liquidtight tray or battery box of adequate capacity to retain normal spillage or boilover of electrolytes. The tray shall be constructed of or lined with materials resistant to deterioration by the electrolytes.
- **7-3.6** A nonconductive, perforated cover or other means shall be provided to prevent accidental shorting of the ungrounded battery terminals and cell connectors.

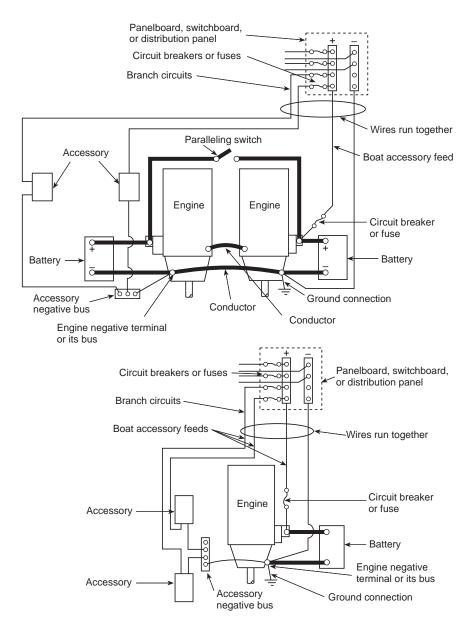


Figure 7-2.1(a) Typical inboard dc grounding systems.

- **7-3.7** Batteries with metal cell containers shall be assembled in nonconductive trays having insulated cell supports. Provision shall be made to prevent other conductive materials that could cause a short circuit from contacting cell containers.
- **7-3.8*** Each metallic fuel line and fuel system component located within 12 in. (30 cm) and above the horizontal plane of the battery top surface, as installed, shall be shielded with dielectric material.
- **7-3.9** The positive terminal of each battery shall be identified by the letters "POS" or "P" or by the symbol "+," marked on the terminal or on the battery case near the terminal.
- **7-3.10** Battery terminal connections shall not depend on spring tension.

7-4 Power Distribution System Negative Connections.

7-4.1 The negative terminal of the battery and the negative side of the electrical power distribution system shall be connected to the engine negative terminal or its bus.

Exception: Outboard boats shall be permitted to use the battery negative terminal.

- **7-4.2 Accessory Negative Bus.** An accessory negative bus shall be permitted provided the following conditions are met:
- (a) All accessories connected to the bus are branch circuits from the same panelboard.
- (b) Negative buses, negative bus return conductors, and their terminals and connections shall have an ampacity equal to the panelboard feeder.

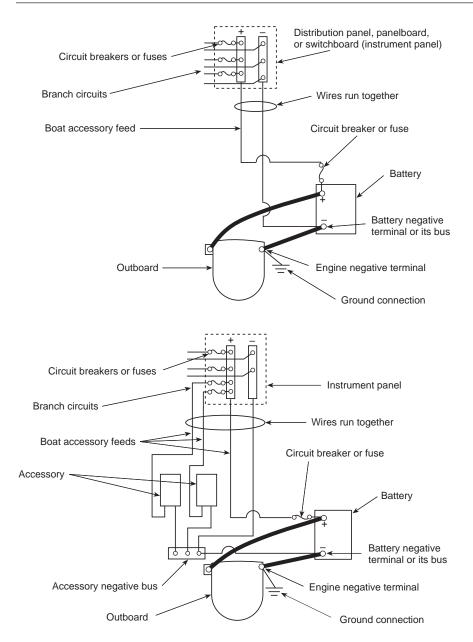


Figure 7-2.1(b) Typical outboard dc grounding systems.

- (c) Negative return conductors from the panelboard feeding the branch circuits that use the accessory negative bus shall be equal in size to the positive feeder to the panelboard.
- **7-5 Continuously Energized Parts.** Continuously energized parts, such as the positive battery terminal and both ends of all wires connected thereto, shall be physically protected by boots, sleeving, or other insulation to prevent an accidental short.

Exception: Conductors that have overcurrent protection at the source of power in accordance with Section 7-9.

7-6 Marking.

7-6.1 Marking of Controls. Switches and electrical controls shall be marked to indicate their use.

Exception: A switch or electrical control whose purpose is obvious and whose erroneous operation cannot cause a hazardous condition shall not be required to be marked.

7-6.2 Marking of Equipment. Electrical equipment such as an engine shall be marked or identified to indicate the following:

- (a) Manufacturer
- (b) Identifying number
- (c) Electrical rating (dc) in volts; rated current of electrical equipment shall be available and permitted to be marked on the device
- (d) Terminal polarity or identification, if necessary to operation
- (e) Ignition protection, if applicable

Exception: If part of an identified assembly.

7-7 Ambient Temperature. The ambient temperature of machinery spaces shall be considered to be 122°F (50° C), and the ambient temperature of all other spaces shall be considered to be 86°F (30° C).

7-8 Ignition Sources.

7-8.1 Potential sources of ignition located in gasoline-powered machinery and fuel tank spaces, and in spaces containing joints, fittings, or other connections between components of the gasoline fuel system, shall be ignition protected unless the electrical component is isolated from a gasoline fuel source as shown in Figures 7-8.1(a) through (g).

Exception: Boats using diesel fuel as the only fuel.

7-8.2 An electrical component shall be considered to be isolated from a gasoline fuel source provided the following conditions are met:

- (a) Distance between the electrical component and the gasoline fuel source is at least 2 ft (0.6 m) and the space is open to the atmosphere
- (b) Electrical component is located as follows:
 - Below the gasoline fuel source, and a means is provided to prevent gasoline fuel and vapors that can leak from the gasoline fuel sources from exposure to the electrical component
 - 2. Above the gasoline fuel source, and a deck or other enclosure is located between the ignition source and the gasoline fuel source
- (c) Each bulkhead located between the gasoline fuel source and ignition source shall provide the following:
 - Separate the electrical component(s) from the gasoline fuel source and extend the length of both the vertical and horizontal distances of the open space between the gasoline fuel source and the ignition source



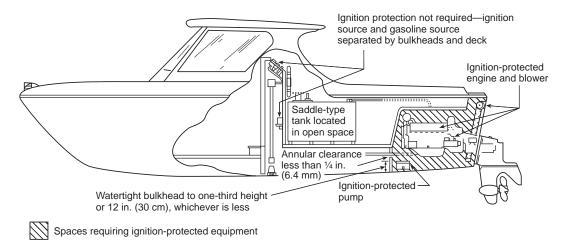


Figure 7-8.1(a) Location of ignition-protected equipment on gasoline-powered inboard engine boats with bulkhead and deck separations.

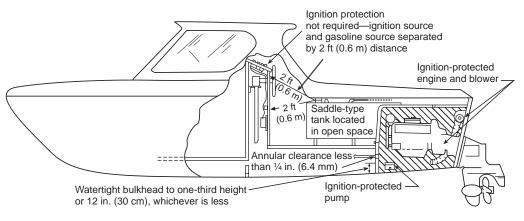


Spaces requiring ignition-protected equipment

Figure 7-8.1(b) Location of ignition-protected equipment on gasoline-powered inboard engine boats with ignition source and gasoline fuel source separated by 2 ft (0.6 m) distance.

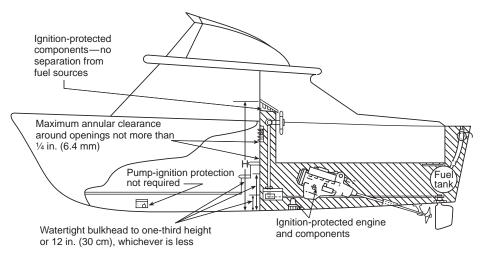

Spaces requiring ignition-protected equipment

Figure 7-8.1(c) Ignition protection in space containing gasoline engine and fuel line fittings.

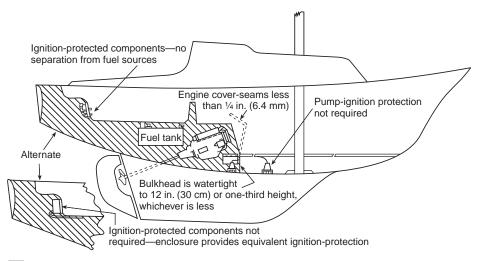

Spaces requiring ignition-protected equipment

Figure 7-8.1(d) Ignition protection in space containing gasoline engine and fuel line fittings on sailboats.

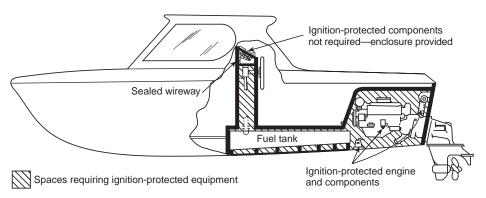


Figure 7-8.1(e) Ignition protection in space containing gasoline engines and fuel line fittings.

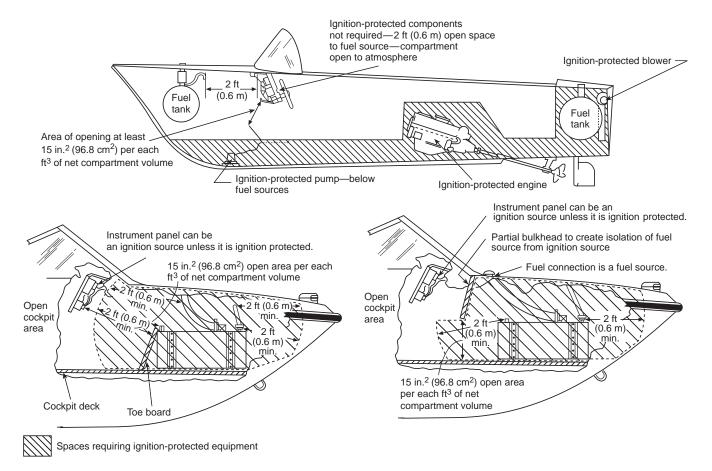


Figure 7-8.1(f) Ignition protection with no bulkhead.

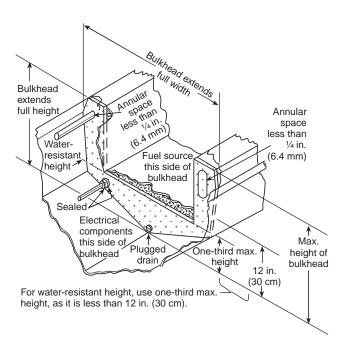


Figure 7-8.1(g) Cutaway illustration showing separation of electrical components from gasoline fuel source.

- 2. Resist a water level of 12 in. (30 cm) or of greater than one-third the maximum height of the bulkhead, whichever is lower, without seepage of more than ½ fl oz (7.4 ml) of fresh water per hour
- 3. Have no opening higher than 12 in. (30 cm) or greater than one-third the maximum height of the bulkhead, whichever is lower, unless the opening is used for the passage of items such as conductors, piping, ventilation ducts, and mechanical equipment, or for doors, hatches, and access panels, and the maximum annular space around each item not more than ½ in. (6.4 mm)

7-9 Overcurrent Protection.

7-9.1 Overcurrent Protection Location. Conductors other than cranking motor conductors shall be provided with overcurrent protection within a distance of 7 in. (18 cm) of the point at which the protection is connected to the source of power measured along the conductor. (*See Figure 7-9.1.*)

Exception No. 1: Up to 40 in. (102 cm) shall be permitted if the conductor, throughout the required distance, is contained in a sheath or enclosure, such as a junction box, control box, or enclosed panel. Exception No. 2: If the conductor is connected directly to the battery terminal, the 7-in. (18-cm) distance shall be permitted to be increased to 72 in. (183 cm).

7-9.2* Battery Charging Sources. Only battery charging sources designed to meet the requirements of the battery manufacturer shall be used for charging and shall also comply with the following.

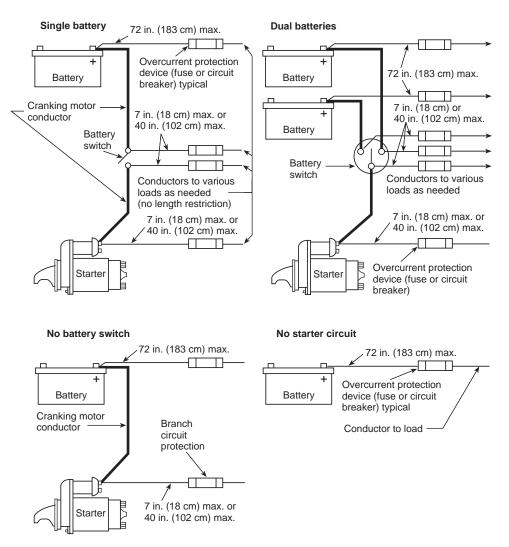


Figure 7-9.1 Location of overcurrent protection for conductors served by single or dual batteries or without battery switch or starter circuit.

7-9.2.1 Each ungrounded dc conductor that runs from the battery charger or other charging source to a battery or other point of connection to the dc system shall be provided with overcurrent protection within a distance of 7 in. (18 cm) of the point of connection to the dc electrical system or battery.

Exception No. 1: Overcurrent protection shall not be required if the charging source is within 72 in. (183 cm) of the battery measured along the conductor.

Exception No. 2: Overcurrent protection shall not be required if the charging source is within 40 in. (102 cm) of a point of connection, other than to the battery, and its entire length is contained within a sheath or enclosure, such as a conduit, junction box, control box, or enclosed panel.

7-9.2.2 Each ungrounded dc output conductor shall be provided with overcurrent protection within the charging source, based on the maximum output.

Exception: Self-limiting devices that are not capable of producing current in excess of the current rating of the connecting conductors shall not require overcurrent protection for the dc output conductors.

- **7-9.3* Motors or Motor-Operated Equipment.** Motors and motor-operated equipment, except for engine cranking motors, shall be protected internally at the equipment or by branch-circuit overcurrent devices suitable for motor current. The protection provided shall preclude a fire hazard if the circuit, as installed, is energized for 7 hours under any conditions of overload, including locked rotor.
- **7-9.4 Resistive Loads.** The rating of overcurrent protection devices used to protect both the conductor and a load other than a dc motor shall not exceed 150 percent of the current-carrying capacity of the conductor being protected.
- **7-9.5 Branch Circuits.** Each ungrounded conductor of a branch circuit shall be provided with overcurrent protection at the point of connection to the panelboard, unless the main circuit breaker or fuse provides such protection.
- **7-9.6 Distribution** Panels, Panelboards, and Switchboards. A trip-free circuit breaker or a fuse shall be installed at the power source for the panelboard. The overcurrent protection shall not be greater than 100 percent of the total

load capacity of the panelboard and shall not exceed 100 percent of the current-carrying capacity of the feeders to the panelboard. The protection at the power source shall not be greater than 150 percent of either the supply or return conductor ampacity, unless it is also the distribution panel or switchboard overcurrent protection, in which case it shall not exceed 100 percent of the load capacity. (See Figure 7-9.6.)

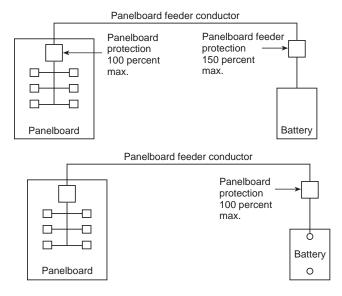


Figure 7-9.6 Illustration of overcurrent protection for panelboards and panelboard feeder conductors.

- **7-9.7 Circuit Breakers.** Circuit breakers shall comply with the following:
- (a) Have a dc voltage rating of not less than the nominal system voltage.
- (b) Be of the trip-free type.
- (c) Be capable of an interrupting capacity in accordance with Table 7-9.7.
- (d)* Meet the marine requirements of UL 489, Standard for Safety Molded-Case Circuit Breakers and Circuit-Breaker Enclosures; UL 1077, Standard for Safety Supplementary Protectors for Use in Electrical Equipment; or UL 1133, Standard for Safety Boat Circuit Breakers. Circuit breakers that meet the requirements of UL 1077 shall be permitted to be used as branch circuit breakers if they can interrupt the current specified for branch circuit breakers in Table 7-9.7 alone or in combination with the main circuit breaker.
- (e)* Meet the requirements of UL 1500, Standard for Safety Ignition-Protection Test for Marine Products, at four times their rated current if located in a space that requires ignition protection.
- **7-9.8 Fuses.** Fuses shall comply with the following:
- (a) Have a dc voltage rating of not less than the nominal system voltage
- (b) Be capable of an interrupting capacity in accordance with Table 7-9.7
- (c)* Meet the requirements of UL 1500, Standard for Safety Ignition-Protection Test for Marine Products, at four times their rated current if located in a space that requires ignition protection

- **7-9.9 Integral Overcurrent Protection Devices.** Integral overcurrent protection devices without a manual reset shall be permitted to be used as an integral part of an electrical device, provided the remainder of the circuit is protected by a trip-free circuit protection device(s) or a fuse(s). Integral overcurrent protection shall be sized to protect the accessory in which it is installed.
- **7-9.10 Pigtails.** Pigtails less than 7 in. (18 cm) in length shall be exempt from overcurrent protection requirements.

7-10 Switches.

- **7-10.1 Battery Switch Location.** If used, a battery switch shall be mounted as close as practicable to the battery and shall be readily accessible.
- **7-10.2** All boats with a battery or battery bank with a cold cranking capacity of greater than 800 amps shall have a master battery switch in a readily accessible location that meets the requirements of Section 7-8.

Exception: Electronic devices with protected memory and protective devices, such as bilge pumps and alarm systems if protected, shall be permitted to be connected to the continuously energized side of this switch.

- **7-10.3 Battery Switch Ratings.** The intermittent rating of a battery switch shall not be less than the maximum cranking current of the largest engine cranking motor it serves. The continuous rating of a battery switch shall not be less than the total of the ampacities of the main overcurrent protection devices connected to the battery switch.
- **7-10.4** If single-pole switches are used in branch circuits, they shall be installed in the positive conductor of the circuit.

Exception No. 1: Engine-mounted pressure, vacuum, and temperature-operated switches.

Exception No. 2: Switches such as those used for control of alarm systems.

7-10.5* Switches shall have voltage ratings of not less than the system voltage and current ratings of the connected load.

7-11 Appliances and Equipment.

7-11.1 Appliances and fixed dc electrical equipment shall be designed so that the current-carrying parts of the devices are insulated from all exposed electrically conductive parts.

Exception No. 1: Engine-mounted equipment.

Exception No. 2: The following devices shall be permitted to have their negative conductors connected to exposed electrically conductive parts. The polarity of both the positive and negative connections shall be identified, and these devices shall be mounted only on electrically nonconductive material and shall not be bonded.

- (a) Communications and audio equipment
- (b) Electronic navigation equipment
- (c) Instruments and instrument clusters
- (d) Cigarette lighters
- (e) Liquid level gauge transmitters (for installation on conductive surfaces)
- (f) Navigation lights operating at 12 volts or less
- **7-11.2 Grounded Liquid Level Gauge Transmitters** (Senders). Grounded liquid level gauge transmitters mounted on metallic tanks or tank plates shall have the transmitter negative return conductor connected directly to the engine negative terminal, its bus, or, for outboard boats, the battery negative terminal. This conductor also shall serve as

Table 7-9.7 Circuit Breaker Minimum Amperage Interrupting Capacity

Ampere Interrupting Capacity (AIC)
(Amperage available at circuit breaker terminals)

0.11.0	(Amperage available at circuit breaker terminals)						
Cold Cranking Current Rating at 0°F (-18°C) of Total Connected Battery Capacity	Main Circuit Breaker (Amperes)	Branch Circuit Breaker (Amperes)					
12 volts and 24 volts							
650 or less	1500	750					
651–1100	3000	1500					
Over 1100	5000	2500					
32 volts							
1250 or less	3000	1500					
Over 1250	5000	2500					

Notes:

^{2.} Under Battery Council International conversion factors, the following approximate correlations are used for $0^{\circ}F$ ($-18^{\circ}C$):

Cold Cranking Amperes	Ampere Hours (20-hour rating)
630	120
1076	205
1260	240

For the purpose of converting the 20-hour amp/hour rating to approximate cold cranking amps, use a value of $5.25 \times$ the amp/hour rating.

the static ground or the bonding conductor, or both. If this conductor is used as the tank system bonding conductor, it shall be minimum No. 8 AWG. No other device shall be connected to this conductor.

Exception: Tank fills and vents shall be permitted to be statically grounded to the tank or the tank plate.

7-11.3 Pigtail connections on submersible devices such as submersible bilge pumps shall not be shorter in length than 16 in. (41 cm).

7-12 System Wiring.

- **7-12.1** Conductors and flexible cords shall have a minimum rating of 50 volts.
- **7-12.2*** The construction of insulated cables and conductors shall conform with the requirements of SAE J1127, *Standard for Battery Cable*, SAE J1128, *Standard for Low Tension Primary Cable*, or UL 1426, *Standard for Safety Electrical Cables for Boats*.
- **7-12.3** Conductors shall be permitted to be selected from the types provided in Table 7-12.3 and Table 8-13.2. The temperature ratings shown assume the routing of wires above bilge water in locations protected from dripping, exposure to weather, spray, and oil.
- **7-12.4** Flexible cords shall conform with NFPA 70, *National Electrical Code*, and shall be selected from the types specified in Table 8-13.3.
- **7-12.5** Conductors and flexible cords shall be stranded copper according to Table 7-12.5(a) and shall be sized in accordance with Table 7-12.5(b).
- **7-12.6** Conductors and flexible cords shall be sized for voltage drop as follows:

Table 7-12.3 SAE Conductors

		Available Insulation Temperature Rating			
Туре	Description	°C	°F		
GPT	Thermoplastic insulation, braidless	60 90 105	140 194 221		
HDT	Thermoplastic insulation, braidless	60 90 105	140 194 221		
SGT	Thermoplastic insulation, braidless	60 90 105	140 194 221		
STS	Thermosetting synthetic rubber insulation, braidless	85 90	185 194		
HTS	Thermosetting synthetic rubber insulation, braidless	85 90	185 194		
SXL	Thermosetting cross-linked polyethylene insulation, braidless	125	257		

Source: SAE J378, Recommended Practice for Marine Engine Wiring.

- (a) Panelboard main feeders—3 percent
- (b) Navigation light circuits—3 percent
- (c) Electronic equipment circuits—3 percent
- (d) Bilge pump, blower, and refrigeration motor circuits—3 percent
- (e) All other noncritical circuits—10 percent

^{1.} The main circuit breaker is considered to be the first breaker(s) in a circuit connected in series with the battery. All subsequent breakers connected in series with a main circuit breaker are considered to be branch circuit breakers.

Table 7-12.5(a) Conductor Circular Mil (CM) Area and Stranding

		Minimum Number of Strands			
Conductor Size (AWG)	Minimum Acceptable CM Area ^a	Type 2 ^b	Type 3 ^c		
18	1,537	16			
16	2,336	19	26		
14	3,702	19	41		
12	5,833	19	65		
10	9,343	19	105		
8	14,810	19	168		
6	25,910	37	266		
4	37,360	49	420		
2	62,450	127	665		
1	77,790	127	836		
1/0	98,980	127	1064		
2/0	125,100	127	1323		
3/0	158,600	259	1666		
4/0	205,500	418	2107		

Note: Metric wire sizes are to be used if of equivalent circular mil area. If the circular mil area of the metric conductor is less than that specified, the wire ampacity can be corrected based on the ratio of the circular mil area.

7-12.7 Conductor sizes shall be permitted to be calculated by means of the following formula based on the voltage drops 3 percent and 10 percent. If the circular mil area is less than

the value specified in Table 7-12.5(a), the next larger size conductor shall be used.

$$CM = \frac{K \times I \times L}{E}$$

where:

CM = circular mil area of conductor

K = 10.75 (constant representing the mil-foot resistance of copper)

I = load current in amperes

L = length of conductor from the positive power source connection to the electrical device and back to the negative power source connection, measured in feet

E = voltage drop at load in volts (e.g., 12 volt @ 3 percent= 0.36)

7-13 Wiring Installation.

7-13.1 Current-carrying conductors shall be routed as high as practicable above the bilge water level and other areas where water can accumulate.

Exception: Where wiring and connectors are watertight, conductors shall be permitted to be routed through the bilge or other areas where water can accumulate.

7-13.2 Conductors shall be routed as far away as practicable from exhaust pipes and other heat sources. A clearance of at least 2 in. (5 cm) between conductors and water-cooled exhaust components and at least 9 in. (23 cm) between conductors and dry exhaust components shall be maintained. This clearance shall be increased to 18 in. (46 cm) where conductors are located directly above a dry exhaust.

Exception No. 1: Wiring on engines.

Exception No. 2: Exhaust temperature sensor wiring.

7-13.3 Battery cables shall not contact any metallic fuel system components. Battery cables shall be routed to minimize

Table 7-12.5(b) Allowable Amperage of Conductors for Under 50 Volts

		Temperature Rating of Conductor Insulation									200°C			
Conduc	ctor Size	60°C (140°F)	75°C (167°F)	80°C (176°F)	90°C (194°F)	105°C (221°F)	125°C ((257°F)	(392°F)
English	(metric)	Outside Engine Spaces	Inside Engine Spaces	Outside Engine Spaces	Inside Engine Spaces	Outside Engine Spaces	Inside Engine Spaces	Outside Engine Spaces	Inside Engine Spaces	Outside Engine Spaces	Inside Engine Spaces	Outside Engine Spaces	Inside Engine Spaces	Outside or Inside Engine Spaces
18	(0.8)	10	5.8	10	7.5	15	11.7	20	16.4	20	17.0	25	22.3	25
16	(1)	15	8.7	15	11.3	20	15.6	25	20.5	25	21.3	30	26.7	35
14	(2)	20	11.6	20	15.0	25	19.5	30	24.6	35	29.8	40	35.6	45
12	(3)	25	14.5	25	18.8	35	27.3	40	32.8	45	38.3	50	44.5	55
10	(5)	40	23.2	40	30.0	50	39.0	55	45.1	60	51.0	70	62.3	70
8	(8)	55	31.9	65	48.8	70	54.6	70	57.4	80	68.0	90	80.1	100
6	(13)	80	46.4	95	71.3	100	78.0	100	82.0	120	102.0	125	111.3	135
4	(19)	105	60.9	125	93.8	130	101.4	135	110.7	160	136.0	170	151.3	180
2	(32)	140	81.2	170	127.5	175	136.5	180	147.6	210	178.5	225	200.3	240
1	(40)	165	95.7	195	146.3	210	163.8	210	172.2	245	208.3	265	235. 9	280
0	(50)	195	113.1	230	172.5	245	191.1	245	200.9	285	242.3	305	271.5	325
00	(62)	225	130.5	265	198.8	285	222.3	285	233.7	330	280.5	355	316.0	370
000	(81)	260	150.8	310	232.5	330	257.4	330	270.6	385	327.3	410	364.9	430
0000	(130)	300	174.0	360	270.0	385	330.3	385	315.7	445	378.3	475	422.8	510

^aApplies only to systems under 50 volts.

^bConductors with Type 2 stranding, used for general-purpose wireing, which is subject to some movement from vibration or minor flexing. ^cConductors with Type 3 stranding, used for any wiring where flexing is involved in normal use.

contact with nonmetallic fuel system components. Where such contact occurs with nonmetallic fuel system components, cables shall be secured to prevent relative motion and abrasion between the two system components.

- **7-13.4** Conductors subject to exposure to physical damage shall be protected by loom, conduit, tape, raceways, or other equivalent protection. The protection shall be self-draining. Conductors passing through or around bulkheads or structural members shall be protected to minimize insulation damage such as chafing or compression. Conductors also shall be routed clear of sources of chafing such as steering cable and linkages, engine shafts and belts, and throttle connections.
- 7-13.5 Conductors shall be at least No. 16 gauge.

Exception No. 1: No. 18 gauge conductors shall be permitted to be used if they are included with other conductors in a sheath and do not extend more than 30 in. (75 cm) outside the sheath.

Exception No. 2: Conductors contained completely within equipment or enclosures.

- **7-13.6** Conductors shall be supported for their entire length or, alternatively, shall be secured at least every 18 in. (46 cm) by one of the following methods:
- (a) Nonmetallic clamps of a size to hold the conductors firmly in place. Nonmetallic straps or clamps shall not be used over engine(s), moving shafts, other machinery, or passageways if failure can result in a hazardous condition. Conductor material shall be resistant to oil, gasoline, and water and shall not break or crack under flexing within a temperature range of -30°F to 250°F (-34°C to 121°C).
- (b) Metal straps or clamps with smooth, rounded edges. That section of the conductor or cable located directly under the strap or clamp shall be protected by means of loom, tape, or other suitable wrapping to prevent injury to the conductor.

Exception No. 1: Battery cables within 36 in. (91 cm) of a battery terminal.

Exception No. 2: Cables attached to outboard motors.

(c) Metal clamps lined with an insulating material resistant to the effects of oil, gasoline, and water.

7-14 Wiring Connections.

- **7-14.1** Metals used for the terminal studs, nuts, and washers shall be corrosion resistant and galvanically compatible with the conductor and terminal lug. Aluminum and unplated steel shall not be used for studs, nuts, and washers.
- **7-14.2** Wiring connections and terminals shall be designed specifically for use with stranded wire.
- **7-14.3** Each conductor splice joining conductor to conductor, conductor to connectors, and conductor to terminals shall be able to withstand a tensile force equal to at least the value shown in Table 8-14.9 for the smallest conductor size used in the splice for a 1-minute duration without breaking.
- **7-14.4** Terminal connectors shall be of the ring or captive spade type.

Exception: Friction-type connectors shall be permitted to be used as follows:

- (a) Voltage drop from terminal to terminal does not exceed 50 millivolts for a 20-ampere current flow
- (b) Connection does not separate if subjected to a 6-lb (26.7-N) tensile force along the axial direction of the connector for 1 minute

- **7-14.5** Connections shall be permitted to be made using a set-screw, pressure-type conductor connector, provided a means is used to prevent the set screw from bearing directly on the conductor strands.
- 7-14.6 Twist-on connectors (wire nuts) shall not be used.
- **7-14.7*** Solder shall not be the sole means of mechanical connection in any circuit.

Exception No. 1: Battery lugs with a solder contact length of not less than 1.5 times the diameter of the conductor.

Exception No. 2: Conductors contained completely within equipment or enclosures.

- **7-14.8** Solderless crimp-on connectors shall be attached with the type of crimping tools designed for the connector used.
- **7-14.9** Each battery terminal post shall not be used for more than one conductor.

Exception No. 1: Connections made for paralleling batteries.

Exception No. 2: One additional conductor shall be permitted where installed in accordance with 7-9.1.

- **7-14.10** No more than four conductors shall be secured to any terminal stud.
- **7-14.11** Terminal connectors of the ring and captive spade type shall be the same nominal size as the stud.
- **7-14.12** Conductors terminating at switchboards in junction boxes or at fixtures shall be arranged to provide a length of conductor to relieve tension, to allow for repairs, and to permit multiple conductors to be fanned at terminal studs.
- **7-14.13** The shanks of terminals shall be protected against accidental shorting by the use of insulation barriers or sleeves.

Exception: Shanks used in grounding systems.

7-15 Receptacles.

- **7-15.1** Receptacles shall be installed in locations normally not subject to rain, spray, or flooding. Receptacles used in areas subject to such weather exposure shall be protected as follows:
- (a) Weatherproof if subject to rain or spray
- (b) Watertight if subject to flooding
- **7-15.2** Receptacles and matching plugs used on dc systems shall not be interchangeable with receptacles and matching plugs used elsewhere on the boat for ac systems.
- **7-16 Plug Connectors.** Connectors used in conjunction with harness-type wiring systems shall comply with the following:
- (a) Connectors shall incorporate means such as cable clamps, molded connectors, insulation grips, or extended terminal barrels to limit flexing at the connection.
- (b) Connectors exposed to weather shall be weatherproof or, if subject to immersion, shall be watertight.
- (c) Each terminal in a multiwire connector shall be protected from accidental short-circuiting to adjacent terminals.
- (d) Connectors shall have provision for a minimum disengagement force of 6 lb $(26.7\ N)$ along the axial direction of the connector for 1 minute.

Chapter 8 Alternating Current (ac) Electrical Systems on Boats

8-1* General. The standards and practices of this chapter establish requirements for the design and installation of ac electrical systems on boats operating at frequencies of 50 or 60 hertz and less than 300 volts, including shore-powered systems up to the point of connection to the shore outlet.

8-2 Requirements—General.

- **8-2.1** The system shall be polarized.
- **8-2.2** A grounded neutral system shall be required, but the neutral shall be grounded only at the power source (e.g., at the onboard generator, at an inverter, at the secondary of an isolation or polarization transformer, or through the shore power connection.) The shore power neutral grounded through the shore power cable shall not be grounded on the boat.

Exception: On systems using an isolation or polarization transformer, the generator or inverter neutral shall be permitted to be the transformer. Secondary neutrals shall be permitted to be grounded at a main grounding bus instead of at the generator inverter or transformer secondaries.

- **8-2.3** The boat's ac system grounding (green) conductor shall be connected to the engine negative terminal or its bus.
- **8-2.4** Individual circuits shall not be capable of being energized by more than one source of electrical power at a time. Each shore power inlet or generator shall be a separate source of electrical power.
- **8-2.5** Energized parts of electrical equipment shall be protected against accidental contact by the use of enclosures or other protective means; these shall not be used for nonelectrical equipment. Access to enclosures containing energized parts of the electrical equipment shall require the use of hand tools.
- **8-2.6** The transfer from one power source circuit to another shall be made by a means that opens all current-carrying conductors, including neutrals, before closing the alternate source circuit, and that prevents arc over between sources.

8-3 Marking.

8-3.1 Shore Power Inlet Warning. A permanently mounted, waterproof warning sign shall be located alongside each shore power inlet location on the boat. The warning sign shall include the following information:

CAUTIONShore power inlet warning.

To minimize shock and fire hazards

- (a) Turn off the boat's shore connection switch before connecting or disconnecting shore cable.
- (b) Connect shore power cable at the boat first.
- (c) Immediately disconnect cable if polarity warning indicator is activated.

Exception to c: This provision shall not be required if a polarity indicator is not required.

- (d) Disconnect shore power cable at shore outlet first.
- (e) Close shore power inlet cover tightly. Do not alter shore power cable connectors.

- **8-3.2 Marking of Controls.** Switches and electric controls shall be marked to indicate their use, unless their purpose is obvious and erroneous operation cannot cause a hazardous condition.
- **8-3.3 Marking of Equipment.** Electrical equipment shall be marked or identified to indicate the following:
- (a) Manufacturer's identification
- (b) Model number
- (c) Rating in volts and amperes or volts and watts
- (d) Phase identification, if applicable
- (e) Ignition protection, if applicable
- **8-4 System Voltage.** Nominal system voltages for ac electrical systems shall be selected from the following:
- (a) 120 volts ac, single-phase
- (b) 240 volts ac, single-phase
- (c) 120/240 volts ac, single-phase
- (d) 120/240 volts ac, delta three-phase
- (e) 120/208 volts ac, wye three-phase
- **8-5 Ambient Temperature.** The ambient temperature of machinery spaces shall be considered to be 122°F (50°C), and the ambient temperature of all other spaces shall be considered to be 86°F (30°C).

8-6 Ignition Source.

8-6.1 Potential sources of ignition located in machinery and fuel tank spaces, and in spaces containing joints, fittings, or other connections between components of the gasoline fuel system, shall be ignition protected, unless the ignition source is isolated from a gasoline fuel source as described in 8-6.2. [See also Figures 7-8.1(a)through (g).]

Exception: Boats using diesel fuel as the only fuel.

- **8-6.2** An electrical component shall be considered to be isolated from a gasoline fuel source provided the following conditions are met:
- (a) Distance between the electrical component and the gasoline fuel source is at least 2 ft (0.6 m) and the space is open to the atmosphere
- (b) Electrical component is located as follows:
 - Below the gasoline fuel source and a means is provided to prevent gasoline fuel and vapors that can leak from the gasoline fuel sources from exposure to the electrical component
 - 2. Above the gasoline fuel source and a deck or other enclosure is located between the ignition source and the gasoline fuel source
- (c) A bulkhead that meets the requirements of 8-6.3 is located between the electrical component and the gasoline fuel source

8-6.3* Each bulkhead shall provide the following:

- (a) Separate the electrical component(s) from the gasoline fuel source and extend the length of both the vertical and horizontal distances of the open space between the gasoline fuel source and the ignition source
- (b) Resist a water level of 12 in. (30 cm) or of greater than one-third the maximum height of the bulkhead, whichever is lower, without seepage of more than ¼ fl oz (7.4 ml) of fresh water per hour

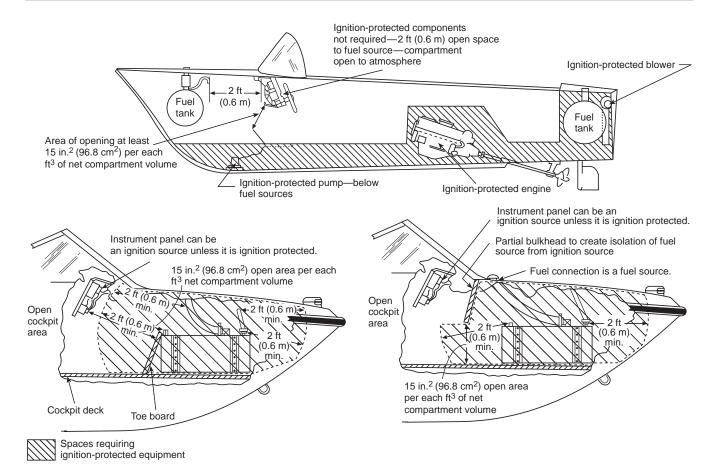


Figure 8-6.1 Ignition protection with no bulkhead.

(c) Have no opening higher than 12 in. (30 cm) or greater than one-third the maximum height of the bulkhead, whichever is lower, unless the opening is used for the passage of items such as conductors, piping, ventilation ducts, and mechanical equipment, or for doors, hatches, and access panels, and the maximum annular space around each item is not more than ½ in. (6.4 mm)

8-7 Shore Power Polarity Devices.

- **8-7.1*** Reverse-polarity indicating devices having a continuously visible or audible signal shall be installed in 120 VAC shore power systems, provided the following applies:
- (a) The polarity of the system is maintained for the proper operation of electrical devices in the system
- (b) A branch circuit is provided with overcurrent protection in the ungrounded current-carrying conductors only

Exception: Systems with polarization or isolation transformers that establish the polarity of the onboard system.

- **8-7.2** The total impedance of polarity-indicating and protection devices connected between normal current-carrying conductors and the grounding conductor shall not be less than 25,000 ohms at 120 volts, 60 hertz at all times.
- **8-7.3** Conductors shall be identified to indicate polarity according to Figures 8-7.3(a) through (i).

8-8 Overcurrent Protection.

- **8-8.1 Rating of Overcurrent Protection Devices.** Overcurrent protection devices shall have a temperature rating and demand load characteristics consistent with the protected circuit and their location in the boat (e.g., in machinery space). The rating of the overcurrent protection device shall not exceed the maximum current-carrying capacity of the conductor being protected.
- **8-8.2 Circuit Breakers.** Circuit breakers shall comply with the following:
 - (a) Be of the manual reset type
 - (b) Be of the trip-free type
- (c) Be capable of an interrupting capacity in accordance with Table 8-8.2
- (d) Meet the marine requirements of UL 489, Standard for Safety Molded-Case Circuit Breakers and Circuit-Breaker Enclosures, UL 1077, Standard for Safety Supplementary Protectors for Use in Electrical Equipment; or UL 1133, Standard for Safety Boat Circuit Breakers
- (e)* Meet the requirements of UL 1500, Standard for Safety Ignition-Protection Test for Marine Products, at four times their rated current if located in a space that requires ignition protection

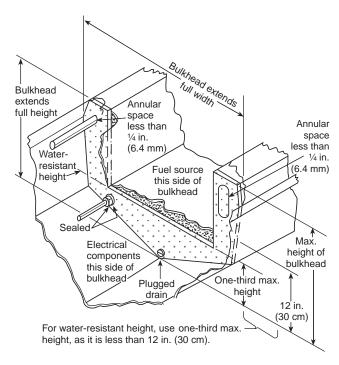


Figure 8-6.3 Cutaway illustration showing separation of electrical components from gasoline fuel source.

- **8-8.3 Fuses.** Fuses shall comply with the following:
- (a) Have a dc voltage rating of not less than the nominal system voltage
- (b) Be capable of an interrupting capacity at a rated system voltage of at least 5000 amperes for the feeders between the shore power inlet and the main circuit breaker and 3000 amperes for branch circuits
- (c)* Meet the requirements of UL 1500, Standard for Safety Ignition-Protection Test for Marine Products, at four times their rated current if located in a space that requires ignition protection
- (d) Meet the requirements of UL 198C, Standard for Safety High-Interrupting Capacity Fuses, Current-Limiting Types; UL198E, Standard for Safety Class R Fuses; UL 198F, Standard for Safety Plug Fuses; or UL 198H, Standard for Safety Class T Fuses for Class J, L, R, S, or T fuses
- **8-8.4 Fuse Holders.** Fuse holders shall meet the requirements of UL 512, *Standard for Safety Fuseholders*, for the class of fuse being used.

8-9 Main Supply.

- **8-9.1** Common-trip circuit breakers shall be provided in main supply conductors as follows:
- (a) 120-volt ac, single-phase—ungrounded and grounded conductors (white)
- (b) 240-volt ac, single-phase—both ungrounded conductors
- (c) 120/240-volt ac, single-phase—both ungrounded conductors
- (d) 120/240-volt ac, delta three-phase—all ungrounded conductors

- (e) 120/208-volt ac, wye three-phase—all ungrounded conductors
- **8-9.2** If the main supply feeder from the shore power inlet to the main circuit breaker exceeds 10 ft (3 m) in length, additional fuses or circuit breakers shall be provided within 10 ft (3 m) of the shore power inlet. If additional fuses are used, their rating shall be such that circuit breakers trip before the fuses open the circuit in the event of overload.
- **8-9.3** Overcurrent protection for ac-generator power feeders, if required, shall be within 7 in. (18 cm) of the output connection or shall be permitted to be within 40 in. (102 cm) of the output connections if the unprotected insulated conductors are contained for their entire length within a sheath or enclosure, such as a conduit, junction box, control box, or enclosed panel.

8-10 Branch Circuits.

- **8-10.1** Each ungrounded conductor of a branch circuit shall be provided with overcurrent protection at the point of connection to the panelboard bus. Each circuit breaker or fuse used for this purpose shall not be rated in excess of the current rating of the smallest conductor between the fuse or circuit breaker and the load.
- **8-10.2** In branch circuits, circuit breakers and switches shall open all grounded and ungrounded conductors simultaneously.

Exception No. 1: A polarized circuit with a polarity indicator.

Exception No. 2: The neutral leg of a grounded secondary of a polarization or isolation transformer.

- **8-10.3** Fuses shall not be used in the grounded conductor.
- **8-10.4** If circuits contain two or more ungrounded current-carrying conductors that are protected by fuses, means shall be provided to disconnect all energized legs of the circuit simultaneously or to remove all fuses from the circuit simultaneously.
- **8-10.5** All ac branch-circuit conductors to receptacles or equipment shall be of the jacketed type.

Exception: Conductors contained completely within equipment or enclosures.

8-10.6 Alternating Current (ac) Motors. Each motor or motor-operated device shall be protected by an overcurrent protection device that is responsive to the motor current. The overcurrent protection device shall not be rated at more than 125 percent of the motor full-load current rating and shall be permitted to be integral and of an automatic resetting type.

Exception: Motors that do not overheat under locked rotor conditions.

8-10.7 Battery Chargers. Each ungrounded conductor to a battery charger shall be provided with overcurrent protection at the point of connection to the main switchboard, the distribution panel, or the battery. In addition, the ungrounded conductor shall be provided with overcurrent protection within the battery charger, based on the maximum output of the charger, unless the battery charger output is current limited.

8-11 Ground-Fault Circuit Interrupters (GFCI).

8-11.1 A GFCI shall be permitted to be used on any single-phase ac circuit and shall be used for all receptacles in a head, galley, or machinery space or on a weather deck.


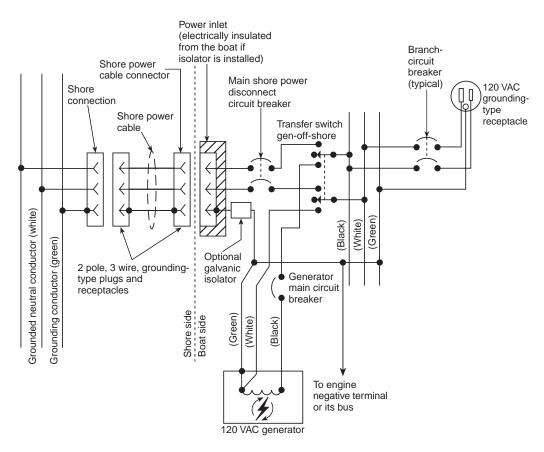


Figure 8-7.3(a) Single-phase 120-volt auxiliary generator shore power selector switch circuit.

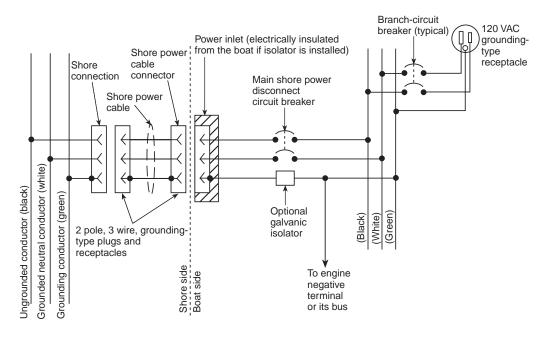

 $\begin{tabular}{ll} Figure~8-7.3(b) & Single-phase~120-volt~system~with~shore-grounded~neutral~conductor~and~shore~grounding~conductor. \end{tabular}$

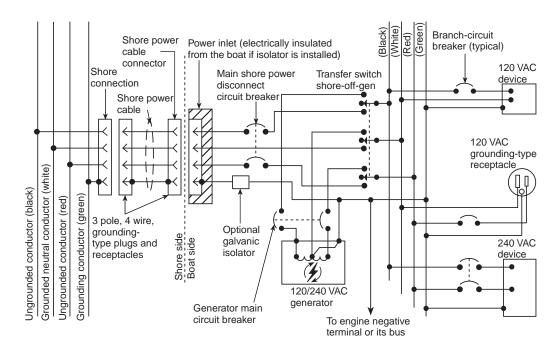


Figure 8-7.3(c) Single-phase 120/240-volt system with shore-grounded neutral conductor and grounding conductor.

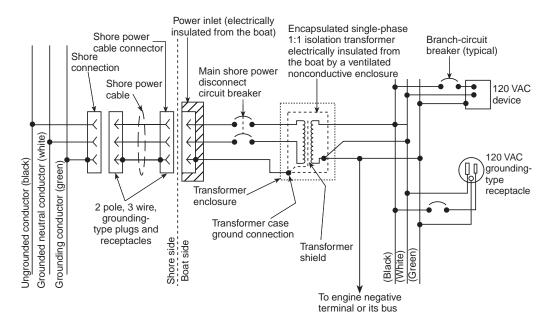


Figure 8-7.3(d) Single-phase 120-volt isolation transformer system with grounded secondary.

8-11.2 Ground-Fault Circuit-Interrupter (GFCI) Breakers. GFCI breakers shall comply with the following:

- (a) Meet the requirements of UL 943, Standard for Safety Ground-Fault Circuit-Interrupters, and UL 489, Standard for Safety Molded-Case Circuit Breakers and Circuit-Breaker Enclosures
- (b) Be protected by Type A (nominal 5 milliampere) ground-fault circuit interrupters if installed in a head, galley, or machinery space or on a weather deck
- (c) Be permitted to be installed as panelboard feeder breakers to protect all associated circuits, or in individual branch circuits

8-11.3 Ground-Fault Circuit-Interrupter (GFCI) Receptacle Devices. GFCI receptacle devices shall comply with the following:

(a) Meet the requirements of UL 943, Standard for Safety Ground-Fault Circuit-Interrupters, and UL 498, Standard for Safety Attachment Plugs and Receptacles

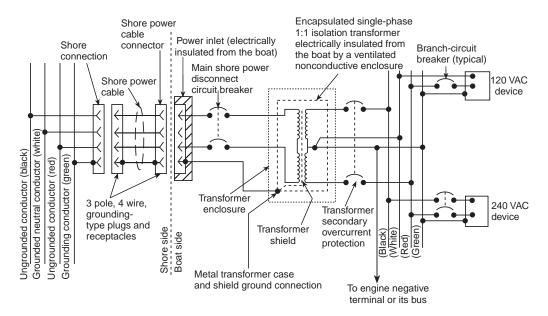


Figure 8-7.3(e) Isolation transformer system with single-phase 240-volt input and 120/240-volt single-phase output.

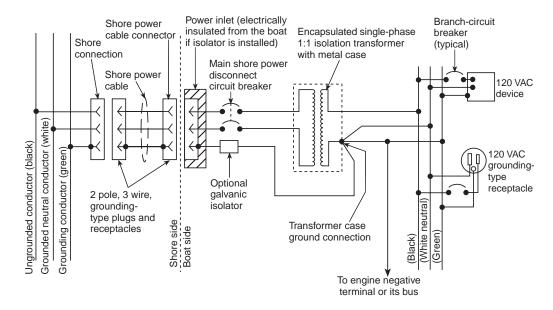


Figure 8-7.3(f) Single-phase 120-volt polarization transformer system with shore grounding wire protection of transformer primary.

- (b) Be permitted to be installed as part of a convenience outlet installation, either in single outlet applications or in multiple "feed-through" installations
- **8-11.4* Isolation Transformer Primary.** GFCI circuit breakers shall be permitted to be installed as the main breaker on the primary side of isolation transformers.

8-12 Appliances and Equipment.

8-12.1 Appliances and fixed ac electrical equipment used on boats shall be designed so that the current-carrying parts of the device are insulated effectively from all exposed electrically conductive parts.

- **8-12.2** All exposed electrically conductive noncurrent-carrying parts of fixed ac electrical equipment and appliances intended to be grounded shall be connected to the grounding system.
- **8-12.3** If an appliance has a neutral-to-ground bonding strap, the bonding strap shall be removed.

8-13 Conductors and Flexible Cords.

- **8-13.1** Conductors shall have a minimum rating of 600 volts. Flexible cords shall have a minimum rating of 300 volts.
- **8-13.2** Conductors shall be selected from the types specified in Table 8-13.2.

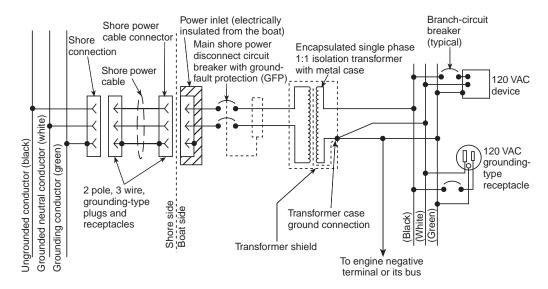


Figure 8-7.3(g) Single-phase 120-volt isolation transformer system with ground-fault circuit-interrupter (GFCI) protection of transformer primary.

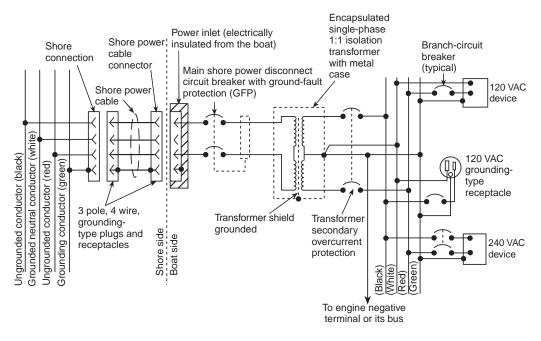


Figure 8-7.3(h) Isolation transformer system—single-phase 240-volt input and 120/240-volt single-phase output with ground-fault circuit-interrupter (GFCI) protection of transformer primary.

- **8-13.3** Flexible cords shall be selected from the types specified in Table 8-13.3.
- **8-13.4** Conductors and flexible cords shall be of stranded copper with circular mil area and stranding in accordance with Table 8-13.4.
- **8-13.5** Conductor sizes, as determined by Table 8-13.4, shall not carry current greater than that indicated in Table 8-13.5, based on the temperature rating of the wire and the following derating factors:
- (a) Conductors used in or routed through an engine space shall be corrected in accordance with Note 1 of Table 8-13.5.
- (b) Current-carrying conductors that are bundled shall be derated in accordance with Note 2 of Table 8-13.5.

8-13.6 Conductors shall be at least No. 16 AWG.

Exception: Conductors contained completely within equipment or enclosures.

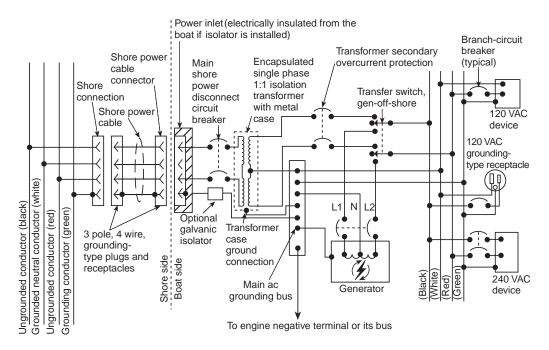


Figure 8-7.3(i) Single-phase polarization transformer system with single-phase 240-volt input and 120/240-volt single-phase output—shore grounding protection of transformer.

Table 8-8.2 Circuit-Breaker Interrupting Capacity (Amperes)

	Main Shore Power					
Shore Power Source	Disconnect Circuit Breaker	Branch Breaker				
120V-30A	3000	3000				
120V-50A	3000	3000				
120/240V-50A	5000	3000				
240V-50A	5000	3000				
120/208V-3-phase/wye 30A	5000	3000				
120/240V-100A	5000	3000				
120/208V-3-phase/wye 100A	5000	3000				

Notes

- 1. The main circuit breaker shall be considered the first circuit breaker(s) connected to a source of ac power. All subsequent breakers including submain breakers connected in series with a main circuit breaker, are considered to be branch circuit breakers.
- 2. A fuse in series with, and ahead of a circuit breaker shall be permitted to be required by the circuit-breaker manufacturer to achieve the interrupting capacity specified in Table 8-8.2.
- **8-13.7** All conductors shall meet the applicable standards of Underwriters Laboratories Inc., and shall be so labeled.

8-14 Installation.

- **8-14.1** All connections normally carrying current shall be made in enclosures with interior surfaces having a flame spread rating of not more than 25.
- **8-14.2** All conductors shall be supported to relieve strain on connections. Where ac and dc conductors are run together, the ac conductors shall be sheathed, bundled, or otherwise kept separate from the dc conductors.

Exception: Conductors contained completely within equipment or enclosures.

- **8-14.3*** Conductors shall be supported for their entire length or, alternatively, shall be secured at least every 18 in. (46 cm) by one of the following methods:
- (a) Nonmetallic clamps of a size to hold the conductors firmly in place. Nonmetallic straps or clamps shall not be used over engine(s), moving shafts, other machinery, or passageways if failure can result in a hazardous condition. Conductor material shall be resistant to oil, gasoline, and water and shall not break or crack under flexing within a temperature range of -30°F to 250°F (-34°C to 121°C).
- (b) Metal straps or clamps with smooth, rounded edges to hold the conductors firmly in place without damage to the conductors or insulation. That section of the conductor or cable located directly under the strap or clamp shall be protected by means of loom, tape, or other suitable wrapping to prevent injury to the conductor.
- (c) Metal clamps lined with an insulating material resistant to the effects of oil, gasoline, and water.
- **8-14.4** Junction boxes, cabinets, and other enclosures in which electrical connections are made shall be weatherproof or installed in a protected location to minimize the entrance or accumulation of moisture or water within the boxes, cabinets, or enclosures. In wet locations, metallic boxes, cabinets, or enclosures shall be mounted to minimize the entrapment of moisture between the box, cabinet, or enclosure and the adjacent structure. If air space is used to achieve this, the minimum space shall be ½ in. (6.4 mm).
- **8-14.5** Unused openings in boxes, cabinets, and weather-proof enclosures shall be closed.
- **8-14.6** Current-carrying conductors shall be routed as high as practicable above the bilge water level and other areas

Table 8-13.2 Acceptable Insulation Types

Types	Description	Available Insulation Temperature Rating
THW	Moisture- and heat-resistant, thermoplastic	75°C (167°F)
TW	Moisture-resistant, thermoplastic	60°C (140°F)
THWN	Moisture- and heat-resistant, thermoplastic	75°C (167°F)
XHHW	Moisture- and heat-resistant, cross-linked synthetic polymer	90°C (194°F)
MTW	Moisture-, heat-, and oil-resistant, thermoplastic	90°C (194°F)
AWM	Moisture-, heat-, and oil-resistant, thermoplastic	105°C (221°F)
Style Nos.:*	Thermosetting	
1230		
1231		
1275		
1276		
1329		
1335		
1336		
1337		
1339		
1340		
1345		
1388		
3403		
UL 1426	Boat cable	(See UL 1426, Standard for Safety Electric Cables for Boats)

^{*}Numbers listed are style numbers.

Table 8-13.3 Flexible Cords

Туре	Description	Insulation Temperature Rating	Application
so	Hard service	60°C (140°F)	General use except
	cord—oil-resistant	75°C (167°F)	for machinery space
	compound	and higher	General use
ST	Hard service cord—thermoplastic	60°C (140°F) 75°C (167°F) and higher	General use except for machinery space General use
STO	Hard service	60°C (140°F)	General use except
	cord—oil-resistant	75°C (167°F)	for machinery space
	thermoplastic	and higher	General use
SJO	Junior hard service	60°C (140°F)	General use except
	cord—oil-resistant	75°C (167°F)	for machinery space
	compound	and higher	General use
SJT	Junior hard service	60°C (140°F)	General use except
	cord—	75°C (167°F)	for machinery space
	thermoplastic	and higher	General use
SJTO	Junior hard service	60°C (140°F)	General use except
	cord—	75°C (167°F)	for machinery space
	thermoplastic	and higher	General use

where water can accumulate. If conductors are forced to be routed through the bilge or other areas where water can accumulate, the wiring shall be of a submersible type and connections shall be watertight.

8-14.7 Conductors shall be routed as far away as practicable from exhaust pipes and other heat sources. Unless an equivalent thermal barrier is provided, a clearance of at least 2 in. (5 cm) between conductors and water-cooled exhaust components and a clearance of at least 9 in. (23 cm) between conductors and dry exhaust components shall be maintained. Where conductors are located directly above a dry exhaust, the clearance shall be increased to 18 in. (46 cm).

Conductors subject to physical damage shall be protected by loom, conduit, tape, raceways, or other equivalent protection. The protection shall be self-draining. Conductors passing through or around bulkheads or structural members shall be protected to minimize insulation damage such as chafing or compression. Conductors also shall be routed clear of sources of chafing such as steering cable and linkages, engine shafts, and throttle connections.

8-14.8 All permanently installed appliances and utilization equipment shall be mounted securely to the boats structure.

8-14.9 Wiring Connections. Wiring connections shall comply with the following:

(a) Wiring connections shall be designed and installed to make mechanical and electrical joints without damage to the conductors.

Table 8-13.4 Conductor Circular Mil (CM) Area and Stranding

Conductor Size (AWG)	Nominal CM Area ^a	Minimum Type 2 ^b	Number of Strands Type 3 ^c	
18	1,620	16	_	
16	2,580	19	26	
14	4,110	19	41	
12	6,530	19	65	
10	10,380	19	105	
8	16,510	19	168	
6	26,240	37	266	
4	41,740	61	420	
2	66,360	127	665	
1	83,690	127	836	
1/0	105,600	127	1064	
2/0	133,100	127	1323	
3/0	167,800	259	1666	
4/0	211,600	418	2107	

Note: Metric wire sizes can be used if of equivalent circular mil area. If the circular mil area of the metric conductor is less than that listed, the wire ampacity needs to be corrected based on the ratio of the circular mil areas.

^aTo recognize stranded conductors made of AWG elements, note that the actual nominal CM area can differ from the specified nominal CM area but by no more than 7 percent. The circular mil area is equal to the mathematical square of the specified diameter of the AWG stranded solid copper conductor measured in one thousandths of an inch.

Area in.² =
$$\frac{\pi \times (circular \ mils)}{4(1,000,000)}$$

^bConductors with Type 2 stranding shall be permitted to be used for wiring that is subject to the movement from vibration or minor flexing. If four or more conductors are run in a cable, Type 2 stranding shall be permitted to be used for frequent flexing applications.

^cConductors with Type 3 stranding shall be used for any wiring where frequent flexing is involved in normal use.

- (b) Metals used for the terminal studs, nuts, and washers shall be corrosion resistant and galvanically compatible with the conductor and terminal lug. Aluminum and unplated steel shall not be used for studs, nuts, and washers.
- (c) Each conductor splice joining conductor to conductor, conductor to connectors, and conductor to terminals shall be able to withstand a tensile force equal to at least the value shown in Table 8-14.9 for the smallest conductor size used in the splice for a 1-minute duration without breaking.
- (d) Terminal connectors shall be of the ring or captive spade type.

Exception: Friction-type connectors shall be permitted to be used on components, provided

- (a) Circuit is rated at not more than 10 amperes.
- (b) Voltage drop from terminal to terminal does not exceed 50 millivolts for a 20-ampere current flow.
- (c) Connection does not separate if subjected to a 6-lb (26.7-N) tensile force along the axial direction of the connector for 1 minute.
- **8-14.10** Connections shall be permitted to be made using a set-screw, pressure-type conductor connector, provided a means is used to prevent the set screw from bearing directly on

the conductor strands. Set-screw-type conductor connectors without such means shall be used only on seven-strand conductors

- 8-14.11 Twist-on connectors (wire nuts) shall not be used.
- **8-14.12** Solder shall not be the sole means of mechanical connection in any circuit.

Exception: Conductors contained completely within equipment or enclosures.

- **8-14.13** Solderless crimp-on connectors shall be attached with the type of crimping tools designed for the connector used
- **8-14.14** No more than four conductors shall be secured to any terminal stud. If additional connections are necessary, two or more terminal studs shall be connected together by means of jumpers or copper straps.
- **8-14.15** Terminal connectors of the ring and captive spade type shall be the same nominal size as the stud.
- **8-14.16** Conductors terminating at panelboards in junction boxes or fixtures shall be arranged to provide a length of conductor to relieve tension, to allow for repairs, and to permit multiple conductors to be fanned at terminal studs.
- **8-14.17** The shanks of terminals shall be protected against accidental shorting by the use of insulation barriers or sleeves.

Exception: Shanks used in grounding systems.

8-15 Receptacles.

- **8-15.1** Receptacles shall be installed in locations normally not subject to rain, spray, or flooding, but if receptacles are used in areas that are subject to such weather exposure, the following requirements shall apply:
- (a) Receptacles installed in locations subject to rain, spray, or splash shall be weatherproof to the degree provided by a spring-loaded, self-closing cover.
- (b) Receptacles installed in areas subject to flooding or momentary submersion shall be of as watertight a design as can be provided by a threaded, gasketed cover.
- **8-15.2** Receptacles shall be of the grounding type with a terminal provided for the grounding (green) conductor in accordance with ANSI/NEMA WD-6, *Wiring Devices—Dimensional Requirements.*
- **8-15.3** Receptacles and matching plugs used on ac systems shall not be interchangeable with receptacles and matching plugs used on dc systems.
- **8-15.4** Power wiring for receptacles shall be connected so that the grounded (white) conductor attaches to the terminal identified by a letter(s) or a light color (normally silver). The ungrounded conductor(s) shall be attached to the terminal identified by a letter(s) or a dark color (normally brass or copper).
- **8-15.5** A branch circuit supplying a combination of receptacle loads and permanently connected loads shall not supply fixed loads in excess of the following:
- (a) 600 watts for a 15-ampere circuit
- (b) 1000 watts for a 20-ampere circuit
- **8-15.6** Receptacles provided for the galley shall be located so appliance cords can be plugged in without crossing a traffic area, galley stove, or sink.

Table 8-13.5 Ampacities of Insulated Conductors

Conductor Size AWG	Temperature Rating of Conductor Insulation								
	60°C (140°F)	75°C (167°F)	80°C (176°F)	90°C (194°F)	105°C (221°F)	125°C (257°F)	200°C (392°F)		
18	10	10	15	20	20	25	25		
16	15	15	20	25	25	30	35		
14	20	20	25	30	35	40	45		
12	25	25	35	40	45	50	55		
10	40	40	50	55	60	70	70		
8	55	65	70	70	80	90	100		
6	80	95	100	100	120	125	135		
4	105	125	130	135	160	170	180		
3	120	145	150	155	180	195	210		
2	140	170	175	180	210	225	240		
1	165	195	210	210	245	265	280		
0	195	230	245	245	285	305	325		
00	225	265	285	285	330	355	370		
000	260	310	330	330	385	410	430		
0000	300	360	385	385	445	475	510		

Notes:

1. Engine room temperature derating factor:

	60°C (140°F)	75°C (167°F)	80°C (176°F)	90°C (194°F)	105°C (221°F)	125°C (257°F)	220°C (392°F)
Temperature rating of conductor	0.58	0.75	0.78	0.82	0.85	0.89	1.00

2. Current-carrying conductor bundling derating factor:

Number of Energized Wires in a Bundle	Correction Factor
3	0.70
4 to 6	0.60
7 to 24	0.50
25 and above	0.40

Table 8-14.9 Tensile Test Values for Connections

_	Tensile Force			Tensile Force	
Conductor Size	lb	N	Conductor Size (gauge)	lb	N
18	10	44	4	70	311
16	15	66	3	80	355
14	30	133	2	90	400
12	35	155	1	100	444
10	40	177	0	125	556
8	45	200	00	150	667
6	50	222	000	175	778
5	60	266	0000	225	1000

8-15.7 If installed in a head, galley, or machinery space or on a weather deck, the receptacle shall be protected by a Type A (nominal 5 milliamperes) GFCI.

8-15.8 Electrical systems not equipped with polarity indicators using two-pole circuit breakers shall use two-pole GFCI in place of single-pole GFCI receptacles in those circuits that supply receptacles.

8-16 Main Panelboard.

- **8-16.1** A main panelboard shall be installed in a readily accessible location, shall be weatherproof or protected from weather and splash, and shall be permitted to serve as a distribution center.
- **8-16.2** Boats equipped with both dc and ac electrical systems shall have their distribution on separate panelboards, or there shall be a partition to separate the ac and the dc sections of the panelboard when the panel is open for service.
- **8-16.3** Panelboards shall be permanently marked with the system voltage and either VAC or the system frequency (e.g., 120 VAC or 120V-60 hertz).
- **8-16.4** If the frequency is other than 60 hertz, the frequency shall be indicated. For three-phase systems, the system voltage, phase, and number of conductors shall be indicated.

- **8-16.5** A system voltmeter shall be installed, provided the following applies:
- (a) System is designed to supply motor circuits
- (b) Onboard generator is installed

8-17 Alternating-Current (ac) Generators.

- **8-17.1** Alternating-current generators shall be connected to the electrical distribution system through a selector switch in accordance with 8-2.3 and Figure 8-7.3(a).
- **8-17.2** The power feeders from the ac generator shall be sized to accommodate at least the generator's maximum rated output and shall be protected at the generator with overcurrent protection devices in accordance with Section 8-8. The rating of these overcurrent protection devices shall not exceed 120 percent of the generator's rated output.

Exception: Self-limiting generators having a maximum overload current not exceeding 120 percent of their rated current output shall not require additional external overcurrent protection.

8-18 Isolation of Galvanic Currents.

- **8-18.1** Boats using an isolation transformer or galvanic isolator to reduce galvanic corrosion shall use the following:
- (a) Isolation transformer system in accordance with 8-21.4 or 8-21.7
- (b) Galvanic isolator in the grounding conductor in accordance with 8-18.2.
- **8-18.2** The isolator shall meet the requirements of ABYC A-28, *Galvanic Isolators*.

8-19 Shore Power.

- **8-19.1 Power Inlet.** The receptacle installed to receive a connecting cable to carry ac shore power aboard shall be a male-type connector. Power inlets shall comply with the following:
- (a) Power inlets installed in locations subject to rain, spray, or splash shall be weatherproof to the degree provided by a spring-loaded, self-closing cover, the integrity of which shall not be affected when the receptacle is in use (female-type connector inserted).
- (b) Power inlets installed in areas subject to flooding or momentary submersion shall be of as watertight a design as can be provided by a threaded, gasketed cover.
- (c) A warning sign shall be located alongside each shore power inlet location on the boat. (See 8-3.1.)
- (d) If a boat uses an isolation transformer or an isolator to prevent galvanic current flow through the grounding conductor, the metallic shell of the shore power inlet shall be insulated from metallic surfaces or any contact with a boat ground. [See Figures 8-7.3(d) through (i).]
- **8-19.2 Shore Power Cable.** Boats with an ac electrical system(s) intended to use shore power provided in accordance with NFPA 70, *National Electrical Code*, Article 555, and NFPA 303, *Fire Protection Standard for Marinas and Boatyards*, shall be provided with a shore power cable that includes the following:
- (a) A male locking and grounding-type connection that conforms with NFPA 70, *National Electrical Code*, Article 555, and ANSI/NEMA WD-6, *Wiring Devices—Dimensional Requirements*, if a configuration for that service exists in ANSI/NEMA WD-6.
- (b) A female boat connection of the locking and grounding type that conforms with ANSI/NEMA WD-6, Wiring Devices—

- $Dimensional\ Requirements,$ if a configuration for that service exists in ANSI/NEMA WD-6
- (c) A minimum length of 25 ft (7.6 m) and meets the marine requirements of UL 817, Standard for Safety Cord Sets and Power-Supply Cords
- **8-20 Devices Employing Isolation Transformers.** Devices employing isolation transformers, such as battery chargers, shall be permitted to be connected directly to the shore conductors or to the secondary of the system isolation transformer.
- 8-21 Application of Types of Shore Power Circuits.
- **8-21.1** Single-Phase 120-Volt System with Shore-Grounded Neutral and Shore Grounding Conductor. This system, wired in accordance with the basic circuit shown in Figure 8-7.3(b), shall be permitted to be used on any nonmetallic hull boat with underwater hardware of metal alloys that are at least as galvanically noble as manganese bronze. This system also shall be permitted to be used with metal hull boats if protection against galvanic corrosion is provided by means of a cathodic protection system or a galvanic isolator.
- 8-21.2 Single-Phase 120/240-Volt System with Shore-Grounded Neutral and Shore Grounding Conductor. This system, wired in accordance with the basic circuit shown in Figure 8-7.3(c), shall be permitted to be used on any nonmetallic hull boat with underwater hardware of metal alloys that are at least as galvanically noble as manganese bronze. This system also shall be permitted to be used with metal hull boats if protection against galvanic corrosion is provided by means of a cathodic protection system or a galvanic isolator.
- **8-21.3** Single-Phase 120-Volt Primary and Secondary Isolation Transformer System. With shore grounding protection of the transformer core, this system, wired in accordance with the basic circuit shown in Figure 8-7.3(d), shall be permitted to be used with any metallic or nonmetallic hull boat. In this system, the grounded transformer core and the metallic shell of the shore power inlet shall be insulated from contact with any boat ground. The transformer secondary shall be grounded on the boat.
- 8-21.4 Isolation Transformer with Single-Phase 240-Volt Input and 120/240-Volt Output with Shore Grounding Protection of Transformer Core. This system, wired in accordance with the basic circuit shown in Figure 8-7.3(e), shall be permitted to be used with any boat and shall be used on all metal hull boats if other means of protection against galvanic corrosion, such as a galvanic isolator, are not provided. The metallic shell of the shore power inlet shall be insulated from contact with any boat ground. The center leg of the transformer secondary shall be grounded on the boat, establishing a new neutral for the boat system.
- 8-21.5 Single-Phase 120-Volt Primary and Secondary Polarization Transformer System with Shore-Grounded Neutral and Shore Grounding Protection of Transformer. This system, wired in accordance with the basic circuit shown in Figure 8-7.3(f), shall be permitted to be used on any nonmetallic hull boat with underwater hardware of metal alloys that are at least as galvanically noble as manganese bronze. This system also shall be permitted to be used with metal hull boats if protection against galvanic corrosion is provided by means of a cathodic protection system or a galvanic isolator. The transformer secondary shall be grounded on the boat.

8-21.6 Single-Phase 120-Volt Primary and Secondary Polarization Transformer System with Shore-Grounded Neutral and GFCI Protection of Transformer Primary. This system, wired in accordance with the basic circuit shown in Figure 8-7.3(g), shall be used with any metallic or nonmetallic hull boat. The metallic shell of the shore power inlet shall be insulated from contact with any boat ground. The transformer secondary shall be grounded on the boat.

8-21.7 Single-Phase Isolation Transformer with 240-Volt Input and 120/240-Volt Secondary with GFCI Protection of Transformer Primary. This system, wired in accordance with the basic circuit shown in Figure 8-7.3(h), shall be permitted to be used with any metallic or nonmetallic hull boat. The metallic shell of the shore power inlet shall be insulated from contact with any boat ground. The central leg of the transformer secondary shall be grounded on the boat, establishing a new neutral for the boat system.

8-21.8 Single-Phase Polarization Transformer with 240-Volt Input and 120/240-Volt Secondary and Shore Grounding Conductor Protection of Transformer Core. This system, wired in accordance with the basic circuit shown in Figure 8-7.3(i), shall be permitted to be used on any nonmetallic hull boat with underwater hardware of metal alloys that are at least as galvanically noble as manganese bronze. This system also shall be permitted to be used with metal hull boats if protection against galvanic corrosion is provided by means of a cathodic protection system or a galvanic isolator. The center leg of the transformer secondary shall be grounded on the boat, establishing a new neutral for the boat system.

Chapter 9 Lightning Protection

9-1 General. Lightning protection systems shall comply with ABYC E-4, *Lightning Protection*.

Chapter 10 Fire Protection Equipment

- **10-1 General Requirements.** All motor craft shall be equipped with fire-fighting equipment as required by this standard.
- 10-1.1* All boats with an enclosed machinery space(s) shall have provision for discharging extinguishing agent directly into the space immediately surrounding the engine without opening the primary access.
- **10-1.2** Either a fixed system or portable clean agent extinguisher used in conjunction with a machinery space discharge port shall be used to fulfill this requirement.

10-2 Portable Fire-Extinguishing Equipment.

10-2.1* All boats shall be equipped with portable fire extinguishers in accordance with Tables 10-2.1(a) and 10-2.1(b).

If the total horsepower exceeds 1000 bhp, an additional Type B-II portable fire extinguisher shall be required for each additional 1000 bhp or fraction thereof.

10-2.2* Portable fire extinguishers shall meet the requirements of and be inspected and maintained in accordance with NFPA 10, Standard for Portable Fire Extinguishers, and shall be U.S. Coast Guard approved or listed to the applicable ANSI/UL marine standard. All required fire extinguishers located in accommodation spaces shall have Class A capability.

Exception: Boats under 26 ft (8 m) in length without enclosed accommodation spaces or enclosed galleys shall be permitted to be equipped with a bucket with attached lanyard in lieu of Class A rated portable fire extinguishers.

- **10-2.3 Location.** It shall not be necessary to travel more than half the length of the vessel or 33 ft (10 m), whichever is less, to reach an extinguisher.
- **10-2.4*** Enclosed machinery spaces protected by a portable extinguisher shall be provided with a readily accessible port that is sized to accept the extinguisher nozzle and marked as

Table 10-2.1(a)	Number and Distribution	of Fire Extinguishers	[Boats up to but not in	cluding 65 ft (20 m) in length]
-----------------	-------------------------	-----------------------	-------------------------	---------------------------------

Type of Boat	No. of Extinguishers	Minimum ANSI/UL Rating	Minimum USCG Classification	Location
Open boats under 16 ft (5 m) with fiberglass or metal hulls and a light load of flammable Class A materials	1	5 B:C	B-1	Steering position
Open boats under 16 ft (5 m)	1	1A: 10B:C	B-1	Steering position
Boats 16 ft (5 m) to, but not including, 26 ft (8 m)	2	1A: 10B:C	B-1	Steering position and galley, when onboard, or cock pit
Open boats 16 ft (5 m) to, but not including, 26ft (8 m)	2	1A: 10B:C	B-1	Steering position and galley or cock pit
Boats 26 ft (8 m) to, but not including, 40 ft (12 m)	3	1A: 10B:C	B-1	Outside engine compartment, steering position, and near galley or passenger cockpit
Boats 40 ft (12 m) to, but not including, $65~\mathrm{ft}~(20~\mathrm{m})$	4	1A: 10B:C	B-1	Outside engine compartment, steering position, crew quarters, and galley, when onboard, or cock pit

Notes

- 1. For enclosed machinery spaces protected by a portable fire extinguisher, see 10-2.4.
- 2. Extinguishers intended only for machinery space protection are not required to have a Class A rating.

Table 10-2.1(b) Number and Distribution of Fire Extinguishers [Boats equal to and greater than 65 ft (20 m) in length]

Gross Tonnage	No. of Extinguishers	Minimum ANSI/UL Rating	Minimum USCG Classification	Location
Under 50	1*	4A: 60B:C	B-II	Outside machinery space
	1	4A: 60B:C	B-II	Helmsman's position
	3	1A: 10B:C	B-I	Galley, crew quarters, and cabin
50 to less than 100	1*	4A: 60B:C	B-II	Outside machinery space
	2	4A: 60B:C	B-II	Helmsman's position and galley
	2	1A: 10B:C	B-I	Crew quarters and cabin
100 to less than 300	1*	4A: 60B:C	B-II	Outside machinery space
	3	4A: 60B:C	B-II	Helmsman's position, galley, and crew quarters
	1	1A: 10B:C	B-I	Cabin

*See 10-2.1.

to its function. This port shall be located so that the extinguisher can remain upright during discharge.

Exception: Where the location of the port will not permit an extinguisher to remain upright during discharge, the extinguisher shall be equipped with a discharge hose.

10-2.4.1 Where portable equipment is provided for enclosed machinery space protection, the size and type shall be as specified in Table 10-2.4.1.

10-2.4.2 If an extinguisher is portable and readily removable from its fixed mounting, it shall be permitted to be credited as one of the extinguishers required in Tables 10-2.1(a) and 10-2.1(b).

10-3* Fixed Fire Protection Systems.

10-3.1 Systems shall be manually operated, automatically operated, or both. Carbon dioxide systems, that are installed to protect accommodation compartments or to protect enclosed machinery spaces that normally can be occupied shall be equipped with a predischarge alarm.

10-3.2 If spaces are connected, such spaces shall be considered as a single space when determining the capacity of the system. In determining the extent of connecting spaces, the requirements of Section 2-3 shall be used. The actuation of the system shall be such that all the connecting spaces are flooded. If multiple units are used to provide the required capacity, they shall discharge simultaneously.

Table 10-2.4.1 Minimum Clean Agent Portable Extinguisher Sizes for Flooding an Enclosed Machinery Space (Halogenated Agents and ${\rm CO_2}$)

	Minimum Extinguisher	Maximum Compartment Volume		
Agent	lb	kg	-ft ³	m ³
CO_2	5	2.3	66	2
CO_2	10	4.5	133	4
CO_2	15	7	200	6
CO_2	20	9	266	7.5
Halon	$2\frac{1}{2}$	1	108	3
Halon	3	1.4	130	3.7
Halon	4	2	174	5
Halon	5	2.3	217	6
Halon	9	4	391	11
Halon	13	6	565	16
Halocarbon	USCG Classified B-1		108	3
Halocarbon	USCG Classified B-11		434	12

Notes

^{1.} Table 10-2.4.1 Represents extinguishers containing concentrations of 45 percent $\rm CO_2$ at 70°F (21°C) based on 0.075 lb agent/ft³ (1.2 kg/m³) or 5 percent halon at 70°F (21°C) based on 0.023 lb agent/ft³ (0.37 kg/m³).

^{2.} Halon means Halon 1211, Halon 13.01, or a mixture thereof.