

# NFPA 432

## Code for the Storage of Organic Peroxide Formulations

### 1997 Edition



National Fire Protection Association, 1 Batterymarch Park, PO Box 9101, Quincy, MA 02269-9101  
An International Codes and Standards Organization

Copyright ©  
National Fire Protection Association, Inc.  
One Batterymarch Park  
Quincy, Massachusetts 02269

## **IMPORTANT NOTICE ABOUT THIS DOCUMENT**

NFPA codes, standards, recommended practices, and guides, of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in its codes and standards.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on this document. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making this document available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of this document. Nor does the NFPA list, certify, test or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

## **NOTICES**

All questions or other communications relating to this document and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA documents during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

Users of this document should be aware that this document may be amended from time to time through the issuance of Tentative Interim Amendments, and that an official NFPA document at any point in time consists of the current edition of the document together with any Tentative Interim Amendments then in effect. In order to determine whether this document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments, consult appropriate NFPA publications such as the *National Fire Codes*® Subscription Service, visit the NFPA website at [www.nfpa.org](http://www.nfpa.org), or contact the NFPA at the address listed above.

A statement, written or oral, that is not processed in accordance with Section 5 of the Regulations Governing Committee Projects shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

The NFPA does not take any position with respect to the validity of any patent rights asserted in connection with any items which are mentioned in or are the subject of this document, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on this document. Users of this document are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Users of this document should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of this document, intend to urge action that is not in compliance with applicable laws, and this document may not be construed as doing so.

## **Licensing Policy**

This document is copyrighted by the National Fire Protection Association (NFPA). By making this document available for use and adoption by public authorities and others, the NFPA does not waive any rights in copyright to this document.

**1. Adoption by Reference**—Public authorities and others are urged to reference this document in laws, ordinances, regulations, administrative orders, or similar instruments. Any deletions, additions, and changes desired by the adopting authority must be noted separately. Those using this method are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. The term "adoption by reference" means the citing of title and publishing information only.

**2. Adoption by Transcription**—**A.** Public authorities with lawmaking or rule-making powers only, upon written notice to the NFPA (Attention: Secretary, Standards Council), will be granted a royalty-free license to print and republish this document in whole or in part, with changes and additions, if any, noted separately, in laws, ordinances, regulations, administrative orders, or similar instruments having the force of law, provided that: (1) due notice of NFPA's copyright is contained in each law and in each copy thereof; and (2) that such printing and republication is limited to numbers sufficient to satisfy the jurisdiction's lawmaking or rule-making process. **B.** Once this NFPA Code or Standard has been adopted into law, all printings of this document by public authorities with lawmaking or rule-making powers or any other persons desiring to reproduce this document or its contents as adopted by the jurisdiction in whole or in part, in any form, upon written request to NFPA (Attention: Secretary, Standards Council), will be granted a nonexclusive license to print, republish, and vend this document in whole or in part, with changes and additions, if any, noted separately, provided that due notice of NFPA's copyright is contained in each copy. Such license shall be granted only upon agreement to pay NFPA a royalty. This royalty is required to provide funds for the research and development necessary to continue the work of NFPA and its volunteers in continually updating and revising NFPA standards. Under certain circumstances, public authorities with lawmaking or rule-making powers may apply for and may receive a special royalty where the public interest will be served thereby.

**3. Scope of License Grant**—The terms and conditions set forth above do not extend to the index of this document.

(For further explanation, see the Policy Concerning the Adoption, Printing, and Publication of NFPA Documents, which is available upon request from the NFPA.)

Copyright © 1997 NFPA, All Rights Reserved

**NFPA 432**  
**Code for the**  
**Storage of Organic Peroxide Formulations**  
**1997 Edition**

This edition of NFPA 432, *Code for the Storage of Organic Peroxide Formulations*, was prepared by the Technical Committee on Hazardous Chemicals and acted on by the National Fire Protection Association, Inc., at its Annual Meeting held May 19–22, 1997, in Los Angeles, CA. It was issued by the Standards Council on July 24, 1997, with an effective date of August 15, 1997, and supersedes all previous editions.

Changes other than editorial are indicated by a vertical rule in the margin of the pages on which they appear. These lines are included as an aid to the user in identifying changes from the previous edition.

This edition of NFPA 432 was approved as an American National Standard on August 15, 1997.

**Origin and Development of NFPA 432**

The development of NFPA 432 (formerly NFPA 43B in previous editions) began in 1969 with the tentative adoption by the Association of NFPA 499-T, *Code for the Storage and Transportation of Oxidizing Materials and Organic Peroxides*. As a result of suggestions by reviewers of this Tentative Code, the Technical Committee on Storage, Handling and Transportation of Hazardous Chemicals decided to replace NFPA 499-T with two codes, one for the storage of liquid and solid oxidizing materials and the other for organic peroxides.

The Technical Committee experienced great difficulty in developing NFPA 43B, primarily because initial attempts to classify burning behavior of the various organic peroxides considered only the peroxide itself. By 1975, it had become apparent to the Committee that any classification system would have to take into account the composition of each formulation (i.e., concentration of peroxide, active oxygen, and diluent) and the strength and size of the shipping container, if an accurate assessment of fire and explosion hazard were to be made. By analyzing the characteristics of most of the commercially available organic peroxide formulations and by conducting a limited number of full-scale fire tests, the Committee developed a valid classification scheme and storage requirements.

The first edition of NFPA 43B was adopted at the 1985 NFPA Fall Meeting.

The 1993 edition of NFPA 43B contained enhanced fire protection and storage requirements for all classes of organic peroxide formulations. The Committee on Hazardous Chemicals clarified the storage limitations for both sprinklered and nonsprinklered storage of all classes of organic peroxide formulations. The Committee also clarified the separation distance from the storage of incompatible materials. In addition, Appendix B contained expanded and updated tables of typical organic peroxide formulations that include more listed formulations and information on temperature control recommendations as well as hazard identification ratings.

For this 1997 edition, NFPA 43B was redesignated as NFPA 432. Provisions were added to address the classification of electrical equipment on the interior of any nonventilated, nonrefrigerated storage cabinet used for the storage of Class I, II, or III organic peroxide formulations. In addition, a table alphabetizing all the organic peroxide formulations was added to Appendix B.

Revisions to the tables of Typical Class Formulations include the following:

- (a) Class I Formulations — The Health Hazard Identification Rating was revised for five organic peroxide formulations.
- (b) Class II Formulations — The Health Hazard Identification Rating was revised for eight organic peroxide formulations.
- (c) Class III Formulations — The Health Hazard Identification Rating was revised for 17 organic peroxide formulations, and the Flammability Hazard Identification Rating for cumyl hydroperoxide was also revised.
- (d) Class IV Formulations — The Health Hazard Identification Rating was revised for nine organic peroxide formulations.
- (e) Class V Formulations — The Health Hazard Identification Rating was revised for five organic peroxide formulations.
- (f) The classification for 2,4-Pentanedione Peroxide was revised.

Other changes were editorial in nature to bring the document into conformance with the NFPA *Manual of Style*.

## Technical Committee on Hazardous Chemicals

**John A. Davenport**, *Chair*  
Industrial Risk Insurers, CT [I]

**James E. Benge**, Hercules Chemical Specialties Co., DE [U]  
**William J. Bradford**, Brookfield, CT [SE]  
**James L. Daneker**, Los Angeles City Fire Dept., CA [E]  
Rep. NFPA Fire Service Section  
**August L. DeVico, II**, Environmental Strategies & Applications, Inc., NJ [SE]  
**Henry L. Febo, Jr.**, Factory Mutual Research Corp., MA [I]  
**H. Dieter Heinz**, Heinz Laboratories Int'l, CA [SE]  
**John M. Hoffmann**, Safety Engr Laboratories, Inc., MI [SE]  
**Bart Howard**, Davenport Fire Dept., IA [E]  
**Bruce A. Jacobsen**, Olin Chemicals Corp., TN [M]  
**Janice King Jensen**, U.S. Environmental Protection Agency, DC [I]  
**Brad Jones**, Jacobson Warehouse Co. Inc., IA [U]

**Roland J. Land**, Alexander & Alexander of New York, Inc., NY [I]  
**George H. Matthews**, N. Norwich, NY [SE]  
**Chester M. McCloskey**, The Norac Co. Inc., CA [M]  
**Robert A. Michaels**, RAM TRAC Corp., NY [SE]  
**David P. Nugent**, Schirmer Engr Corp., IL [SE]  
**Anthony M. Ordile**, Loss Control Assoc. Inc., PA [SE]  
**Gary A. Page**, American Home Products, NJ [M]  
**George W. Rambo**, GRCS Inc., VA [SE]  
**Sheila E. Toperosky**, Akzo Nobel Chemicals, TX [M]  
Rep. Society of the Plastics Industry Inc.  
**Gary F. Trojak**, Chlorine Inst. Inc., DC [M]  
Rep. The Chlorine Inst.  
**Michael A. Viggiani**, George Eastman House, NY [U]  
**Matthew C. Woody**, Des Moines Fire Dept., IA [E]

### Alternates

**Richard Cobb**, The Norac Co. Inc., CA [M]  
(Alt. to C. M. McCloskey)  
**Richard D. Gottwald**, Society of the Plastics Industry Inc., DC [M]  
(Alt. to S. E. Toperosky)

**Donald J. Hoffmann**, Safety Engr Laboratories, Inc., MI [SE]  
(Alt. to J. M. Hoffmann)  
**Peter F. Langan**, Industrial Risk Insurers, CT [I]  
(Alt. to J. A. Davenport)  
**P. Kirk Mitchell**, BioLab, Inc., GA [M]  
(Voting Alt. to BLI Rep.)

### Nonvoting

**Charles H. Ke**, U.S. Dept. of Transportation, DC  
**Samuel J. Porter**, Lakeridge, VA  
(Member Emeritus)

**Robert W. VanDolah**, CA  
(Member Emeritus)

**Martha H. Curtis**, NFPA Staff Liaison

**Committee Scope:** This Committee shall have primary responsibility for documents on, and maintain current codes for, classes of hazardous chemicals and codes for specific chemicals where these are warranted by virtue of widespread distribution or special hazards.

*This list represents the membership at the time the Committee was balloted on the text of this edition. Since that time, changes in membership may have occurred. A key to classifications is found at the back of this document.*

**NOTE:** Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

## Contents

<b>Chapter 1 General</b> . . . . .	<b>432- 4</b>	3-4 Storage Arrangement . . . . .	<b>432- 7</b>
1-1 Scope . . . . .	<b>432- 4</b>	3-5 Fire Protection . . . . .	<b>432- 7</b>
1-2 Purpose . . . . .	<b>432- 4</b>		
1-3 Applicability of Other Documents . . . . .	<b>432- 4</b>	<b>Chapter 4 Cut-off Storage</b> . . . . .	<b>432- 7</b>
1-4 Equivalency . . . . .	<b>432- 4</b>	4-1 Scope . . . . .	<b>432- 7</b>
1-5 Definitions . . . . .	<b>432- 4</b>	4-2 Basic Requirements . . . . .	<b>432- 7</b>
1-6 Classification of Organic Peroxide Formulations . . . . .	<b>432- 4</b>	4-3 Building Construction . . . . .	<b>432- 7</b>
1-7 Classification of Storage Facilities . . . . .	<b>432- 4</b>	4-4 Storage Arrangement . . . . .	<b>432- 8</b>
		4-5 Fire Protection . . . . .	<b>432- 8</b>
<b>Chapter 2 Basic Requirements</b> . . . . .	<b>432- 5</b>	<b>Chapter 5 Detached Storage</b> . . . . .	<b>432- 8</b>
2-1 Identification . . . . .	<b>432- 5</b>	5-1 Scope . . . . .	<b>432- 8</b>
2-2 Employee Instruction . . . . .	<b>432- 5</b>	5-2 Basic Requirements . . . . .	<b>432- 8</b>
2-3 Building Construction . . . . .	<b>432- 5</b>	5-3 Building Location . . . . .	<b>432- 8</b>
2-4 Heating and Cooling . . . . .	<b>432- 5</b>	5-4 Building Construction and Utilities . . . . .	<b>432- 8</b>
2-5 Electrical Installations . . . . .	<b>432- 5</b>	5-5 Fire Protection . . . . .	<b>432- 8</b>
2-6 Smoking . . . . .	<b>432- 5</b>		
2-7 Maintenance Operations . . . . .	<b>432- 5</b>	<b>Chapter 6 Referenced Publications</b> . . . . .	<b>432- 8</b>
2-8 Fire Protection . . . . .	<b>432- 5</b>		
2-9 Housekeeping and Waste Disposal . . . . .	<b>432- 6</b>	<b>Appendix A Explanatory Material</b> . . . . .	<b>432- 9</b>
2-10 Storage Limitations . . . . .	<b>432- 6</b>		
2-11 Storage Arrangements . . . . .	<b>432- 6</b>	<b>Appendix B Typical Organic Peroxide Formulations</b> . . . . .	<b>432-10</b>
<b>Chapter 3 Segregated Storage</b> . . . . .	<b>432- 7</b>		
3-1 Scope . . . . .	<b>432- 7</b>	<b>Appendix C Referenced Publications</b> . . . . .	<b>432-16</b>
3-2 Basic Requirements . . . . .	<b>432- 7</b>		
3-3 Building Construction . . . . .	<b>432- 7</b>	<b>Index</b> . . . . .	<b>432-17</b>

**NFPA 432****Code for the****Storage of Organic Peroxide Formulations****1997 Edition**

NOTICE: An asterisk (\*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Appendix A.

Information on referenced publications can be found in Chapter 6 and Appendix C.

**Chapter 1 General****1-1 Scope.**

**1-1.1** This code shall apply only to commercially available organic peroxide formulations in U.S. Department of Transportation- or Canadian Ministry of Transport-approved packages.

**1-1.2** This code shall not apply to the storage of such formulations in process areas where they are manufactured or used.

**1-1.3** This code does not apply to organic peroxide formulations that are capable of detonation in their normal shipping containers under conditions of fire exposure. Such formulations shall be handled and stored as Explosives 1.1 (formerly known as Class A) explosives in accordance with NFPA 495, *Explosive Materials Code*.

**1-2 Purpose.** The purpose of this code is to provide reasonable requirements for the safe storage of commercially available formulations containing organic peroxides.

**1-3 Applicability of Other Documents.** The requirements of NFPA 30, *Flammable and Combustible Liquids Code*, and NFPA 231, *Standard for General Storage*, shall apply where applicable and where they are more restrictive than this code.

**1-4 Equivalency.** Nothing in this standard is intended to prevent the use of systems, methods, or devices that provide equivalent protection from fire and explosion, provided that suitable data is available to demonstrate equivalency.

**1-5 Definitions.** For the purpose of this code, the following terms shall have the meanings given below.

**Approved.\*** Acceptable to the authority having jurisdiction.

**Authority Having Jurisdiction.\*** The organization, office, or individual responsible for approving equipment, an installation, or a procedure.

**Deflagration.** Propagation of a reaction zone at a velocity that is less than the speed of sound in the unreacted medium.

**Detonation.** Propagation of a reaction zone at a velocity that is at or above the speed of sound in the unreacted medium.

**Explosive Decomposition.** Rapid chemical reaction resulting in a large, almost instantaneous, release of energy. The term includes both deflagration and detonation.

**Incompatible Materials.** Materials that can initiate, catalyze, or accelerate the decomposition of organic peroxide formulations or that can cause hazardous reactions when in contact with such formulations. Information on incompatible

materials for organic peroxide formulations can be found in material safety data sheets (MSDS) or manufacturers' product bulletins.

**Labeled.** Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

**Listed.\*** Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets identified standards or has been tested and found suitable for a specified purpose.

**Organic Peroxide.** Any organic compound having a double oxygen or peroxy (-O-O-) group in its chemical structure.

**Organic Peroxide Formulation.\*** A pure organic peroxide or a mixture of one or more organic peroxides with one or more other materials in various combinations and concentrations.

**Organic Peroxide Storage Area.** An area used for the storage of organic peroxide formulations.

**Shall.** Indicates a mandatory requirement.

**Should.** Indicates a recommendation or that which is advised but not required.

**1-6\* Classification of Organic Peroxide Formulations.** For the purpose of this code, organic peroxide formulations shall be classified according to the system described in this section. The system is based on the behavior of certain specific formulations in their U.S. Department of Transportation- or Canadian Ministry of Transport-approved shipping containers and under conditions of fire exposure. (*See Appendix B for classification of typical organic peroxide formulations.*)

**1-6.1** Class I shall describe those formulations that are capable of deflagration but not detonation.

**1-6.2** Class II shall describe those formulations that burn very rapidly and that present a severe reactivity hazard.

**1-6.3** Class III shall describe those formulations that burn rapidly and that present a moderate reactivity hazard.

**1-6.4** Class IV shall describe those formulations that burn in the same manner as ordinary combustibles and that present a minimal reactivity hazard.

**1-6.5** Class V shall describe those formulations that burn with less intensity than ordinary combustibles or do not sustain combustion and that present no reactivity hazard.

**1-7 Classification of Storage Facilities.**

**1-7.1 Segregated storage** refers to storage in the same room or inside area, but physically separated by distance from incompatible materials. Sills, curbs, intervening storage of nonhazardous compatible materials, and aisles shall be permitted to be used as aids in maintaining spacing. (*See Chapter 3.*)

**1-7.2** *Cut-off storage* refers to storage in the same building or inside area, but physically separated from incompatible materials by partitions or walls. (See *Chapter 4*.)

**1-7.3** *Detached storage* refers to storage in either an open outside area or a separate building containing no incompatible materials and located away from all other structures. (See *Chapter 5*.)

## Chapter 2 Basic Requirements

**2-1 Identification.** All storage areas containing organic peroxide formulations shall be conspicuously identified by the words “Organic Peroxides” and by the class, as defined in Section 1-6.

**2-1.1\*** When organic peroxide formulations having different classifications as defined by Section 1-6 are stored in the same area, the area shall be marked for the most severe class present.

**2-1.2** Packages containing organic peroxide formulations shall be individually marked with the chemical name of the organic peroxide or with other pertinent information to allow proper area classification as required by this section.

**2-1.3** Packages containing organic peroxide formulations that require temperature control shall be marked with the recommended storage temperature range.

**2-2 Employee Instruction.** Personnel involved in operations in organic peroxide storage areas shall be instructed in proper and safe handling of such materials, proper use of personal protective equipment, proper and safe disposal of spilled material, and proper emergency procedures. Manufacturers’ instructions shall be consulted for each specific formulation.

**2-3 Building Construction.** Any construction materials that can be contacted by organic peroxide formulations shall be compatible with the materials stored.

### 2-4 Heating and Cooling.

**2-4.1** Storage areas shall be maintained within the recommended storage temperature range for the materials stored. (See *Appendix B* for compounds needing refrigeration systems.)

**2-4.2\*** Where the required storage temperature range extends beyond normal ambient temperatures, high or low temperature limit switches — as applicable — shall be provided in addition to the normal temperature controls. These limit switches shall actuate an alarm arranged to ensure prompt response.

**2-4.3** Heating systems shall use hot water, low pressure (less than 15 psig [103 kPa gauge]) steam, or indirectly heated warm air. Cooling systems shall not utilize direct expansion of a flammable gas.

**2-4.4** Heating coils, radiators, air diffusers, cooling coils, piping, and ducts shall be installed so as to prevent direct contact with containers and to prevent overheating or overcooling of the materials stored.

### 2-5 Electrical Installations.

**2-5.1** Electrical installations shall meet all applicable requirements of NFPA 70, *National Electrical Code*®.

**2-5.2** The interior of any refrigerator or freezer cabinet used for the storage of Class I, II, or III organic peroxide formulations shall be considered a Class I, Group D, Division 1 location as defined in Article 500 of NFPA 70, *National Electrical Code*. Any electrical equipment installed in the interior of such cabinets shall be approved for such use and shall be installed according to the requirements of Article 501 of NFPA 70, *National Electrical Code*.

**2-5.3** The interior of any nonventilated, nonrefrigerated storage cabinet used for the storage of Class I, II, or III organic peroxide formulations shall be considered a Class I, Division 1 location as defined in Article 500 of NFPA 70, *National Electrical Code*.

**2-5.4** Where the storage cabinet is ventilated, the electrical equipment shall be considered a Class I, Division 2 location as defined in Article 500 of NFPA 70, *National Electrical Code*. Mechanical ventilation systems shall provide at least 1 ft<sup>3</sup> per min per ft<sup>2</sup> of floor area (0.09 m<sup>2</sup> per min per 0.03 m<sup>3</sup>).

**2-6 Smoking.** Smoking shall be prohibited in all organic peroxide storage areas. “No Smoking” signs shall be placed conspicuously at all entrances to and within storage areas.

### 2-7 Maintenance Operations.

**2-7.1** Maintenance operations in organic peroxide storage areas shall be subject to prior review by and approval of supervisory personnel.

**2-7.2** Cutting and welding operations in organic peroxide storage areas shall not be conducted until all organic peroxide formulations have been removed. Cutting and welding operations shall be conducted according to the requirements of NFPA 51B, *Standard for Fire Prevention in Use of Cutting and Welding Processes*.

### 2-8 Fire Protection.

**2-8.1\*** Manual fire-fighting equipment shall be provided and maintained according to the requirements of NFPA 10, *Standard for Portable Fire Extinguishers*, and NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*.

**2-8.2\*** Where required by other provisions of this code, automatic sprinklers and water spray systems shall be designed and installed according to the requirements of NFPA 13, *Standard for the Installation of Sprinkler Systems*, and NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*, and shall provide the following discharge densities:

- Class I — 0.50 gpm/ft<sup>2</sup> (20.4 Lpm/m<sup>2</sup>)
- Class II — 0.40 gpm/ft<sup>2</sup> (16.3 Lpm/m<sup>2</sup>)
- Class III — 0.30 gpm/ft<sup>2</sup> (12.2 Lpm/m<sup>2</sup>)
- Class IV — 0.25 gpm/ft<sup>2</sup> (10.2 Lpm/m<sup>2</sup>)

For Class I organic peroxide formulations, see 5-5.2.

**2-8.2.1** The system shall be designed to provide the required density over a 3000 ft<sup>2</sup> (280 m<sup>2</sup>) area for areas protected by a wet pipe sprinkler system or 3900 ft<sup>2</sup> (360 m<sup>2</sup>) for areas protected by a dry pipe sprinkler system. The entire area of any building of less than 3000 ft<sup>2</sup> (280 m<sup>2</sup>) shall be used as the area of application.

**2-8.3** Where required, water supplies for automatic sprinklers, fire hydrants, and so forth, shall be provided in accordance with NFPA 24, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*, and shall be capable of supplying the anticipated demand for at least 90 minutes.



## 2-9 Housekeeping and Waste Disposal.

**2-9.1** Any accumulation of combustible waste in organic peroxide storage areas shall be prohibited.

**2-9.2\*** Spilled material and leaking or damaged containers and packages shall immediately be removed to a safe location for disposal.

**2-9.3** Specific disposal procedures shall be established for all organic peroxide storage areas. Disposal procedures shall conform to all applicable federal, state, and local regulations and with the manufacturers' recommendations.

## 2-10 Storage Limitations.

**2-10.1** Storage of organic peroxide formulations shall be limited to those areas within the scope of this code. The maximum allowable quantities of organic peroxide formulations that can be stored in a single area or building shall depend on the classification of the formulations and the classification of the storage facility, as set forth in Tables 2-10(a) and 2-10(b).

**2-10.1.1** The quantity of Class III organic peroxide formulations as it appears in Table 2-10(a) in cut-off storage shall be permitted to be increased to 20,000 lb (9070 kg) if the walls or partitions providing the cut-off have a fire resistance rating of at least 4 hours.

**2-10.1.2** Class I organic peroxide formulation cut-off storage as it appears in Table 2-10(b) shall have interior walls with a blast resistance of 432 psf (0.2 bar).

**2-10.1.3\*** Class I organic peroxide formulation cut-off storage as it appears in Table 2-10(b) shall have deflagration venting provided for exterior walls.

**2-10.2\*** Where two or more different classes of organic peroxide formulations are stored in the same area, the maximum quantity permitted shall be limited to the sum of the proportional amounts that each class bears to the maximum permitted for that class. The total of the proportional amounts shall not exceed 100 percent.

**2-10.3** Where the storage area is protected by a specially engineered fire protection system acceptable to the authority having jurisdiction, the quantity of organic peroxide formulations shall be permitted to be increased.

**2-10.4** Organic peroxide formulations shall not be stored where they can be exposed to explosive materials.

## 2-11 Storage Arrangements.

**2-11.1** Storage shall be arranged to facilitate manual access and handling, to maintain pile stability, to minimize breakage and spillage, and to promote good housekeeping.

**2-11.2** A clear space of at least 2 ft (0.6 m) shall be maintained between organic peroxide storage and uninsulated metal walls.

**Table 2-10(a) Maximum Allowable Quantity of Organic Peroxide Formulations in Nonsprinklered Buildings**

Class of Organic Peroxide Formulation	Segregated Storage		Cut-off Storage		Detached Storage Minimum Separation <sup>1</sup>					
					50 ft (15 m)		100 ft (30.5 m)		150 ft (46 m)	
	(lb)	(kg)	(lb)	(kg)	(lb)	(kg)	(lb)	(kg)	(lb)	(kg)
I	N/A	N/A	N/A	N/A	1000	454	4000	1810	10,000	4540
II	N/A	N/A	2000	907	20,000	9070	80,000	36,300	500,000	227,000
III	1500	680	3000	1360	70,000	31,800	200,000	90,700	750,000	340,000
IV	100,000	45,400	200,000	90,700	300,000	136,000	500,000	227,000	1,000,000	454,000
V	UNL	UNL	UNL	UNL	UNL	UNL	UNL	UNL	UNL	UNL

<sup>1</sup>Minimum separation means the distance from the line of property that is or can be built upon, including the opposite side of a public way, or the distance from the nearest important building on the same property.

N/A — Not Allowed

UNL — Unlimited

**Table 2-10(b) Maximum Allowable Quantity of Organic Peroxide Formulations in Sprinklered Buildings**

Class of Organic Peroxide Formulation	Segregated Storage		Cut-off Storage		Detached Storage Minimum Separation <sup>1</sup>					
					50 ft (15 m)		100 ft (30.5 m)		150 ft (46 m)	
	(lb)	(kg)	(lb)	(kg)	(lb)	(kg)	(lb)	(kg)	(lb)	(kg)
I	N/A	N/A	2000	907	2000	907	20,000	9070	175,000	79,400
II	4000	1810	50,000	22,700	100,000	45,400	200,000	90,700	UNL	UNL
III	50,000	22,700	100,000	45,400	200,000	90,700	UNL	UNL	UNL	UNL
IV	UNL	UNL	UNL	UNL	UNL	UNL	UNL	UNL	UNL	UNL
V	UNL	UNL	UNL	UNL	UNL	UNL	UNL	UNL	UNL	UNL

<sup>1</sup>Minimum separation means the distance from the line of property that is or can be built upon, including the opposite side of a public way, or the distance from the nearest important building on the same property.

N/A — Not Allowed

UNL — Unlimited

### 2-11.3 Separation Distance.

**2-11.3.1** Incompatible materials and flammable liquids shall not be stored within 25 ft (7.6 m) of organic peroxide formulations. The effective separation distance shall be maintained by floor slope, drains, or dikes to prevent liquid leakage from encroaching on the organic peroxide formulation storage area.

*Exception: Organic peroxide formulations that can also be classified as flammable liquids by their flash point shall be permitted to be stored with other organic peroxide formulations, and the more restrictive requirements of NFPA 30, Flammable and Combustible Liquids Code, or this code shall apply.*

**2-11.3.2** As an alternative to the 25-ft (7.6-m) separation distance, a 1-hr, liquid-tight fire barrier shall be permitted.

**2-11.4** Only closed containers and packages shall be permitted in storage areas.

**2-11.5** Storage of bags, drums, and other containers and packages of organic peroxide formulations shall be in accordance with Table 2-11.5.

**Table 2-11.5 Provisions for Storage Arrangement by Class of Organic Peroxide Formulation**

Class of Organic Peroxide Formulation	Max. Pile Height [ft (m)]	Max. Pile Width [ft (m)]	Min. Main Aisle Width [ft (m)]	Min. Additional Aisles Width [ft (m)]
I	6 (1.8)	4 (1.2)	8 (2.4)	4 (1.2)
II*	8 (2.4)	8 (2.4)	6 (1.8)	4 (1.2)
III*	8 (2.4)	8 (2.4)	6 (1.8)	4 (1.2)
IV	10 (3)	16 (4.9)	4 (1.2)	3 (0.9)
V	See 2-11.7.			

\*See 2-11.6.

**2-11.6\*** 55-gal (208-L) drum storage of Class II and Class III organic peroxide formulations shall be stored one high only.

**2-11.7** Storage of Class V organic peroxide formulations shall meet the requirements of NFPA 231, *Standard for General Storage*, or NFPA 231C, *Standard for Rack Storage of Materials*, as applicable.

## Chapter 3 Segregated Storage

**3-1 Scope.** This chapter shall apply to the storage of organic peroxide formulations when stored under segregated conditions as defined in Section 1-7 of this code and in quantities not exceeding those shown in Tables 2-10(a) and 2-10(b).

**3-2 Basic Requirements.** The basic requirements set forth in Chapter 2 shall apply to the segregated storage of organic peroxide formulations.

**3-3 Building Construction.** If there are any floors or open spaces located below the organic peroxide storage area, the floor of the storage area shall be made water-tight and shall be provided with drainage that leads to a safe location. Every means shall be taken to ensure that spilled material cannot run down into areas below the organic peroxide storage area.

### 3-4 Storage Arrangement.

**3-4.1** A minimum of 8 ft (2.4 m) of clear space shall be maintained between organic peroxide storage and any other storage.

**3-4.2** Segregated storage areas shall meet all applicable requirements of NFPA 231, *Standard for General Storage*, or NFPA 231C, *Standard for Rack Storage of Materials*, as applicable.

**3-4.3\*** A clear space of at least 4 ft (1.2 m) shall be maintained between organic peroxide storage and any walls of combustible or limited-combustible construction.

**3-5 Fire Protection.** Automatic sprinkler protection shall be provided for segregated storage areas in accordance with 2-8.2 and 2-8.3, under the following conditions:

(a) Storage areas of combustible construction containing Classes II, III, or IV organic peroxide formulations

(b) Storage areas of noncombustible construction where quantities exceed the following:

1. 100,000 lb (45,400 kg) of Class IV organic peroxide formulations
2. 1500 lb (680 kg) of Class III organic peroxide formulations
3. Any quantity of Class II organic peroxide formulation

## Chapter 4 Cut-off Storage

**4-1 Scope.** This chapter shall apply to the storage of organic peroxide formulations when stored under cut-off conditions as defined in Section 1-7 of this code and in quantities not exceeding those shown in Tables 2-10(a) and 2-10(b).

**4-2 Basic Requirements.** The basic requirements set forth in Chapter 2 shall apply to cut-off storage of organic peroxide formulations.

### 4-3 Building Construction.

**4-3.1** Cut-off storage areas for Class I, Class II, or any refrigerated organic peroxide formulations shall be single story, without basements or crawl spaces.

**4-3.2** Where any Class I organic peroxide formulations are stored in excess of 100 lb (45 kg), internal walls and any wall, roof, or ceiling that joins with another occupied building shall be capable of withstanding an internal overpressure of 432 psf (0.2 bar).

**4-3.3** Where Class II or any refrigerated organic peroxide formulations are stored, any internal walls or any wall, roof, or ceiling that joins with another occupied building shall be capable of withstanding an internal overpressure of 125 psf (0.06 bar).

**4-3.4\*** For Class I, Class II, or any refrigerated organic peroxide formulation that gives off flammable gases upon decomposition, the storage area shall be provided with deflagration venting.

**4-3.5** Any walls common with another building shall have a fire resistance of at least 2 hours, as measured by the procedure described in NFPA 251, *Standard Methods of Fire Endurance of Building Construction and Materials*.

**4-3.5.1** Any door or window openings in such walls shall be protected by approved fire doors and fire windows suitable for

the opening and shall be installed according to NFPA 80, *Standard for Fire Doors and Fire Windows*.

**4-4\* Storage Arrangement.** A clear space of at least 4 ft (1.2 m) shall be maintained between organic peroxide storage and any walls of combustible or limited-combustible construction.

**4-5 Fire Protection.**

**4-5.1** Automatic sprinkler protection in accordance with 2-8.2 and 2-8.3 shall be provided for all storage areas of combustible construction, regardless of the class of formulation stored.

**4-5.2** Automatic sprinkler protection shall be provided for all storage areas of noncombustible construction where any quantity of Class I organic peroxide formulations are stored.

**4-5.3** Automatic sprinkler protection shall also be provided for all storage areas of noncombustible construction where quantities exceed the following:

- (a) 2000 lb (907 kg) of Class II organic peroxide formulations
- (b) 3000 lb (1360 kg) of Class III organic peroxide formulations
- (c) 200,000 lb (90,700 kg) of Class IV organic peroxide formulations

**Chapter 5 Detached Storage**

**5-1 Scope.** This chapter shall apply to the storage of organic peroxide formulations when stored under detached conditions as defined in Section 1-7 and in quantities and at separation distances as specified in Tables 2-10(a) and 2-10(b).

**5-2 Basic Requirements.** The basic requirements set forth in Chapter 2 shall apply to detached storage of organic peroxide formulations.

**5-3 Building Location.**

**5-3.1\*** Detached storage buildings shall be separated from the lines of property that are or can be built upon, including the opposite side of a public way, or from the nearest important building on the same property.

**5-3.2** For Classes II, III, and IV organic peroxide formulations, detached storage buildings separated by less than 50 ft (15.3 m) shall be considered to be a single area when applying the limits for Tables 2-10(a) and 2-10(b).

**5-3.3** For Class I organic peroxide formulations, detached storage buildings shall be separated from each other in accordance with Table 5-3.3.

**Table 5-3.3 Separation of Individual Storage Buildings**

Nonsprinklered				Automatic Sprinklered			
Quantity		Distance		Quantity		Distance	
(lb)	(kg)	(ft)	(m)	(lb)	(kg)	(ft)	(m)
1000	454	20	6	2000	907	20	6

**Table 5-3.3 Separation of Individual Storage Buildings (Continued)**

Nonsprinklered				Automatic Sprinklered			
Quantity		Distance		Quantity		Distance	
(lb)	(kg)	(ft)	(m)	(lb)	(kg)	(ft)	(m)
4000	1810	75	23	20,000	9070	75	23
10,000	4540	100	30	175,000	79,400	100	30

**5-4 Building Construction and Utilities.**

**5-4.1** Detached storage buildings shall be single story, without basement or crawl space.

**5-4.2** Nonsprinklered buildings for storing more than 5000 lb (2270 kg) of Class I, Class II, or any refrigerated organic peroxide formulation that gives off flammable gases upon decomposition shall be built of noncombustible construction.

**5-4.3\*** Buildings of combustible construction employing sun shields such as those illustrated in Figure A-5-4.3 shall be permitted to be used for detached storage buildings storing less than 5000 lb (2270kg) of organic peroxide formulations in those areas where the temperature inside the storage building can approach or exceed the maximum recommended storage temperature.

**5-5 Fire Protection.**

**5-5.1** Where required, automatic sprinkler systems and their water supplies shall meet the requirements of 2-8.2 and 2-8.3.

**5-5.2** Where required for Class I organic peroxide formulations in quantities exceeding 2000 lb (907 kg), automatic sprinkler protection shall be open-head deluge-type, designed and installed in accordance with NFPA 13, *Standard for the Installation of Sprinkler Systems*.

**Chapter 6 Referenced Publications**

**6-1** The following documents or portions thereof are referenced within this code as mandatory requirements and shall be considered part of the requirements of this code. The edition indicated for each referenced mandatory document is the current edition as of the date of the NFPA issuance of this code. Some of these mandatory documents might also be referenced in this code for specific informational purposes and, therefore, are also listed in Appendix C.

**6-1.1 NFPA Publications.** National Fire Protection Association, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101.

NFPA 10, *Standard for Portable Fire Extinguishers*, 1994 edition.  
NFPA 13, *Standard for the Installation of Sprinkler Systems*, 1996 edition.

NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*, 1996 edition.

NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*, 1996 edition.

NFPA 24, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*, 1995 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 1996 edition.

NFPA 51B, *Standard for Fire Prevention in Use of Cutting and Welding Processes*, 1994 edition.

NFPA 70, *National Electrical Code*®, 1996 edition.

NFPA 80, *Standard for Fire Doors and Fire Windows*, 1995 edi-

NFPA 231C, *Standard for Rack Storage of Materials*, 1995 edition.

NFPA 251, *Standard Methods of Fire Endurance of Building Construction and Materials*, 1995 edition.

NFPA 495, *Explosive Materials Code*, 1996 edition.

## Appendix A Explanatory Material

*This Appendix is not part of the requirements of this NFPA document but is included for informational purposes only.*

**A-1-5 Approved.** The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

**A-1-5 Authority Having Jurisdiction.** The phrase “authority having jurisdiction” is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

**A-1-5 Listed.** The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

**A-1-5 Organic Peroxide Formulation.** Terms such as “accelerator,” “catalyst,” “initiator,” and so forth, are sometimes used to describe organic peroxide formulations. These terms are misleading because they can also refer to materials that are not or do not contain organic peroxides, some of which might present increased hazard when mixed with organic peroxides.

**A-1-6** Test procedures described in *United Nations Recommendation on Transportation of Dangerous Goods, Tests and Criteria* are useful in determining the classification of organic peroxide formulations.

**A-2-1.1** The classification system described in Section 1-6 is used only to determine the storage requirements established by this code. It is not meant to be a substitute for the hazard

identification system established by NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*. Since the hazard characteristics of organic peroxide formulations vary widely depending on the type of organic peroxide, the diluent, and their relative concentrations, each specific formulation will have to be rated individually according to the criteria established in NFPA 704.

**A-2-4.2** Considerations should be given for maintaining proper refrigeration capability in the event of a loss of power. Some materials when frozen could cause separation of a carrier from the organic peroxide.

**A-2-8.1** Manual fire-fighting equipment can consist of small hose equipped with adjustable spray nozzles or portable fire extinguishers suitable for Class A and for Class B:C fires, or both. Manual fire fighting in storage areas should be undertaken only by those having a clear understanding of the storage conditions and the characteristics of fires involving organic peroxides.

**A-2-8.2** The use of high-expansion foam or liquid nitrogen flooding can be substituted for automatic sprinkler protection if installed subject to the approval of the authority having jurisdiction.

**A-2-9.2** The method of disposal can vary depending on the specific formulation and materials with which they might have been contaminated. Refer to the manufacturer or the supplier of the specific formulation for advice.

**A-2-10.1.3** See A-4-3.4.

**A-2-10.2** For example, a sprinklered building, detached by 50 ft (15.3 m), can contain up to 500 lb (227 kg) of Class I, 50,000 lb (22,700 kg) of Class II, and 50,000 lb (22,700 kg) of Class III formulations, according to the following ratios:

Class I:

$$\frac{500 \text{ lb}}{200 \text{ lb (max)}} \times 100 = 25\% \quad \frac{227 \text{ kg}}{907 \text{ kg (max)}} \times 100 = 25\%$$

Class II:

$$\frac{50,000 \text{ lb}}{100,000 \text{ lb (max)}} \times 100 = 50\% \quad \frac{22,700 \text{ kg}}{45,400 \text{ kg (max)}} \times 100 = 50\%$$

Class III:

$$\frac{50,000 \text{ lb}}{200,000 \text{ lb (max)}} \times 100 = 25\% \quad \frac{22,700 \text{ lb}}{90,700 \text{ lb (max)}} \times 100 = 25\%$$

In no case does the quantity in storage exceed the maximum for its class, nor does the sum of the percentages exceed 100 percent.

**A-2-11.6** Since no commercially available Class I organic peroxide formulations are supplied in 55-gal (208-L) drums, there is no requirement for such storage.

**A-3-4.3** For information on combustible or limited-combustible construction, see NFPA 220, *Standard on Types of Building Construction*.

**A-4-3.4** In the venting equation, use the fuel characteristic constant for “gases with fundamental burning velocity less than 1.3 times that of propane.” See NFPA 68, *Guide for Venting of Deflagrations*, for information on vent design. Refer to manufacturers’ technical data for information on organic peroxide formulations that give off flammable gases upon decomposition.

**A-4-4** For information on combustible or limited-combustible construction, see NFPA 220, *Standard on Types of Building Construction*.

**A-5-3.1** For the purpose of this document, an important building is one that is occupied or that contains facilities vital to the operation of the plant.

**A-5-4.3** Figure A-5-4.3 is an example of a building for storing less than 5000 lb (2270 kg) of organic peroxide formulations for detached storage as allowed by 5-4.3.

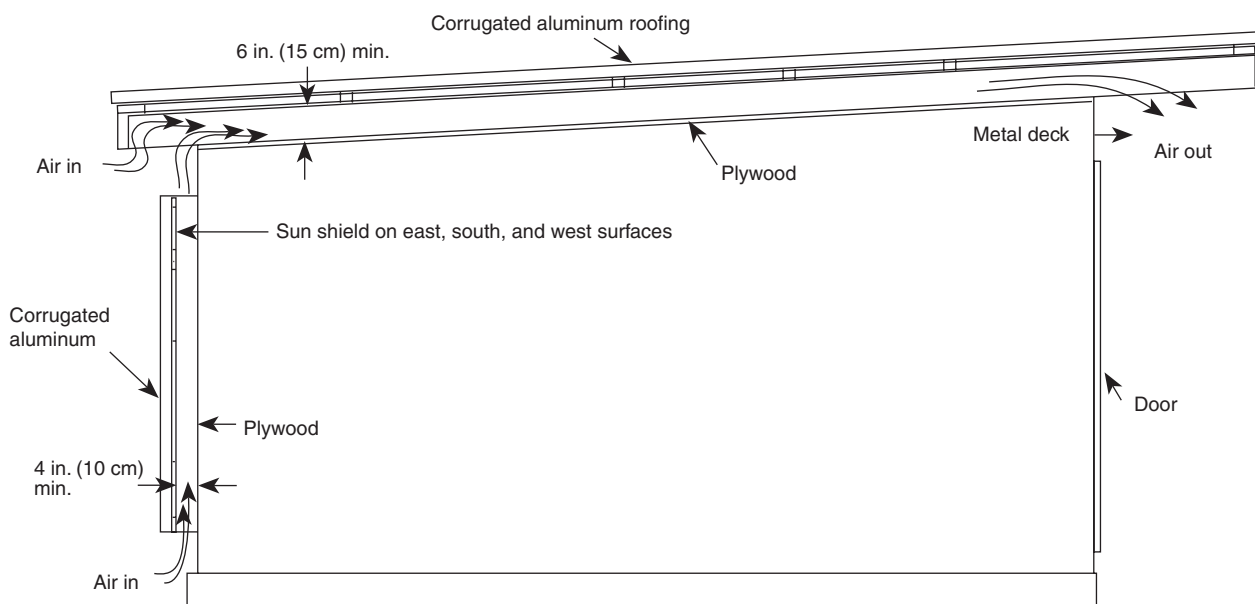


Figure A-5-4.3 Detached storage building for storing less than 5000 lb (2270 kg) of organic peroxide formulations.

## Appendix B Typical Organic Peroxide Formulations

*This appendix is not a part of the requirements of this NFPA document but is included for informational purposes only.*

**B-1 General.** The assignment of the organic peroxide formulation classifications shown in the tables in this Appendix are based on the container sizes shown. A change in the container size could affect the classification.

For alphabetical listing of typical organic peroxide formulations, see Table B-1.

### B-2 Class I Formulations.

**B-2.1 Fire Hazard Characteristics.** Class I formulations present a deflagration hazard through easily initiated, rapid explosive decomposition. Class I includes some formulations that are relatively safe only under closely controlled temperatures. Either excessively high or low temperatures can increase the potential for severe explosive decomposition.

**B-2.2 Fire-Fighting Information.** The immediate area should be evacuated and the fire should be fought from a remote location. Some damage to structures from overpressure can be expected should a deflagration occur.

**B-2.3 Typical Class I Formulations.** See Table B-2.3.

### B-3 Class II Formulations.

**B-3.1 Fire-Hazard Characteristics.** Class II formulations present a severe fire hazard similar to Class I flammable liquids. The decomposition is not as rapid, violent, or complete as that produced by Class I formulations. As with Class I formulations, this class includes some formulations that are relatively safe when under controlled temperatures or when diluted.

**B-3.2 Fire-Fighting Information.** Fires should be fought from a safe distance, since a hazard exists from rupturing containers.

**B-3.3 Typical Class II Formulations.** See Table B-3.3.

### B-4 Class III Formulations.

**B-4.1 Fire Hazard Characteristics.** Class III formulations present a fire hazard similar to Class II combustible liquids. They are characterized by rapid burning and high heat liberation due to decomposition.

**B-4.2 Fire-Fighting Information.** Caution should be observed due to possible unexpected increases in fire intensity.

**B-4.3 Typical Class III Formulations.** See Table B-4.3.

Table B-1 Class Index of Organic Peroxide Formulations

Organic Peroxide Formulation	Concentration	Diluent	Container	Class
t-Amyl Hydroperoxide	88	Water	55 gal (208 L)	III
t-Amyl Peroxyacetate	60	OMS	5 gal (19 L)	III
t-Amyl Peroxybenzoate	96	—	5 gal (19 L)	II
t-Amyl Peroxy-2-ethylhexanoate	96	—	55 gal (208 L)	III
t-Amyl Peroxyneodecanoate	75	OMS	5 gal (19 L)	III
t-Amyl Peroxypivalate	75	OMS	5 gal (19 L)	III
t-Butyl Cumyl Peroxide	95	—	55 gal (208 L)	IV
n-Butyl 4,4-Di(t-butylperoxy)valerate	98	—	5 gal (19 L)	II
t-Butyl Hydroperoxide	90	Water & t-BuOH	5 gal (19 L)	I
t-Butyl Hydroperoxide	70	DTBP & t-BuOH	55 gal (208 L)	II
t-Butyl Hydroperoxide	70	Water	55 gal (208 L)	IV
t-Butyl Peroxyacetate	75	OMS	5 gal (19 L)	I
t-Butyl Peroxyacetate	60	OMS	5 gal (19 L)	I
t-Butyl Peroxybenzoate	98	—	5 gal (19 L)	II
t-Butyl Peroxy-2-ethylhexanoate	97	—	5 gal (19 L)	III
t-Butyl Peroxy-2-ethylhexanoate	97	—	55 gal (208 L)	II
t-Butyl Peroxy-2-ethylhexanoate	50	DOP or OMS	5 gal (19 L)	IV
t-Butyl Peroxy-2-ethylhexanoate	50	DOP or OMS	55 gal (208 L)	III
t-Butylperoxy 2-Ethylhexyl Carbonate	95	—	5 gal (19 L)	III
t-Butyl Peroxyisobutyrate	75	OMS	5 gal (19 L)	II
t-Butylperoxy Isopropyl Carbonate	92	OMS	5 gal (19 L)	I
t-Butylperoxy Isopropyl Carbonate	75	OMS	5 gal (19 L)	II
t-Butyl Peroxymaleate	98	—	50 × 1 lb (50 × 0.5 kg)	I
t-Butyl Peroxyneodecanoate	75	OMS	5 gal (19 L)	III
t-Butyl Peroxypivalate	75	OMS	5 gal (19 L)	II
t-Butyl Peroxypivalate	45	OMS	5 gal (19 L)	IV
Cumyl Hydroperoxide	88	Cumene	55 gal (208 L)	III
Cumyl Peroxyneodecanoate	75	OMS	5 gal (19 L)	III
Cumyl Peroxyneoheptanoate	75	OMS	5 gal (19 L)	III
Diacetyl Peroxide	25	DMP	5 gal (19 L)	II
1,1-Di(t-amylperoxy)cyclohexane	80	OMS or BBP	5 gal (19 L)	III
Dibenzoyl Peroxide	98	—	1 lb (0.5 kg)	I
Dibenzoyl Peroxide	78	Water	25 lb (11 kg)	II
Dibenzoyl Peroxide	75	Water	25 lb (11 kg)	III
Dibenzoyl Peroxide	70	Water	25 lb (11 kg)	IV
Dibenzoyl Peroxide paste	55	Plasticizer	350 lb (160 kg)	III
Dibenzoyl Peroxide paste	55	Plasticizer & Water	350 lb (160 kg)	IV
Dibenzoyl Peroxide paste	50	Plasticizer	380 lb (170 kg)	III
Dibenzoyl Peroxide paste	50	Plasticizer & Water	380 lb (170 kg)	IV
Dibenzoyl Peroxide slurry	40	Water & Plasticizer	380 lb (170 kg)	IV
Dibenzoyl Peroxide slurry	40	Water	5 gal (19 L)	IV
Dibenzoyl Peroxide powder	35	Dicalcium Phosphate Dihydrate or Calcium Sulfate Dihydrate	100 lb (45 kg)	V

Table B-1 Class Index of Organic Peroxide Formulations (Continued)

Organic Peroxide Formulation	Concentration	Diluent	Container	Class
Dibenzoyl Peroxide powder	35	Starch	100 lb (45 kg)	IV
Di (4-t-butylcyclohexyl) Peroxydicarbonate	98	—	88 lb (40 kg)	III
Di-t-butyl Peroxide	99	—	55 gal (208 L)	III
2,2-Di(t-butylperoxy)butane	50	Toluene	1 gal (4 L)	I
1,1-Di(t-butylperoxy)cyclohexane	80	OMS or BBP	5 gal (19 L)	II
Di-sec-butyl Peroxydicarbonate	98	—	1 gal (4 L)	II
Di-sec-butyl Peroxydicarbonate	75	OMS	5 gal (19 L)	II
Di(2-t-butylperoxyisopropyl)benzene	96	—	100 lb (45 kg)	III
Di(2-t-butylperoxyisopropyl)benzene	40	Clay	100 lb (45 kg)	V
Di(butylperoxy) Phthalate	40	DBP	30 gal (110 L)	IV
1,1-Di-(t-butylperoxy)- 3,3,5-trimethylcyclohexane	75—95	—	5 gal (19 L)	II
1,1-Di-(t-butylperoxy)- 3,3,5-trimethylcyclohexane	40	Calcium Carbonate	100 lb (45 kg)	V
Dicetyl Peroxydicarbonate	85	—	20 kg (44 lb)	IV
2,4-Dichlorobenzoyl Peroxide	50	DBP & Silicone	5 gal (19 L)	III
Dicumyl Peroxide	98	—	55 gal (208 L)	IV
Dicumyl Peroxide	40	Clay or Calcium Carbonate	100 lb (45kg)	V
Didecanoyl Peroxide	98	—	50 lb (23 kg)	III
Di(2-ethylhexyl) Peroxydicarbonate	97	—	1 gal (4 L)	II
Di(2-ethylhexyl) Peroxydicarbonate	40	OMS	5 gal (19 L)	IV
Diisopropyl Peroxydicarbonate	99	—	10 lb (4.5 kg)	I
Diisopropyl Peroxydicarbonate	30	Toluene	5 lb (2.3 kg)	III
Di-n-propyl Peroxydicarbonate	98	—	1 gal (4 L)	I
Di-n-propyl Peroxydicarbonate	85	OMS	1 gal (4 L)	I
Dilauroyl Peroxide	98	—	110 lb (50 kg)	IV
2,5-Dimethyl-2,5-di(benzoylperoxy)hexane	95	—	4 × 5 lb (4 × 2.3 kg)	II
2,5-Dimethyl-2,5-di(t-butylperoxy)hexane	92	—	30 gal (110 L)	III
2,5-Dimethyl-2,5-di(t-butylperoxy)hexane	47	Calcium Carbonate or Silica	100 lb (45 kg)	V
2,5-Dimethyl-2,5-di(2-ethylhexanoylperoxy) hexane	90	—	5 gal (19 L)	III
2,5-Dimethyl-2,5-dihydroperoxyhexane	70	Water	100 lb (45 kg)	II
Ethyl 3,3-Di(t-amylperoxy)butyrate	75	OMS	5 gal (19 L)	III
Ethyl 3,3-Di(t-amylperoxy)butyrate	40	Clay or Calcium Silicate	100 lb (45 kg)	V
p-Menthyl Hydroperoxide	54	Alcohols & Ketones	55 gal (208 L)	IV
Methyl Ethyl Ketone Peroxide	9% AO	DMP	5 gal (19 L)	III
Methyl Ethyl Ketone Peroxide	5.5% AO	DMP	5 gal (19 L)	IV
Methyl Ethyl Ketone Peroxide	9% AO	Water & Glycols	5 gal (19 L)	IV
Methyl Ethyl Ketone Peroxide and Cyclohexanone Peroxide mixture	9% AO	DMP	5 gal (19 L)	III
2,4-Pentanedione Peroxide	4% AO	Water & Solvent	5 gal (19 L)	IV
Peroxyacetic Acid	43	Water, HOAc, & H2O2	30 gal (110 L)	II

NOTE: Diluents: OMS — odorless mineral spirits; t-Bu-OH — Tertiary Butanol; DTBP — Di-tertiary-butylperoxide; DOP — Dioctyl Phthalate; BBP — Butyl Benzyl Phthalate; DBP — Dibutyl Phthalate; DMP — Dimethyl Phthalate; HOAc — Acetic Acid; H<sub>2</sub>O<sub>2</sub> — Hydrogen Peroxide.

Table B-2.3 Typical Class I Formulations

Organic Peroxide Formulation	Nominal Concentration, Weight Percent	Diluent	Individual Container Size	Temp. Control	Hazard Identification <sup>1</sup>		
					Health	Flamm.	Reactivity
t-Butyl Hydroperoxide	90	Water & t-BuOH	5 gal (19 L)		3	3	3
t-Butyl Peroxyacetate	75	OMS	5 gal (19 L)		1	3	3
t-Butyl Peroxyacetate	60	OMS	5 gal (19 L)		1	3	3
t-Butylperoxy Isopropyl Carbonate	92	OMS	5 gal (19 L)		1	3	3
t-Butyl Peroxymaleate	98	—	50 × 1 lb (50 × 0.5 kg)		2	3	3
Dibenzoyl Peroxide	98	—	1 lb (0.5 kg)		1	3	4
2,2-Di(t-butylperoxy)butane	50	Toluene	1 gal (4 L)		1	3	3
Diisopropyl Peroxydicarbonate	99	—	10 lb (4.5 kg)	R	2	3	4
Di-n-propyl Peroxydicarbonate	98	—	1 gal (4 L)	R	2	3	4
Di-n-propyl Peroxydicarbonate	85	OMS	1 gal (4 L)	R	2	3	3

R — Refrigeration recommended to reduce fire hazard.

OMS — Odorless Mineral Spirits

t-BuOH — tertiary-Butanol

<sup>1</sup>The column refers to NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*, hazard ratings for health, flammability, and reactivity. See NFPA 704 for details.

Table B-3.3 Typical Class II Formulations

Organic Peroxide Formulation	Nominal Concentration, Weight Percent	Diluent	Individual Container Size	Temp. Control	Hazard Identification <sup>1</sup>		
					Health	Flamm.	Reactivity
t-Amyl Peroxybenzoate	96	—	5 gal (19 L)		2	3	2
n-Butyl 4,4-Di(t-butylperoxy)valerate	98	—	5 gal (19 L)		2	3	2
t-Butyl Hydroperoxide	70	DTBP & t-BuOH	55 gal (208 L)		3	3	3
t-Butyl Peroxybenzoate	98	—	5 gal (19 L)		1	3	3
t-Butyl Peroxy-2-ethylhexanoate	97	—	55 gal (208 L)	R	1	3	3
t-Butyl Peroxyisobutyrate	75	OMS	5 gal (19 L)	R	2	3	3
t-Butylperoxy Isopropyl Carbonate	75	OMS	5 gal (19 L)		1	3	3
t-Butyl Peroxypivalate	75	OMS	5 gal (19 L)	R	2	3	3
Diacetyl Peroxide	25	DMP	5 gal (19 L)	T	2	3	3
Dibenzoyl Peroxide	78	Water	25 lb (11 kg)		1	2	3
1,1-Di(t-butylperoxy)cyclohexane	80	OMS or BBP	5 gal (19 L)		1	3	3
Di-sec-butyl Peroxydicarbonate	98	—	1 gal (4 L)	R	1	3	3
Di-sec-butyl Peroxydicarbonate	75	OMS	5 gal (19 L)	R	1	3	3
1,1-Di(t-butylperoxy)-3,3,5-trimethylcyclohexane	75-95	—	5 gal (19 L)		2	3	3
Di(2-ethylhexyl) Peroxydicarbonate	97	—	1 gal (4 L)	R	1	3	3
2,5-Dimethyl-2,5-di-(benzoylperoxy)hexane	95	—	4 × 5 lb (4 × 2.3 kg)		2	3	3
2,5-Dimethyl-2,5-dihydroperoxyhexane	70	Water	100 lb (45 kg)		2	3	3
Peroxyacetic Acid	43	Water HOAc & H <sub>2</sub> O <sub>2</sub>	30 gal (110 L)		3	2	3

R — Refrigeration recommended to reduce fire hazard.

T — Temperature control should be considered to reduce fire hazard depending on packaging size and recommendations in manufacturers' literature.

BBP — Butyl Benzyl Phthalate

DMP — Dimethyl Phthalate

DTBP — Di-tertiary-butyl Peroxide

HOAc — Acetic Acid

H<sub>2</sub>O<sub>2</sub> — Hydrogen Peroxide

OMS — Odorless Mineral Spirits

t-BuOH — tertiary-Butanol

<sup>1</sup>The column refers to NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*, hazard ratings for health, flammability, and reactivity. See NFPA 704 for details.



Table B-4.3 Typical Class III Formulations

Organic Peroxide Formulation	Nominal Concentration, Weight Percent	Diluent	Individual Container Size	Temp. Control	Hazard Identification <sup>1</sup>		
					Health	Flamm.	Reactivity
t-Amyl Hydroperoxide	88	Water	55 gal (208 L)		3	3	2
t-Amyl Peroxyacetate	60	OMS	5 gal (19 L)		2	3	2
t-Amyl Peroxy-2-ethylhexanoate	96	—	55 gal (208 L)	R	0	3	2
t-Amyl Peroxyneodecanoate	75	OMS	5 gal (19 L)	R	1	3	2
t-Amyl Peroxypivalate	75	OMS	5 gal (19 L)	R	1	3	2
t-Butyl Peroxy-2-ethylhexanoate	97	—	5 gal (19 L)	R	1	3	2
t-Butyl Peroxy-2-ethylhexanoate	50	DOP or OMS	55 gal (208 L)	R	1	2	2
t-Butylperoxy 2-Ethylhexyl Carbonate	95	—	5 gal (19 L)		1	3	2
t-Butyl Peroxyneodecanoate	75	OMS	5 gal (19 L)	R	2	3	2
Cumyl Hydroperoxide	88	Cumene	55 gal (208 L)		3	2	2
Cumyl Peroxyneodecanoate	75	OMS	5 gal (19 L)	R	1	3	2
Cumyl Peroxyneoheptanoate	75	OMS	5 gal (19 L)	R	2	3	2
1,1-Di(t-amylperoxy)cyclohexane	80	OMS or BBP	5 gal (19 L)		2	3	2
Dibenzoyl Peroxide	75	Water	25 lb (11 kg)		1	2	2
Dibenzoyl Peroxide paste	55	Plasticizer	350 lb (160 kg)	T	1	2	2
Dibenzoyl Peroxide paste	50	Plasticizer	380 lb (170 kg)	T	1	2	2
Di(4-t-butylcyclohexyl) Peroxydicarbonate	98	—	88 lb (40 kg)		1	3	2
Di-t-butyl Peroxide	99	—	55 gal (208 L)		1	3	2
Di(2-t-butylperoxyisopropyl) benzene	96	—	100 lb (45 kg)		1	2	2
2,4-Dichlorobenzoyl Peroxide	50	DBP & Silicone	5 gal (19 L)	T	1	2	2
Didecanoyl Peroxide	98	—	50 lb (23 kg)	R	1	3	2
Diisopropyl Peroxydicarbonate	30	Toluene	5 gal (19 L)	R	2	3	2
2,5-Dimethyl-2,5-di-(2-ethylhexanoylperoxy)hexane	90	—	5 gal (19 L)	R	0	3	2
2,5-Dimethyl-2,5-di-(t-butylperoxy)hexane	92	—	30 gal (110 L)		2	3	2
Ethyl 3,3-Di(t-amylperoxy)butyrate	75	OMS	5 gal (19 L)		1	3	2
Ethyl 3,3-Di(t-butylperoxy)butyrate	75	OMS	5 gal (19 L)		2	2	2
Methyl Ethyl Ketone Peroxide	9% AO	DMP	5 gal (19 L)		3	2	2
Methyl Ethyl Ketone Peroxide and Cyclohexanone Peroxide mixture	9% AO	DMP	5 gal (19 L)		3	2	2

R — Refrigeration recommended to reduce fire hazard.

T — Temperature control should be considered to reduce fire hazard depending on packaging size and recommendations in manufacturers' literature.

AO — Active Oxygen

BBP — Butyl Benzyl Phthalate

DBP — Dibutyl Phthalate

DMP — Dimethyl Phthalate

DOP — Dioctyl Phthalate

OMS — Odorless Mineral Spirits

<sup>1</sup>The column refers to NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*, hazard ratings for health, flammability, and reactivity. See NFPA 704 for details.