



UL 1815

STANDARD FOR SAFETY

Nonducted Heat Recovery Ventilators

[ULNORM.COM](https://www.ulnorm.com) : Click to view the full PDF of UL 1815 2021

[ULNORM.COM](https://ulnorm.com) : Click to view the full PDF of UL 1815 2021

UL Standard for Safety for Nonducted Heat Recovery Ventilators, UL 1815

Fifth Edition, Dated February 29, 2012

Summary of Topics

This revision to UL 1815 dated December 7, 2021 includes a revision to the test requirement to add the option of performing the dielectric voltage-withstand test using a DC potential equivalent to the AC potential; [49.1](#), [Table 49.1](#), [68.1](#), and [Table 68.1](#)

Text that has been changed in any manner or impacted by UL's electronic publishing system is marked with a vertical line in the margin.

The new and revised requirements are substantially in accordance with Proposal(s) on this subject dated October 8, 2021.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form by any means, electronic, mechanical photocopying, recording, or otherwise without prior permission of UL.

UL provides this Standard "as is" without warranty of any kind, either expressed or implied, including but not limited to, the implied warranties of merchantability or fitness for any purpose.

In no event will UL be liable for any special, incidental, consequential, indirect or similar damages, including loss of profits, lost savings, loss of data, or any other damages arising out of the use of or the inability to use this Standard, even if UL or an authorized UL representative has been advised of the possibility of such damage. In no event shall UL's liability for any damage ever exceed the price paid for this Standard, regardless of the form of the claim.

Users of the electronic versions of UL's Standards for Safety agree to defend, indemnify, and hold UL harmless from and against any loss, expense, liability, damage, claim, or judgment (including reasonable attorney's fees) resulting from any error or deviation introduced while purchaser is storing an electronic Standard on the purchaser's computer system.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 1815 2021

FEBRUARY 29, 2012

(Title Page Reprinted: December 7, 2021)

1

UL 1815

Standard for Nonducted Heat Recovery Ventilators

First Edition – April, 1990
Second Edition – April, 1995
Third Edition – November, 2001
Fourth Edition – October, 2009

Fifth Edition

February 29, 2012

This UL Standard for Safety consists of the Fifth Edition including revisions through December 7, 2021.

Comments or proposals for revisions on any part of the Standard may be submitted to UL at any time. Proposals should be submitted via a Proposal Request in UL's On-Line Collaborative Standards Development System (CSDS) at <https://csds.ul.com>.

UL's Standards for Safety are copyrighted by UL. Neither a printed nor electronic copy of a Standard should be altered in any way. All of UL's Standards and all copyrights, ownerships, and rights regarding those Standards shall remain the sole and exclusive property of UL.

COPYRIGHT © 2021 UNDERWRITERS LABORATORIES INC.

No Text on This Page

ULNORM.COM : Click to view the full PDF of UL 1815 2021

CONTENTS

INTRODUCTION

1	Scope	7
2	Undated References	7
3	Units of Measurement	7
4	Glossary	7

CONSTRUCTION

5	General	10
6	Component	10
7	Frame and Enclosure	11
	7.1 General	11
	7.2 Nonmetallic enclosure parts	13
	7.3 Accessibility of live parts	14
8	Attachment Plugs, Receptacles, Connectors, and Terminals	19
9	Controls	20
	9.1 General	20
	9.2 Electromechanical and electronic controls	21
	9.3 Motor and speed control	21
	9.4 Temperature controls	22
10	Light sources and associated components	22
11	Cords, Cables, and Internal Wiring	22
12	Power Supplies	23
13	Printed Wiring Boards	23
14	Supplemental Insulation, Insulating Bushings, and Assembly Aids	23
15	Valves (Electrically Operated) and Solenoids	24
16	Transformers	24
17	Protection Against Corrosion	25
18	Protection Against Risk of Fire	27
19	Mechanical Assembly	30
20	Power Supply Connections	31
	20.1 Permanently connected appliances	31
	20.2 Cord-connected appliances	35
21	Live Parts	37
22	Internal Wiring	37
23	Heating Elements	39
24	Insulating Material	39
25	Lampholders	40
26	Receptacles	40
27	Motors	40
	27.1 General	40
	27.2 Protection	40
	27.3 Commercial or industrial appliances	42
28	Thermostats	43
29	Limiting Controls	43
30	Grounding	44
31	Capacitors	45
32	Spacings	46
	32.1 General	46
	32.2 Low-voltage, power-limited circuits	48
32A	Clearance and Creepage Distances	49
33	Filters and Heat Transfer Media	49

34	Polymeric and Other Nonmetallic Materials	52
	34.1 General.....	52
	34.2 Material classification	52
	34.3 Ignition sources	53
	34.4 Material applications	53
35	Overload-Protective Devices	53
36	Switches, Including Motor Controllers	54
37	Controls – End Product Test Parameters	55
	37.1 General.....	55
	37.2 Auxiliary controls	55
	37.3 Operating controls (regulating controls)	55
	37.4 Protective controls (limiting controls)	57
	37.5 Controls using a temperature sensing device.....	58

UL 60335-1 BASED REQUIREMENTS FOR THE EVALUATION OF ELECTRONIC CIRCUITS

37A	General	59
37B	Components	59
	37B.1 Capacitors	59
	37B.2 Isolation devices.....	59
	37B.3 Printed-wiring boards.....	60
	37B.4 Bridging components – switch mode power supplies	60
	37B.5 Switch mode power supply insulation system.....	60
37C	Identification of Safety Critical Circuit Functions	60
	37C.1 General	60
	37C.2 Protective electronic circuits.....	60
	37C.3 Operating circuits that mitigate a dangerous malfunction of the appliance	61
37D	Evaluation of the Different Types of Electronic Circuits.....	61
37E	Circuits that Provide Safety Critical Functions.....	61
37F	General Conditions for the Tests.....	62
	37F.1 Details.....	62
	37F.2 Intentionally weak parts.....	62
	37F.3 Test results determined by overcurrent protection operation	62
37G	Low-Power Circuits	63
37H	Abnormal Operation and Fault Tests.....	64
37I	Programmable Component Reduced Supply Voltage Test.....	65
37J	Electromagnetic Compatibility (EMC) Requirements – Immunity	66
37K	Manufacturing and Production and Line Testing.....	67

PROTECTION AGAINST INJURY TO PERSONS

38	General	67
39	Accessories	67
40	Switches and Controls	67
41	Enclosures and Guards	68
	41.1 General.....	68
	41.2 Impact test	70
	41.3 Duct-connected appliances	70
42	Temperature	70

PERFORMANCE

43	General	71
44	Starting Current Test.....	71
45	Leakage Current Test	72

46	Input Test.....	75
47	Temperature Test	76
	47.1 General.....	76
48	Undervoltage Test	82
49	Dielectric Voltage-Withstand Test	82
50	Water Spray Test.....	82
	50.1 Permanently connected appliance	82
	50.2 Cord-connected appliances	83
	50.3 Water resistivity	84
	50.4 Test apparatus.....	84
51	Metallic Coating Thickness Test.....	87
52	Continuity of Grounding Circuit Test.....	88
53	Capacitor Tests	88
54	Humidity Conditioning Test.....	88
55	Blade Ignition Test.....	89
56	Strain Relief Test	90
57	Push-Back Test.....	91
58	Abnormal Operation Tests.....	91
59	Abnormal Heating	91
60	Endurance	92
61	Thermal Cutoffs	92
62	Tests of Switches and Controls.....	93
	62.1 Overload.....	93
	62.2 Reversing	93
63	Bonding Connection Test	93
64	Conformal Coatings Tests	94
65	Permanence of Marking Tests	94
66	Condensation Test	94
67	Tests for Polymeric Materials.....	95
	67.1 General.....	95
	67.2 Flammability – 5 inch flame	95
	67.3 Heat deflection test	96
	67.4 Water absorption test	96
	67.5 Air-oven aging	96
	67.6 Tensile-strength test.....	97
	67.7 Flexural-strength test	97
	67.8 Izod impact test	97
	67.9 Tensile-impact test.....	97
	67.10 Impact test	98
	67.11 Volume resistivity tests	98

MANUFACTURING AND PRODUCTION TESTS

68	Dielectric Voltage-Withstand Test	98
69	Grounding Continuity Test.....	100

INSTALLATION INSTRUCTIONS

70	Details.....	100
----	--------------	-----

RATING

71	Details.....	100
----	--------------	-----

MARKING

72	Details.....	101
	72.1 General.....	101
	72.2 Commercial or industrial appliances.....	104
73	Important Safety Instructions.....	104

Appendix A

A1	Example of Controls Performing as Operating or Protective Controls (Informative).....	106
----	---	-----

ULNORM.COM : Click to view the full PDF of UL 1815 2021

INTRODUCTION

1 Scope

1.1 These requirements cover nonducted, stationary or fixed heat recovery ventilators for household, commercial, or industrial use and intended to be employed in accordance with the National Electrical Code, ANSI/NFPA 70.

1.2 These requirements cover heat recovery ventilators rated 600 volts or less.

1.3 These requirements cover heat recovery ventilators that may be mounted through a wall or ceiling, or in a window.

1.4 These requirements cover heat recovery ventilators that may employ short ducts intended to bring air to and from the equipment. These requirements do not cover heat recovery ventilators employing ducts intended to supply conditioned air for environmental heating and/or cooling or distribute air throughout a building; such units are judged under the requirements in the Standard for Ducted Heat Recovery Ventilators, UL 1812. These requirements do not preclude a preheater provided as part of the air exchange system.

2 Undated References

2.1 Any undated reference to a code or standard appearing in the requirements of this standard shall be interpreted as referring to the latest edition of that code or standard.

3 Units of Measurement

3.1 Values stated without parentheses are the requirement. Values in parentheses are explanatory or approximate information.

4 Glossary

4.1 For the purpose of this standard the following definitions apply.

4.1.1 CAPACITOR, CLASS X – Capacitor or RC unit of a type suitable for use in situations where failure of the capacitor or RC unit would not lead to danger of electrical shock but could result in a risk of fire. Examples would be units connected phase to phase or phase to neutral.

Note 1: X1 capacitors are generally used in circuits of permanently connected appliances. However, if the appliance is provided with a separate surge protective device that limits the impulse voltage to $\leq 2.5\text{KV}$, an X2 capacitor is permitted.

Note 2: X2 capacitors are generally used in circuits of cord-connected appliances.

4.1.2 CAPACITOR, CLASS Y – Capacitor or RC unit of a type suitable for use in situations where failure of the capacitor could lead to danger of electric shock. Examples would be capacitors connected across the primary and secondary circuits where electrical isolation is required to prevent an electric shock or between hazardous live parts and accessible parts.

Note 1: Y1 capacitors are used in circuits where the prevention of electric shock is afforded solely by the isolation provided by the capacitor. Two Y2 capacitors connected in series is considered to provide the same level of protection as one Y1 capacitor.

Note 2: Y2 capacitors are used where the prevention of electric shock is provided by the combination of the capacitor and earth ground for circuits operating at voltages $\geq 150\text{V}$ and $\leq 300\text{V}$.

Note 3: Y4 capacitors are used where the prevention of electric shock is provided by the combination of the capacitor and earth ground for circuits operating at voltages $\leq 150\text{V}$.

4.2 CONTROL, AUTOMATIC – A control in which at least one aspect is non-manual.

4.3 CONTROL, AUXILIARY – A device or assembly of devices that provides a functional utility, is not relied upon as an operational or protective control, and therefore is not relied upon for safety. For example, an efficiency control not relied upon to reduce the risk of electric shock, fire, or injury to persons during normal or abnormal operation of the end product is considered an auxiliary control.

4.4 CONTROL, MANUAL – A device that requires direct human interaction to activate or rest the control.

4.5 CONTROL, OPERATING – A device or assembly of devices, the operation of which starts or regulates the end product during normal operation. For example, a thermostat, the failure of which a thermal cutout/limiter or another layer of protection would mitigate the potential hazard, is considered an operating control. Operating controls are also referred to as “regulating controls”.

4.6 CONTROL, PROTECTIVE – A device or assembly of devices, the operation of which is intended to reduce the risk of electric shock, fire or injury to persons during normal and reasonably anticipated abnormal operation of the appliance. For example, a thermal cutout/limiter, or any other control/circuit relied upon for normal and abnormal conditions, is considered a protective control. Protective controls are also referred to as “limiting controls” and “safety controls”.

4.7 CONTROL, TYPE 1 – The actuation of an automatic control for which the manufacturing deviation and the drift (tolerance before and after certain conditions) of its operating value, operating time, or operating sequence has not been declared and tested under this standard.

4.8 CONTROL, TYPE 2 – The actuation of an automatic control for which the manufacturing deviation and the drift (tolerance before and after certain conditions) of its operating value, operating time, or operating sequence have been declared and tested under this standard.

4.8.1 DANGEROUS MALFUNCTION – Unintended operation of the appliance that may impair safety. Operating Control functions whose failure would result in a Dangerous Malfunction would be considered Safety Critical Functions. See [4.15.3](#).

Note: Control functions whose failure might result in a Dangerous Malfunction would include:

- a) Unexpected operation of the appliance where the operation would result in risk of electric shock, fire or mechanical risk of injury.
- b) Unattended energization of a heating appliance where the user has placed flammable materials near the appliance based on the assumption the appliance would remain off.

Adapted by UL from IEC 60335-1 Ed. 5.1 b: 2013 with permission of the American National Standards Institute (ANSI) on behalf of the International Electrotechnical Commission. All rights reserved.

4.9 DUCT FAN – A straight-through ventilator provided with flanges for connection to a duct and which may be used with heated air.

4.9.1 ELECTRONIC DISCONNECTION – The de-energizing of the functional load of the appliance by an electronic device of a circuit with no air gap.

4.10 ENCLOSURE – That part of a unit which by itself or in conjunction with barriers reduces the risk of contacting all or any parts of the unit that may otherwise present a risk of electric shock or injury to persons and/or prevents propagation of flame initiated by electrical disturbances occurring within.

4.11 FIELD WIRING TERMINAL – A terminal to which a wire may be connected in the field, unless the wire and a means of making the connection – such as a pressure terminal connector, soldering lug, soldered loop, or crimped eyelet – that is factory assembled to the wire are provided as part of the heat recovery ventilator.

4.12 FUNCTIONAL PART – A part other than an enclosure or structural part that is necessary for the intended operation of a unit.

4.13 HEAT RECOVERY VENTILATOR – A product intended to remove air from a building, replace it with air outside the building and in the process transfer heat from the warmer to the colder air.

4.13.1 INTENTIONALLY WEAK PART – A part intended to rupture under conditions of abnormal operation to prevent the occurrence of a condition which could impair compliance with this standard.

4.13.2 LOW-POWER CIRCUIT – A circuit or parts of circuits farther from the supply source than a low-power point.

4.13.3 LOW-POWER POINT – A point closest to the supply source in an electronic circuit where the maximum available power to an external load at the end of 5 seconds does not exceed 15 watts.

4.14 MOTORS:

a) OPEN MOTOR – A motor having ventilating openings that permit passage of external cooling air over and around the windings of the motor.

b) TOTALLY ENCLOSED MOTOR – A motor that is enclosed so as to prevent the free exchange of air between the inside and outside of the case but not sufficiently enclosed to be termed airtight.

c) TOTALLY ENCLOSED FAN-COOLED MOTOR – A totally enclosed motor with external cooling by a fan or fans integral with the motor but external to the enclosing parts.

4.15 POWER VENTILATOR – A ventilator that consists of an impeller – which may be of the centrifugal, axial, or propeller type – and an integral driver. A power ventilator is:

a) Installed in a weather-resisting base intended to fit, usually by a curb, over a wall or roof opening, or

b) Provided with flanges for connection to a duct.

4.15.1 PROTECTIVE ELECTRONIC CIRCUIT (PEC) – An electronic circuit that prevents a hazardous situation under abnormal operating conditions. The function of a Protective Electronic Circuit would be considered a Safety Critical Function. See [4.15.4](#).

Adapted by UL from IEC 60335-1 Ed. 5.1 b: 2013 with permission of the American National Standards Institute (ANSI) on behalf of the International Electrotechnical Commission. All rights reserved.

4.15.2 RISK OF ELECTRIC SHOCK – A risk of electric shock is considered to exist within a circuit unless the circuit meets one of the following criteria. The circuit shall be supplied by an isolating source such that:

a) The voltage does not exceed 30 V rms;

b) The voltage does not exceed 42.4 V peak;

c) The voltage does not exceed 60 V dc continuous; or

d) The voltage does not exceed 24.8 V peak for DC interrupted at a rate of 200 Hz or less with approximately 50 percent duty cycle.

e) When protective impedance is used, the current available through a 1500 ohm resistor between the part or parts and either pole of the supply source does not exceed 0.7 mA peak or 2 mA DC.

4.15.3 RISK OF FIRE – A risk of fire is considered to exist at any two points in a circuit where a power of more than 15 watts can be delivered into an external resistor connected between the two points.

4.15.4 SAFETY CRITICAL FUNCTION – Control, protection and monitoring functions which are being relied upon to reduce the risk of fire, electric shock or casualty hazards.

Adapted by UL from IEC 60335-1 Ed. 5.1 b: 2013 with permission of the American National Standards Institute (ANSI) on behalf of the International Electrotechnical Commission. All rights reserved.

4.16 STRUCTURAL PART – A part used in such a manner that failure of the part may present a risk of electric shock or injury to persons.

4.17 USER SERVICING – Any form of servicing, such as routine cleaning, changing a filter or a heat exchange medium, and the like, that might be performed by personnel other than those trained to maintain the appliance.

CONSTRUCTION

5 General

5.1 An appliance shall employ materials that are acceptable for the particular use.

6 Component

6.1 A component of a product covered by this standard shall:

- a) Comply with the requirements for that component;
- b) Be used in accordance with its rating(s) established for the intended conditions of use;
- c) Be used within its established use limitations or conditions of acceptability;
- d) Additionally comply with the applicable requirements of this end product standard; and
- e) Not contain mercury.

Exception No. 1: A component of a product covered by this standard is not required to comply with a specific component requirement that:

- a) Involves a feature or characteristic not required in the application of the component in the product;*
- b) Is superseded by a requirement in this standard; or*
- c) Is separately investigated when forming part of another component, provided the component is used within its established ratings and limitations.*

Exception No. 2: A component complying with a UL component standard other than those cited in this standard is acceptable if:

a) The component also complies with the applicable component standard; or

b) The component standard:

- 1) Is compatible with the ampacity and overcurrent protection requirements in the National Electrical Code, NFPA 70, where appropriate;
- 2) Considers long-term thermal properties of polymeric insulating materials in accordance with the Standard for Polymeric Materials – Long Term Property Evaluations, UL 746B; and
- 3) Any use limitations of the other component standard is identified and appropriately accommodated in the end use application. For example, a component used in a household application, but intended for industrial use and complying with the relevant component standard may assume user expertise not common in household applications.

6.2 Specific components are incomplete in construction features or restricted in performance capabilities. Such components are intended for use only under limited conditions, such as certain temperatures not exceeding specified limits, and shall be used only under those specific conditions.

6.3 A component that is also intended to perform other functions, such as over current protection, ground-fault circuit-interruption, surge suppression, any other similar functions, or any combination thereof, shall comply additionally with the requirements of the applicable UL standard(s) that cover devices that provide those functions.

Exception: Where these other functions are not required for the application and not identified as part of markings, instructions, or packaging for the appliance, the additional component standard(s) need not be applied.

6.4 A component not anticipated by the requirements of this standard and that involves a potential risk of electric shock, fire, or personal injury, shall be additionally investigated in accordance with the applicable UL standard, and shall comply with [6.1](#) (b) + (d).

6.5 With regard to a component being additionally investigated, reference to construction and performance requirements in another UL end product standard is appropriate where that standard anticipates normal and abnormal use conditions consistent with the application of this standard.

7 Frame and Enclosure

7.1 General

7.1.1 An appliance shall be formed and assembled so that it will have the strength and rigidity necessary to resist the abuses to which it may be subjected, without resulting in a risk of fire, electrical shock, or injury to persons due to total or partial collapse with a resulting reduction of spacings, loosening or displacement of parts, or other serious defects.

7.1.2 A cast- or sheet-metal section of the enclosure shall not be thinner than the applicable value specified in [Table 7.1](#).

Exception No. 1: A small area or surface that is curved or otherwise reinforced to provide equivalent mechanical strength need not comply with the specifications in the first column of thicknesses in [Table 7.1](#).

Exception No. 2: A section of the enclosure made of uncoated or galvanized sheet steel or cast malleable iron may be thinner than the specifications in the first column of thicknesses in [Table 7.1](#) if such factors as the following are considered acceptable:

- a) *Mechanical strength and impact resistance with regard to intended use and location of the appliance;*
- b) *Resistance to corrosion;*
- c) *Size and shape; and*
- d) *Location on the appliance.*

Table 7.1
Minimum acceptable thicknesses of enclosure metal

Metal	At small, flat, unreinforced surfaces and at surfaces of a shape or size to provide adequate mechanical strength, inch (mm)		At surfaces to which a wiring system is to be connected in the field, inch (mm) ^a	At large, unreinforced, flat surfaces, inch (mm)		
Die-cast metal	3/64	(1.2)	–	5/64	(2.0)	
Cast malleable iron	1/16	(1.6)	–	3/32	(2.4)	
Other cast metal	3/32	(2.4)	–	1/8	(3.2)	
Uncoated sheet steel	0.026	(0.66)	0.032	(0.81)	0.026	(0.66)
Galvanized sheet steel	0.029	(0.74)	0.034	(0.86)	0.029	(0.74)
Nonferrous sheet metal	0.036	(0.91)	0.045	(1.14)	0.036	(0.91)

^a A sheet-metal wall of thickness less than that specified is acceptable if it is not less than 0.026 inch (0.66 mm) and the area surrounding the knockout has a thickness not less than 0.053 inch (1.35 mm).

7.1.3 Among the factors to be considered when judging a nonmetallic enclosure, including one of polymeric material, or a magnesium enclosure are:

- a) Mechanical strength;
- b) Resistance to impact;
- c) Moisture-absorptive properties;
- d) Combustibility;
- e) Resistance to arcing;
- f) Resistance to distortion at temperatures to which the enclosure may be subjected under conditions of normal or abnormal use; and
- g) For a polymeric enclosure, thermal aging.

7.1.4 For a polymeric enclosure all of the factors in [7.1.3](#) are considered with respect to aging. See Nonmetallic enclosure parts, Section [7.2](#); and Polymeric and Other Nonmetallic Materials, Section [34](#).

7.1.5 An overall enclosure for electrical components of an appliance intended for outdoor exposure shall have provision for drainage. See [20.1.1.12](#).

7.1.6 An appliance shall have provision for condensate drainage that shall be located below the lowest electrical part when installed as intended. The smallest dimension of the hole shall be at least 1/2 inch (12.7 mm).

7.2 Nonmetallic enclosure parts

7.2.1 Polymeric material or other material having a flame-spread rating greater than zero in accordance with the Standard for Tests for Surface Burning Characteristics of Building Materials, UL 723, shall not be employed as an enclosure or a skirt or other part of a venturi system of an appliance that is intended to be:

- a) Permanently connected electrically and
- b) Installed within a building structure so that the portion of the appliance enclosed within the wall is not visible to the user.

7.2.2 Unless otherwise specified in this end product standard, polymeric electrical insulating materials and enclosures shall comply with the applicable requirements of the Standard for Polymeric Materials – Use in Electrical Equipment Evaluations, UL 746C.

7.2.3 Metallized or painted polymeric parts or enclosures shall comply with the applicable requirements of the Standard for Polymeric Materials – Use in Electrical Equipment Evaluations, UL 746C.

Exception: This requirement is not applicable to exterior surfaces of polymeric enclosure materials or parts provided that the metallized coating or paint does not offer a continuous path for an internal flame to propagate externally.

7.2.4 A fan blade (air impeller) of polymeric material outside a motor shall not be located within 1 inch (25.4 mm) of an opening in the motor housing.

Exception: A fan blade may be within 1 inch of an opening in the motor housing if:

- a) The material is classed as V-2, V-1, V-0, or V in accordance with the Standard for Tests for Flammability of Plastic Materials for Parts in Devices and Appliances, UL 94, or
- b) The material complies with the requirements for enclosure flammability using a 3/4-inch (19.1-mm) flame, in accordance with the Standard for Polymeric Materials – Use in Electrical Equipment Evaluations, UL 746C, or
- c) No motor opening within 1 inch of the blade has a dimension more than 17/64 inch (6.75 mm) or an area more than 0.055 square inch (35.5 mm²), and no more than six such openings are provided, or
- d) In a skeleton or open frame type motor,
 - 1) The fan blade is of material classed HB or less flammable in accordance with the Standard for Tests for Flammability of Plastic Materials for Parts in Devices and Appliances, UL 94,
 - 2) The coil is completely wrapped with insulation at least 1/32 inch (0.8 mm) thick, and
 - 3) The space between the coil wrap and bobbin does not exceed 1/32 inch, or
- e) The material has a hot wire ignition rating of at least 7 seconds as described in the Standard Test Method for Ignition of Materials by Hot Wire Sources, ASTM D3874, or
- f) The fan employs a thermally protected motor to drive the blade and complies with the test requirements in the Blade Ignition Test, Section [55](#).

7.3 Accessibility of live parts

7.3.1 To reduce the likelihood of unintentional contact that may involve a risk of electric shock from uninsulated live parts and film-coated wire, an opening in an enclosure of an appliance or in a motor shall be investigated as described in (a) or (b):

- a) For an opening that has a minor dimension (see [7.3.5](#)) less than 1 inch (25.4 mm), such a part and film-coated wire shall not be contacted by the probe illustrated in [Figure 7.1](#).
- b) For an opening that has a minor dimension of 1 inch or more, neither an uninsulated live part nor film-coated wire shall be within X inches of the perimeter of the opening or within the volume generated by projecting the perimeter X inches normal to its plane. X equals five times the minor dimension of the opening, but not less than 6-1/16 inches (154 mm). See [Figure 7.2](#).

Exception: A motor need not comply with these requirements if it complies with the requirements in [7.3.2](#).

ULNORM.COM : Click to view the full PDF of UL 1815 2021

Figure 7.1
Articulate probe with web stop


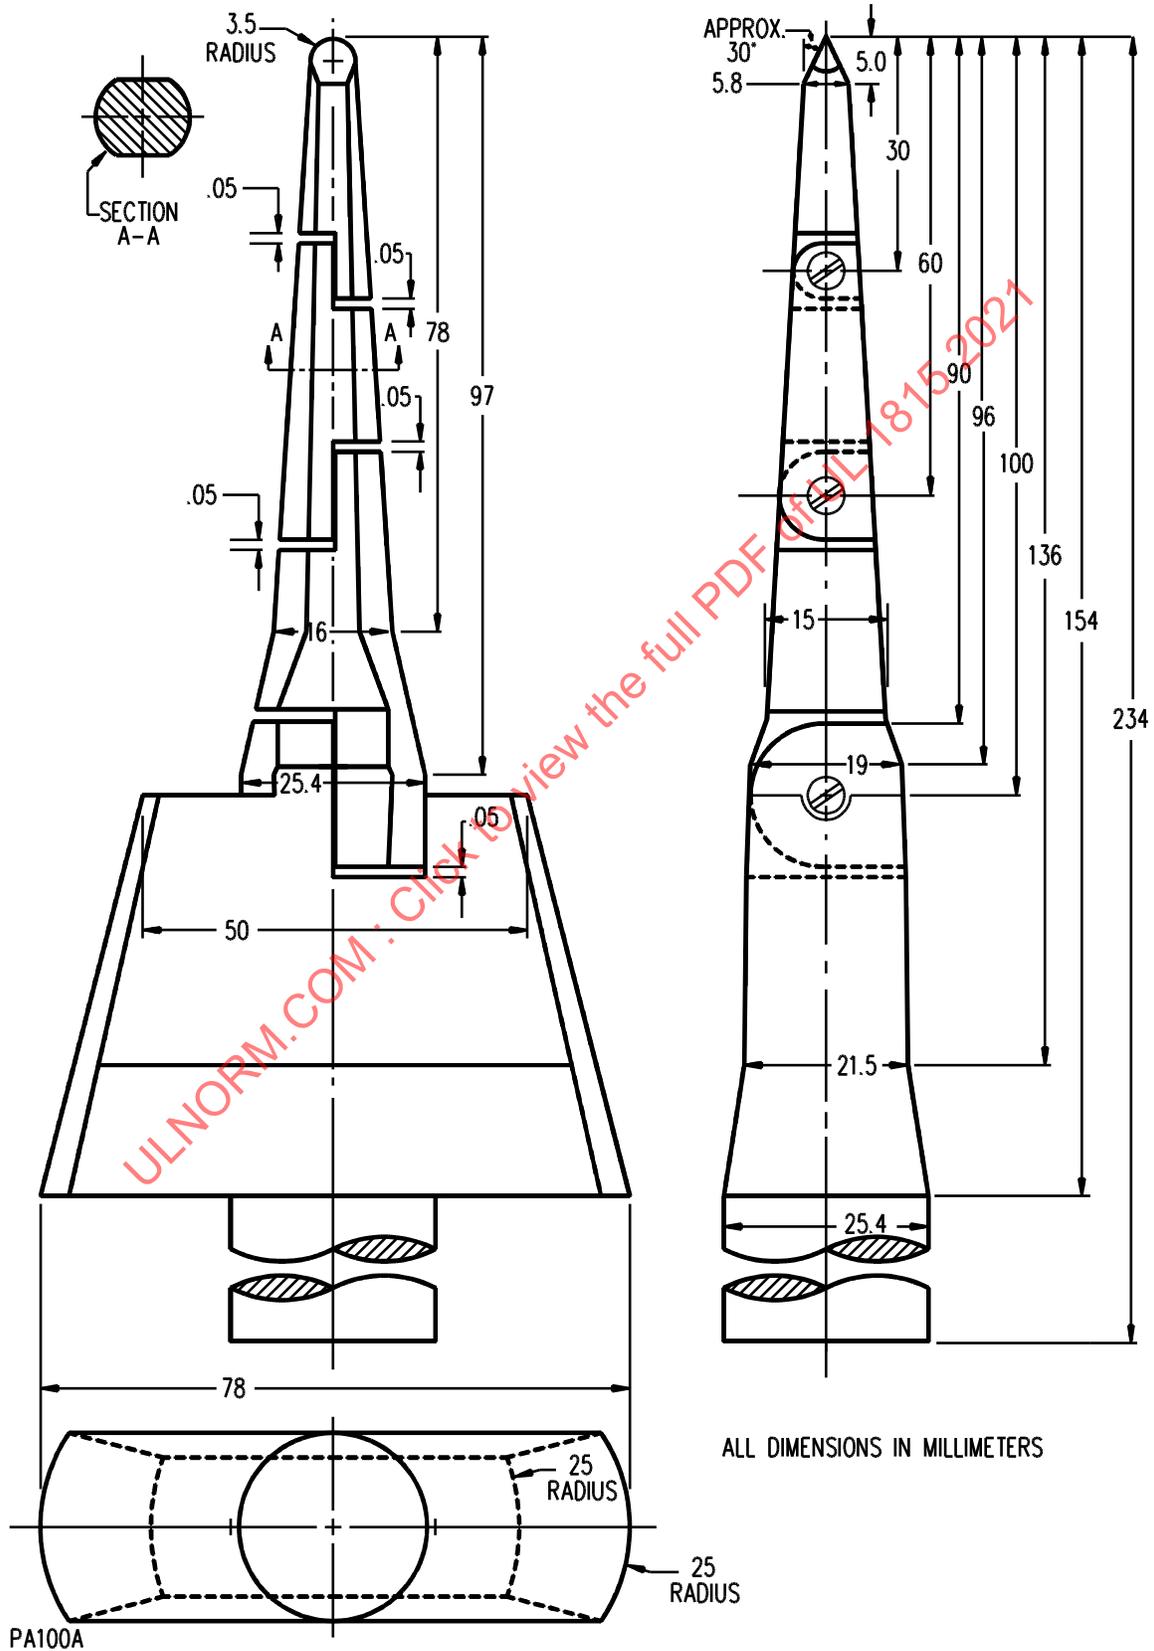


Figure 7.2
Opening in enclosure

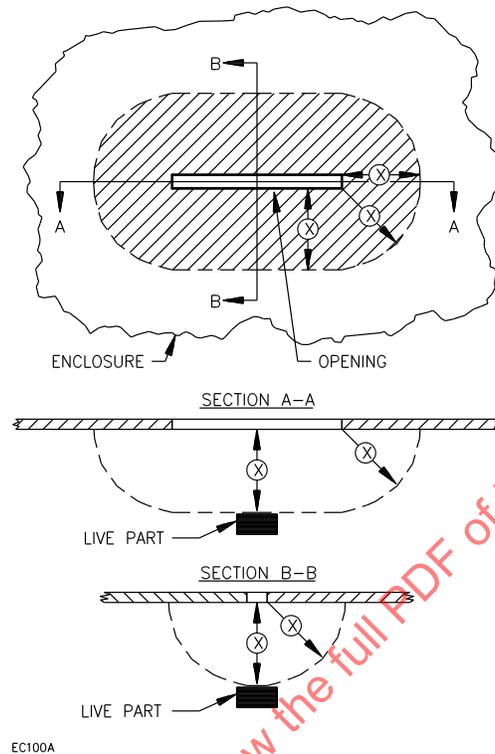


7.3.2 With respect to a part or wire as mentioned in [7.3.1](#), in a motor as mentioned in the exception to [7.3.1](#):

- a) An opening that has a minor dimension (see [7.3.5](#)) less than 3/4 inch (19.1 mm) is acceptable if:
- 1) Film-coated wire cannot be contacted by the probe illustrated in [Figure 7.4](#);
 - 2) In a directly accessible motor (see [7.3.6](#)), an uninsulated live part cannot be contacted by the probe illustrated in [Figure 7.5](#); or
 - 3) In an indirectly accessible motor (see [7.3.6](#)), an uninsulated live part cannot be contacted by the probe illustrated in [Figure 7.3](#).

b) An opening that has a minor dimension of 3/4 inch or more is acceptable if an uninsulated live part or film-coated wire is not within X inches of the perimeter of the opening or within the volume generated by projecting the perimeter X inches normal to its plane. X equals five times the minor dimension of the opening, but not less than 3-5/32 inches (80 mm) for contact with an uninsulated live part through an opening in the enclosure of a directly accessible motor and 4 inches (102 mm) for all other openings. See [Figure 7.2](#).

Figure 7.3
Probe for uninsulated live parts

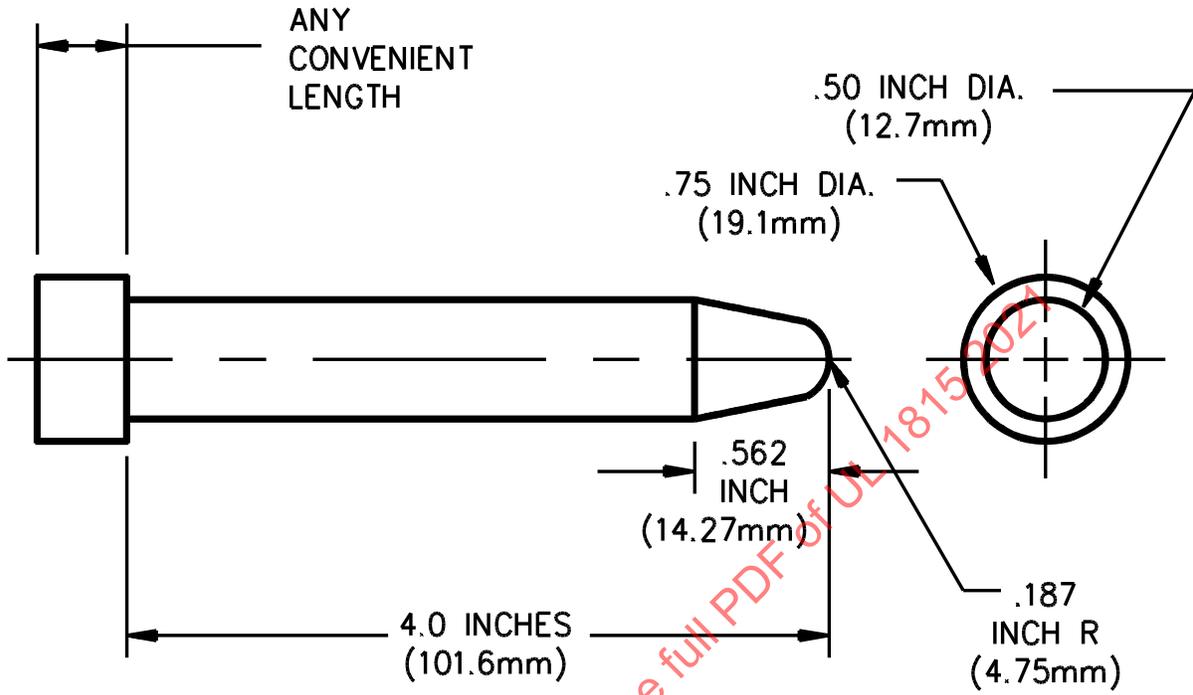

PA135

ULNORM.COM : Click to view the full PDF of UL 1815

Figure 7.4
Probe for film-coated wire

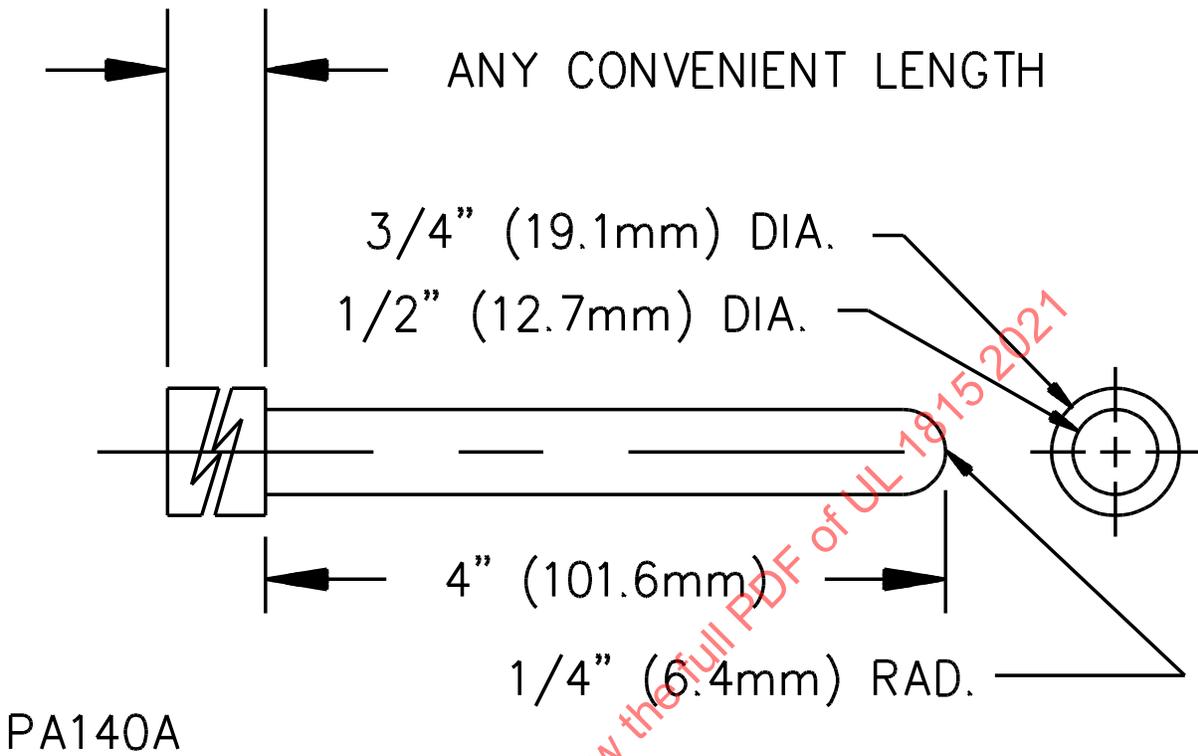


Figure 7.5
IEC articulate probe

